

MasterWorks - 130 Cedar Building, Community Monitoring														Total Structure Count			Asbestos	Asbestos	Result	Concentration	EPA Site Specific	Exceeds EPA Site Specific	Comments
Sample No.	Sampling Location	Collection Start Date	Collection Time (on)	Collection End Date	Collection Time (off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	All Asbestos	Chrysotile	Amphibole	< 5 µm	2.5 µm	(S/m <sup>2</sup> )	(\$/cc)	Trigger Level	Trigger Level?			
5271591	3 - 90 West Courtyard at 2nd Floor Level	1/20/2008	7:17 AM	1/20/2008	1:18 PM	361	2,527	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 12.9	< 0.0020	70 S/m <sup>2</sup>	No			
5271592	4 - Albany St 6th Floor Scaffolding	1/20/2008	7:07 AM	1/20/2008	12:36 PM	329	2,303	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	1	1	0	0	1	11.6	0.0019	70 S/m <sup>2</sup>	No			
5271593	5 - Washington St 6th Floor Scaffolding	1/20/2008	7:05 AM	1/20/2008	12:32 PM	327	2,289	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 11.6	< 0.0020	70 S/m <sup>2</sup>	No			
5271594	6 - Cedar St 6th Floor Scaffolding	1/20/2008	7:00 AM	1/20/2008	12:26 PM	326	2,282	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 11.6	< 0.0020	70 S/m <sup>2</sup>	No			
5271595	7 - Roof, East Facade	1/20/2008	7:07 AM	1/20/2008	12:04 PM	297	2,005	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 9.7	< 0.0019	70 S/m <sup>2</sup>	No			
5271596	8 - Roof, North Facade	1/20/2008	7:12 AM	1/20/2008	12:10 PM	298	2,096	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	1	1	0	0	0	10.5	0.0019	70 S/m <sup>2</sup>	No			
5271579	3 - 90 West Courtyard at 2nd Floor Level	1/21/2008	7:40 AM	1/21/2008	3:31 PM	471	1,796	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271580	4 - Albany St 6th Floor Scaffolding	1/21/2008	7:17 AM	1/21/2008	3:26 PM	489	1,660	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 8.9	< 0.0020	70 S/m <sup>2</sup>	No			
5271581	5 - Washington St 6th Floor Scaffolding	1/21/2008	7:18 AM	1/21/2008	3:25 PM	487	1,680	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271582	6 - Cedar St 6th Floor Scaffolding	1/21/2008	7:19 AM	1/21/2008	3:24 PM	485	1,746	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 8.9	< 0.0020	70 S/m <sup>2</sup>	No			
5271583	7 - Roof, East Facade	1/21/2008	7:27 AM	1/21/2008	3:20 PM	473	1,679	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271584	8 - Roof, North Facade	1/21/2008	7:28 AM	1/21/2008	3:21 PM	473	1,703	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/22/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271728	3 - 90 West Courtyard at 2nd Floor Level	1/22/2008	8:00 AM	1/22/2008	3:26 PM	446	1,595	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/23/2008	0	0	0	0	0	< 7.7	< 0.0019	70 S/m <sup>2</sup>	No			
5271729	4 - Albany St 6th Floor Scaffolding	1/22/2008	7:36 AM	1/22/2008	3:16 PM	460	1,633	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/23/2008	0	0	0	0	0	< 8.3	< 0.0020	70 S/m <sup>2</sup>	No			
5271730	5 - Washington St 6th Floor Scaffolding	1/22/2008	7:38 AM	1/22/2008	3:17 PM	459	1,607	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/23/2008	0	0	0	0	0	< 8.3	< 0.0020	70 S/m <sup>2</sup>	No			
5271731	6 - Cedar St 6th Floor Scaffolding	1/22/2008	7:40 AM	1/22/2008	3:20 PM	460	1,633	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/23/2008	0	0	0	0	0	< 8.3	< 0.0020	70 S/m <sup>2</sup>	No			
5271732	7 - Roof, East Facade	1/22/2008	7:24 AM	1/22/2008	2:59 PM	455	1,593	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/23/2008	0	0	0	0	0	< 7.7	< 0.0019	70 S/m <sup>2</sup>	No			
5271733	8 - Roof, North Facade	1/22/2008	7:29 AM	1/22/2008	3:03 PM	454	1,634	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/23/2008	0	0	0	0	0	< 8.3	< 0.0020	70 S/m <sup>2</sup>	No			
5271567	3 - 90 West Courtyard at 2nd Floor Level	1/23/2008	7:23 AM	1/23/2008	3:11 PM	468	1,638	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/24/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271568	4 - Albany St 6th Floor Scaffolding	1/23/2008	7:52 AM	1/23/2008	3:31 PM	459	1,652	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/24/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271598	5 - Washington St 6th Floor Scaffolding	1/23/2008	7:54 AM	1/23/2008	3:17 PM	443	1,655	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/23/2008	1	1	0	0	1	8.3	0.0020	70 S/m <sup>2</sup>	No			
5271569	5 - Washington St 6th Floor Scaffolding	1/23/2008	7:54 AM	1/23/2008	3:33 PM	459	1,652	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/24/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271570	6 - Cedar St 6th Floor Scaffolding	1/23/2008	7:55 AM	1/23/2008	3:35 PM	460	1,656	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/24/2008	1	1	0	1	0	8.3	0.0019	70 S/m <sup>2</sup>	No			
5271571	7 - Roof, East Facade	1/23/2008	7:43 AM	1/23/2008	3:22 PM	459	1,652	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/24/2008	1	1	0	1	0	8.3	0.0019	70 S/m <sup>2</sup>	No			
5271572	8 - Roof, North Facade	1/23/2008	7:45 AM	1/23/2008	3:26 PM	461	1,660	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/24/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271555	3 - 90 West Courtyard at 2nd Floor Level	1/24/2008	6:55 AM	1/24/2008	3:17 PM	462	1,757	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/25/2008	0	0	0	0	0	< 8.9	< 0.0020	70 S/m <sup>2</sup>	No			
5271556	4 - Albany St 6th Floor Scaffolding	1/24/2008	7:21 AM	1/24/2008	3:07 PM	502	1,640	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/25/2008	0	0	0	0	0	< 8.9	< 0.0019	70 S/m <sup>2</sup>	No			
5271557	5 - Washington St 6th Floor Scaffolding	1/24/2008	7:22 AM	1/24/2008	3:04 PM	462	1,571	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/25/2008	0	0	0	0	0	< 7.7	< 0.0019	70 S/m <sup>2</sup>	No			
5271558	6 - Cedar St 6th Floor Scaffolding	1/24/2008	7:25 AM	1/24/2008	3:04 PM	461	1,591	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/25/2008	1	1	0	1	0	7.7	0.0019	70 S/m <sup>2</sup>	No			
5271559	7 - Roof, East Facade	1/24/2008	7:14 AM	1/24/2008	2:55 PM	461	1,567	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/25/2008	0	0	0	0	0	< 7.7	< 0.0019	70 S/m <sup>2</sup>	No			
5271560	8 - Roof, North Facade	1/24/2008	7:15 AM	1/24/2008	2:57 PM	462	1,617	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/25/2008	0	0	0	0	0	< 8.3	< 0.0020	70 S/m <sup>2</sup>	No			
5271716	3 - 90 West Courtyard at 2nd Floor Level	1/25/2008	7:39 AM	1/25/2008	3:38 PM	479	1,701	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/26/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271717	4 - Albany St 6th Floor Scaffolding	1/25/2008	7:30 AM	1/25/2008	3:29 PM	479	1,724	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/26/2008	0	0	0	0	0	< 8.9	< 0.0020	70 S/m <sup>2</sup>	No			
5271718	5 - Washington St 6th Floor Scaffolding	1/25/2008	7:31 AM	1/25/2008	3:30 PM	479	1,748	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/26/2008	0	0	0	0	0	< 8.9	< 0.0020	70 S/m <sup>2</sup>	No			
5271719	6 - Cedar St 6th Floor Scaffolding	1/25/2008	7:32 AM	1/25/2008	3:31 PM	479	1,677	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/26/2008	0	0	0	0	0	< 8.3	< 0.0019	70 S/m <sup>2</sup>	No			
5271720	7 - Roof, East Facade	1/25/2008	7:23 AM	1/25/2008	3:26 PM	483	1,763	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/26/2008	0	0	0	0	0	< 8.9	< 0.0019	70 S/m <sup>2</sup>	No			
5271721	8 - Roof, North Facade	1/25/2008	7:24 AM	1/25/2008	3:27 PM	483	1,739	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/26/2008	0	0	0	0	0	< 8.9	< 0.0020	70 S/m <sup>2</sup>	No			
5270823	3 - 90 West Courtyard at 2nd Floor Level	1/26/2008	7:49 AM	1/26/2008	1:32 PM	345	1,226	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/28/2008	0	0	0	0	0	< 6.1	< 0.0019	70 S/m <sup>2</sup>	No			
5270824	4 - Albany St 6th Floor Scaffolding	1/26/2008	8:05 AM	1/26/2008	1:40 PM	333	1,214	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/28/2008	0	0	0	0	0	< 6.1	< 0.0019	70 S/m <sup>2</sup>	No			
5270825	5 - Washington St 6th Floor Scaffolding	1/26/2008	8:06 AM	1/26/2008	1:40 PM	334	1,202	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/28/2008	0	0	0	0	0	< 6.1	< 0.0020	70 S/m <sup>2</sup>	No			
5270826	6 - Cedar St 6th Floor Scaffolding	1/26/2008	8:07 AM	1/26/2008	1:41 PM	334	1,202	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/28/2008	0	0	0	0	0	< 6.1	< 0.0020	70 S/m <sup>2</sup>	No			
5270827	7 - Roof, East Facade	1/26/2008	8:02 AM	1/26/2008	12:02 PM	240	1,468	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/28/2008	0	0	0	0	0	< 7.2	< 0.0019	70 S/m <sup>2</sup>	No			
5270828	8 - Roof, North Facade	1/26/2008	8:00 AM	1/26/2008	12:03 PM	243	1,471	Asbestos	AHERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/28/2008	0	0	0	0	0	< 7.2	< 0.0019	70 S/m <sup>2</sup>	No			

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	Barium Concentration (µg/m³)	Chromium Concentration (µg/m³)	Manganese Concentration (µg/m³)	Zinc Concentration (µg/m³)	Beryllium Concentration (µg/m³)	Copper Concentration (µg/m³)	Mercury Particulate Concentration (µg/m³)	Cadmium Concentration (µg/m³)	Lead Concentration (µg/m³)	Nickel Concentration (µg/m³)	Antimony Concentration (µg/m³)	Exceeds Target Air Quality Levels	Exceeds EPA Site Specific Trigger Levels	Comments
Target Air Quality Levels												5.00	6.00	0.50	160.00	0.20	100.00	3.00	2.00	6.00	20.00	14.00			
EPA Site Specific Trigger Levels												5.00	6.00	0.50	160.00	0.20	100.00	3.00	2.00	6.00	20.00	14.00			
5271814	3- 90 West Courtyard at 2nd Floor Level	1/20/2008	7:38 AM	1/21/2008	7:10 AM	1,412	4,907	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/22/2008	0.010	< 0.041	0.014	0.11	< 0.0020	0.019	< 0.0020	< 0.0020	0.019	0.010	0.014	No	No	
5271800	4- Albany St 6th Floor Scaffolding	1/20/2008	8:00 AM	1/21/2008	7:28 AM	1,348	4,853	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/22/2008	< 0.008	< 0.041	0.009	0.08	< 0.0021	0.013	< 0.0021	< 0.0021	< 0.008	0.013	< 0.012	No	No	
5271794	5- Washington St 6th Floor Scaffolding	1/20/2008	8:28 AM	1/21/2008	7:38 AM	1,390	5,004	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/22/2008	0.012	0.064	0.013	0.07	< 0.0020	0.011	< 0.0020	0.023	0.011	< 0.012	No	No		
5271786	6- Cedar St 6th Floor Scaffolding	1/20/2008	8:09 AM	1/21/2008	7:52 AM	1,423	5,052	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/22/2008	0.012	0.049	0.017	0.11	< 0.0020	0.018	< 0.0020	< 0.0020	0.010	0.012	< 0.012	No	No	
5271774	7- Roof, East Facade	1/20/2008	7:30 AM	1/21/2008	7:38 AM	1,418	5,125	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/22/2008	0.030	0.040	0.025	0.09	< 0.0020	0.060	< 0.0020	< 0.0020	0.111	0.015	< 0.012	No	No	
5271778	8- Roof, North Facade	1/20/2008	7:55 AM	1/21/2008	7:51 AM	1,436	5,089	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/22/2008	0.010	< 0.039	0.015	0.12	< 0.0020	0.018	< 0.0020	0.014	0.012	< 0.012	No	No		
5271810	3- 90 West Courtyard at 2nd Floor Level	1/21/2008	7:14 AM	1/22/2008	7:09 AM	1,435	4,951	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/23/2008	0.018	< 0.040	0.021	0.12	< 0.0020	0.024	< 0.0020	< 0.0020	0.028	0.019	< 0.012	No	No	
5271806	4- Albany St 6th Floor Scaffolding	1/21/2008	7:33 AM	1/22/2008	7:31 AM	1,438	5,357	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/23/2008	0.017	< 0.037	0.014	0.11	< 0.0019	0.015	< 0.0019	< 0.0019	0.011	0.017	< 0.012	No	No	
5271782	5- Washington St 6th Floor Scaffolding	1/21/2008	7:43 AM	1/22/2008	7:59 AM	1,456	5,199	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/23/2008	0.020	0.041	0.020	0.11	< 0.0019	0.019	< 0.0019	< 0.0019	0.020	0.018	< 0.012	No	No	
5271786	6- Cedar St 6th Floor Scaffolding	1/21/2008	7:56 AM	1/22/2008	8:16 AM	1,460	5,037	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/23/2008	0.023	< 0.040	0.032	0.13	< 0.0020	0.023	< 0.0020	0.028	0.016	< 0.012	No	No		
5271790	7- Roof, East Facade	1/21/2008	7:16 AM	1/22/2008	7:03 AM	1,427	5,020	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/23/2008	0.037	0.052	0.032	0.16	< 0.0019	0.082	< 0.0019	< 0.0019	0.140	0.023	< 0.011	No	No	
5271770	8- Roof, North Facade	1/21/2008	8:00 AM	1/22/2008	7:40 AM	1,420	5,025	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/23/2008	0.020	0.052	0.027	0.10	< 0.0020	0.042	< 0.0020	< 0.0020	0.035	0.020	< 0.012	No	No	
5271828	3- 90 West Courtyard at 2nd Floor Level	1/22/2008	7:14 AM	1/23/2008	7:13 AM	1,439	4,965	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/24/2008	0.029	0.048	0.019	0.13	< 0.0020	0.119	< 0.0020	< 0.0020	0.052	0.018	< 0.012	No	No	
5271832	4- Albany St 6th Floor Scaffolding	1/22/2008	7:35 AM	1/23/2008	7:31 AM	1,436	5,134	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/24/2008	0.032	< 0.039	0.022	0.13	< 0.0020	0.054	< 0.0020	< 0.0020	0.036	0.014	< 0.012	No	No	
5271813	5- Washington St 6th Floor Scaffolding	1/22/2008	7:52 AM	1/23/2008	7:44 AM	1,432	4,728	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/24/2008	0.047	< 0.042	0.030	0.17	< 0.0021	0.051	< 0.0021	< 0.0021	0.120	0.014	< 0.013	No	No	
5271836	5- Washington St 6th Floor Scaffolding	1/22/2008	8:04 AM	1/23/2008	7:50 AM	1,428	4,670	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/24/2008	0.041	0.064	0.026	0.10	< 0.0021	0.236	< 0.0021	< 0.0021	0.072	0.013	< 0.013	No	No	
5271840	6- Cedar St 6th Floor Scaffolding	1/22/2008	8:19 AM	1/23/2008	8:02 AM	1,423	4,981	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/24/2008	0.042	0.045	0.027	0.11	< 0.0020	0.304	< 0.0020	0.059	0.013	< 0.012	No	No		
5271844	7- Roof, East Facade	1/22/2008	7:10 AM	1/23/2008	7:00 AM	1,430	5,323	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/24/2008	0.055	0.057	0.035	0.12	< 0.0019	0.197	< 0.0019	< 0.0019	0.171	0.020	< 0.012	No	No	
5271896	8- Roof, North Facade	1/22/2008	7:50 AM	1/23/2008	7:35 AM	1,425	5,232	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/24/2008	0.028	0.041	0.017	0.08	< 0.0019	0.168	< 0.0019	< 0.0019	0.035	0.012	< 0.012	No	No	
5271852	3- 90 West Courtyard at 2nd Floor Level	1/23/2008	7:17 AM	1/24/2008	7:02 AM	1,425	4,774	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/25/2008	0.029	0.068	0.019	0.08	< 0.0021	0.020	< 0.0021	< 0.0021	0.030	0.013	< 0.013	No	No	
5271856	4- Albany St 6th Floor Scaffolding	1/23/2008	7:35 AM	1/24/2008	7:17 AM	1,422	4,977	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/25/2008	0.017	0.060	0.014	0.09	< 0.0020	0.017	< 0.0020	0.017	0.015	< 0.012	No	No		
5271860	5- Washington St 6th Floor Scaffolding	1/23/2008	7:54 AM	1/24/2008	7:29 AM	1,415	4,599	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/25/2008	0.022	0.071	0.018	0.13	< 0.0022	0.026	< 0.0022	< 0.0022	0.024	0.023	< 0.013	No	No	
5271864	6- Cedar St 6th Floor Scaffolding	1/23/2008	8:07 AM	1/24/2008	7:38 AM	1,411	4,868	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/25/2008	0.027	0.051	0.027	0.10	< 0.0021	0.021	< 0.0021	< 0.0021	0.031	0.012	< 0.012	No	No	
5271868	7- Roof, East Facade	1/23/2008	7:36 AM	1/24/2008	6:48 AM	1,422	5,140	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/25/2008	0.036	0.047	0.028	0.13	< 0.0020	0.057	< 0.0020	< 0.0020	0.088	0.030	< 0.012	No	No	
5271848	8- Roof, North Facade	1/23/2008	7:47 AM	1/24/2008	7:21 AM	1,414	5,115	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/25/2008	0.020	< 0.039	0.020	0.09	< 0.0020	0.023	< 0.0020	< 0.0020	0.021	0.021	< 0.012	No	No	
5271876	3- 90 West Courtyard at 2nd Floor Level	1/24/2008	7:06 AM	1/25/2008	7:13 AM	1,447	4,739	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.030	< 0.042	0.022	0.15	< 0.0021	0.045	< 0.0021	< 0.0021	0.076	0.017	< 0.013	No	No	
5271880	4- Albany St 6th Floor Scaffolding	1/24/2008	7:21 AM	1/25/2008	7:48 AM	1,467	4,694	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.033	0.050	0.026	0.14	< 0.0021	0.041	< 0.0021	< 0.0021	0.062	0.017	< 0.013	No	No	
5271884	5- Washington St 6th Floor Scaffolding	1/24/2008	7:33 AM	1/25/2008	8:02 AM	1,469	4,921	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.028	0.051	0.027	0.12	< 0.0020	0.035	< 0.0020	< 0.0020	0.038	0.015	< 0.012	No	No	
5271888	6- Cedar St 6th Floor Scaffolding	1/24/2008	7:42 AM	1/25/2008	8:16 AM	1,474	5,012	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.024	< 0.040	0.025	0.13	< 0.0020	0.027	< 0.0020	< 0.0020	0.018	0.012	< 0.012	No	No	
5271892	7- Roof, East Facade	1/24/2008	6:57 AM	1/25/2008	6:53 AM	1,436	5,203	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.043	0.041	0.030	0.13	< 0.0019	0.072	< 0.0019	< 0.0019	0.121	0.017	< 0.012	No	No	
5271872	8- Roof, North Facade	1/24/2008	7:31 AM	1/25/2008	7:27 AM	1,436	5,137	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.026	< 0.039	0.026	0.09	< 0.0020	0.040	< 0.0020	< 0.0020	0.041	0.012	< 0.012	No	No	
5271798	3- 90 West Courtyard at 2nd Floor Level	1/25/2008	7:19 AM	1/26/2008	7:40 AM	1,461	5,114	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.021	0.046	0.022	0.09	< 0.0020	0.038	< 0.0020	0.022	0.022	< 0.012	No	No		
5271657	4- Albany St 6th Floor Scaffolding	1/25/2008	7:54 AM	1/26/2008	8:45 AM	1,491	5,219	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.015	0.060	0.013	0.09	< 0.0019	0.022	< 0.0019	< 0.0019	0.012	0.017	< 0.012	No	No	
5271661	5- Washington St 6th Floor Scaffolding	1/25/2008	8:09 AM	1/26/2008	9:01 AM	1,492	5,222	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.027	0.054	0.026	0.12	< 0.0019	0.032	< 0.0019	< 0.0019	0.044	0.014	< 0.012	No	No	
5271665	6- Cedar St 6th Floor Scaffolding	1/25/2008	8:18 AM	1/26/2008	9:15 AM	1,497	5,314	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.021	0.045	0.028	0.08	< 0.0019	0.028	< 0.0019	< 0.0019	0.015	0.013	< 0.011	No	No	
5271669	7- Roof, East Facade	1/25/2008	7:30 AM	1/26/2008	7:31 AM	1,471	5,009	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.031	< 0.036	0.028	0.13	< 0.0018	0.066	< 0.0018	< 0.0018	0.087	0.020	< 0.011	No	No	
5271673	8- Roof, North Facade	1/25/2008	7:37 AM	1/26/2008	7:49 AM	1,452	5,311	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.018	0.048	0.020	0.09	< 0.0019	0.037	< 0.0019	< 0.0019	0.016	0.014	< 0.011	No	No	
5271677	3- 90 West Courtyard at 2nd Floor Level	1/26/2008	7:45 AM	1/27/2008	8:26 AM	1,541	5,317	Metals	NIOSH 7300 Modified ICP-MS	R/L/G Metals	1/26/2008	0.028	0.058	0.016	0.08	< 0.0019	0.039								

MasterWorks - 130 Cedar Building, Community Monitoring															
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Mercury Concentration (ng/m <sup>3</sup> )	EPA Site Specific Trigger Level for Mercury (ng/m <sup>3</sup> )	Exceeds Target Air quality or EPA Site Specific Level?	Comments
5271817	3 - 90 West Courtyard at 2nd Floor Level	1/20/2008	7:33 AM	1/21/2008	7:10 AM	1,417	567	Mercury	EPA 324/1631 mod.	BRL	01/22/2008	6	3000 ng/m3	No	
5271803	4 - Albany St 6th Floor Scaffolding	1/20/2008	8:54 AM	1/21/2008	7:28 AM	1,354	548	Mercury	EPA 324/1631 mod.	BRL	01/22/2008	< 6	3000 ng/m3	No	
5271797	5 - Washington St 6th Floor Scaffolding	1/20/2008	8:37 AM	1/21/2008	7:38 AM	1,381	573	Mercury	EPA 324/1631 mod.	BRL	01/22/2008	< 5	3000 ng/m3	No	
5271789	6 - Cedar St 6th Floor Scaffolding	1/20/2008	8:04 AM	1/21/2008	7:52 AM	1,428	578	Mercury	EPA 324/1631 mod.	BRL	01/22/2008	< 5	3000 ng/m3	No	
5271777	7 - Roof, East Facade	1/20/2008	7:30 AM	1/21/2008	7:08 AM	1,418	553	Mercury	EPA 324/1631 mod.	BRL	01/22/2008	< 6	3000 ng/m3	No	
5271781	8 - Roof, North Facade	1/20/2008	7:55 AM	1/21/2008	7:51 AM	1,436	567	Mercury	EPA 324/1631 mod.	BRL	01/22/2008	< 5	3000 ng/m3	No	
5271813	3 - 90 West Courtyard at 2nd Floor Level	1/21/2008	7:14 AM	1/22/2008	7:09 AM	1,435	574	Mercury	EPA 324/1631 mod.	BRL	01/23/2008	< 5	3000 ng/m3	No	
5271809	4 - Albany St 6th Floor Scaffolding	1/21/2008	7:33 AM	1/22/2008	7:51 AM	1,458	547	Mercury	EPA 324/1631 mod.	BRL	01/23/2008	< 6	3000 ng/m3	No	
5271785	5 - Washington St 6th Floor Scaffolding	1/21/2008	7:43 AM	1/22/2008	7:59 AM	1,456	597	Mercury	EPA 324/1631 mod.	BRL	01/23/2008	< 5	3000 ng/m3	No	
5271769	6 - Cedar St 6th Floor Scaffolding	1/21/2008	7:56 AM	1/22/2008	8:16 AM	1,460	584	Mercury	EPA 324/1631 mod.	BRL	01/23/2008	< 5	3000 ng/m3	No	
5271793	7 - Roof, East Facade	1/21/2008	10:36 AM	1/22/2008	7:03 AM	1,227	515	Mercury	EPA 324/1631 mod.	BRL	01/23/2008	< 6	3000 ng/m3	No	Pump flow fault, Replaced/Restarted at 10:36 AM
5271773	8 - Roof, North Facade	1/21/2008	8:00 AM	1/22/2008	7:40 AM	1,420	596	Mercury	EPA 324/1631 mod.	BRL	01/23/2008	< 5	3000 ng/m3	No	
5271831	3 - 90 West Courtyard at 2nd Floor Level	1/22/2008	7:14 AM	1/23/2008	7:13 AM	1,439	561	Mercury	EPA 324/1631 mod.	BRL	01/24/2008	< 5	3000 ng/m3	No	
5271835	4 - Albany St 6th Floor Scaffolding	1/22/2008	7:35 AM	1/23/2008	7:31 AM	1,436	539	Mercury	EPA 324/1631 mod.	BRL	01/24/2008	< 6	3000 ng/m3	No	
5271616	5 - Washington St 6th Floor Scaffolding	1/22/2008	7:52 AM	1/22/2008	8:30 AM	N/A	N/A	Mercury	EPA 324/1631 mod.	BRL	01/24/2008	N/A	3000 ng/m3	N/A	Sample Voided, Pump Flow Fault - Sampling time of 38 min.
5271839	5 - Washington St 6th Floor Scaffolding	1/22/2008	8:04 AM	1/23/2008	7:50 AM	1,426	585	Mercury	EPA 324/1631 mod.	BRL	01/24/2008	< 5	3000 ng/m3	No	
5271843	6 - Cedar St 6th Floor Scaffolding	1/22/2008	8:19 AM	1/23/2008	8:02 AM	1,423	583	Mercury	EPA 324/1631 mod.	BRL	01/24/2008	< 5	3000 ng/m3	No	
5271847	7 - Roof, East Facade	1/22/2008	7:10 AM	1/23/2008	7:00 AM	1,430	579	Mercury	EPA 324/1631 mod.	BRL	01/24/2008	< 5	3000 ng/m3	No	
5271899	8 - Roof, North Facade	1/22/2008	7:50 AM	1/23/2008	7:35 AM	1,425	591	Mercury	EPA 324/1631 mod.	BRL	01/24/2008	< 5	3000 ng/m3	No	
5271855	3 - 90 West Courtyard at 2nd Floor Level	1/23/2008	7:17 AM	1/24/2008	7:02 AM	1,425	527	Mercury	EPA 324/1631 mod.	BRL	01/25/2008	< 6	3000 ng/m3	No	
5271859	4 - Albany St 6th Floor Scaffolding	1/23/2008	7:35 AM	1/24/2008	7:17 AM	1,422	526	Mercury	EPA 324/1631 mod.	BRL	01/25/2008	< 6	3000 ng/m3	No	
5271863	5 - Washington St 6th Floor Scaffolding	1/23/2008	7:54 AM	1/24/2008	7:29 AM	1,415	587	Mercury	EPA 324/1631 mod.	BRL	01/25/2008	< 5	3000 ng/m3	No	
5271867	6 - Cedar St 6th Floor Scaffolding	1/23/2008	8:07 AM	1/24/2008	7:38 AM	1,411	557	Mercury	EPA 324/1631 mod.	BRL	01/25/2008	< 6	3000 ng/m3	No	
5271871	7 - Roof, East Facade	1/23/2008	7:06 AM	1/24/2008	6:48 AM	1,422	569	Mercury	EPA 324/1631 mod.	BRL	01/25/2008	< 5	3000 ng/m3	No	
5271851	8 - Roof, North Facade	1/23/2008	7:47 AM	1/24/2008	7:21 AM	1,414	587	Mercury	EPA 324/1631 mod.	BRL	01/25/2008	< 5	3000 ng/m3	No	
5271879	3 - 90 West Courtyard at 2nd Floor Level	1/24/2008	7:06 AM	1/25/2008	7:13 AM	1,447	550	Mercury	EPA 324/1631 mod.	BRL	01/26/2008	< 6	3000 ng/m3	No	
5271883	4 - Albany St 6th Floor Scaffolding	1/24/2008	7:21 AM	1/25/2008	7:48 AM	1,467	572	Mercury	EPA 324/1631 mod.	BRL	01/26/2008	< 5	3000 ng/m3	No	
5271887	5 - Washington St 6th Floor Scaffolding	1/24/2008	7:33 AM	1/25/2008	8:02 AM	1,469	610	Mercury	EPA 324/1631 mod.	BRL	01/26/2008	10	3000 ng/m3	No	
5271891	6 - Cedar St 6th Floor Scaffolding	1/24/2008	7:42 AM	1/25/2008	8:16 AM	1,474	560	Mercury	EPA 324/1631 mod.	BRL	01/26/2008	< 5	3000 ng/m3	No	
5271895	7 - Roof, East Facade	1/24/2008	6:57 AM	1/25/2008	6:53 AM	1,436	596	Mercury	EPA 324/1631 mod.	BRL	01/26/2008	< 5	3000 ng/m3	No	
5271875	8 - Roof, North Facade	1/24/2008	7:31 AM	1/25/2008	7:27 AM	1,436	567	Mercury	EPA 324/1631 mod.	BRL	01/26/2008	< 5	3000 ng/m3	No	
5271856	3 - 90 West Courtyard at 2nd Floor Level	1/25/2008	7:19 AM	1/26/2008	7:40 AM	1,461	592	Mercury	EPA 324/1631 mod.	BRL	01/28/2008	< 5	3000 ng/m3	No	
5271860	4 - Albany St 6th Floor Scaffolding	1/25/2008	7:54 AM	1/26/2008	8:45 AM	1,491	582	Mercury	EPA 324/1631 mod.	BRL	01/28/2008	< 5	3000 ng/m3	No	
5271664	5 - Washington St 6th Floor Scaffolding	1/25/2008	8:09 AM	1/26/2008	9:01 AM	1,492	589	Mercury	EPA 324/1631 mod.	BRL	01/28/2008	< 5	3000 ng/m3	No	
5271668	6 - Cedar St 6th Floor Scaffolding	1/25/2008	8:18 AM	1/26/2008	9:15 AM	1,497	531	Mercury	EPA 324/1631 mod.	BRL	01/28/2008	< 6	3000 ng/m3	No	
5271672	7 - Roof, East Facade	1/25/2008	7:00 AM	1/26/2008	7:31 AM	1,471	588	Mercury	EPA 324/1631 mod.	BRL	01/28/2008	< 5	3000 ng/m3	No	
5271676	8 - Roof, North Facade	1/25/2008	7:37 AM	1/26/2008	7:49 AM	1,452	581	Mercury	EPA 324/1631 mod.	BRL	01/28/2008	< 5	3000 ng/m3	No	
5271680	3 - 90 West Courtyard at 2nd Floor Level	1/26/2008	7:45 AM	1/27/2008	9:26 AM	1,541	309	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 10	3000 ng/m3	No	
5271684	4 - Albany St 6th Floor Scaffolding	1/26/2008	8:50 AM	1/27/2008	8:25 AM	1,415	410	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 8	3000 ng/m3	No	
5271688	5 - Washington St 6th Floor Scaffolding	1/26/2008	9:06 AM	1/27/2008	8:45 AM	1,419	582	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	21	3000 ng/m3	No	
5271692	6 - Cedar St 6th Floor Scaffolding	1/26/2008	9:19 AM	1/27/2008	9:00 AM	1,421	568	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 5	3000 ng/m3	No	
5271696	7 - Roof, East Facade	1/26/2008	7:34 AM	1/27/2008	8:07 AM	1,473	589	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 5	3000 ng/m3	No	
5271200	8 - Roof, North Facade	1/26/2008	7:54 AM	1/27/2008	7:54 AM	1,440	576	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 5	3000 ng/m3	No	

## MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Asbestos Concentration (f/cc)	MMVF Concentration (f/cc)	EPA Site Specific Trigger Level	Exceeds EPA Site Specific Trigger Level?	Comments
5271816	3 - 90 West Courtyard at 2nd Floor Level	1/20/2008	7:42 AM	1/21/2008	7:10 AM	1,408	4,330	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271802	4 - Albany St 6th Floor Scaffolding	1/20/2008	8:58 AM	1/21/2008	7:28 AM	1,350	4,084	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271796	5 - Washington St 6th Floor Scaffolding	1/20/2008	8:31 AM	1/21/2008	7:38 AM	1,387	4,369	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271788	6 - Cedar St 6th Floor Scaffolding	1/20/2008	8:11 AM	1/21/2008	7:52 AM	1,421	4,334	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/22/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271776	7 - Roof, East Facade	1/20/2008	7:30 AM	1/21/2008	7:08 AM	1,418	4,294	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271780	8 - Roof, North Facade	1/20/2008	7:55 AM	1/21/2008	7:51 AM	1,436	4,338	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271812	3 - 90 West Courtyard at 2nd Floor Level	1/21/2008	7:14 AM	1/22/2008	7:09 AM	1,435	4,305	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/23/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271808	4 - Albany St 6th Floor Scaffolding	1/21/2008	7:33 AM	1/22/2008	7:31 AM	1,438	4,314	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/23/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271784	5 - Washington St 6th Floor Scaffolding	1/21/2008	7:43 AM	1/22/2008	7:59 AM	1,456	4,441	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/23/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271768	6 - Cedar St 6th Floor Scaffolding	1/21/2008	7:56 AM	1/22/2008	8:16 AM	1,460	4,453	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/23/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271792	7 - Roof, East Facade	1/21/2008	7:16 AM	1/22/2008	7:03 AM	1,427	4,494	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/23/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271772	8 - Roof, North Facade	1/21/2008	8:00 AM	1/22/2008	7:40 AM	1,420	4,315	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/23/2008	0.00005	0.00009	0.0009 f/cc	No	
5271830	3 - 90 West Courtyard at 2nd Floor Level	1/22/2008	7:14 AM	1/23/2008	7:13 AM	1,439	4,281	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/24/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271834	4 - Albany St 6th Floor Scaffolding	1/22/2008	7:35 AM	1/23/2008	7:31 AM	1,436	4,308	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/24/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271615	5 - Washington St 6th Floor Scaffolding	1/22/2008	7:52 AM	1/23/2008	7:44 AM	1,432	4,582	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/24/2008	<0.00004	0.00027	0.0009 f/cc	No	
5271838	5 - Washington St 6th Floor Scaffolding	1/22/2008	8:04 AM	1/23/2008	7:50 AM	1,426	4,349	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/24/2008	0.00005	0.00005	0.0009 f/cc	No	
5271842	6 - Cedar St 6th Floor Scaffolding	1/22/2008	8:19 AM	1/23/2008	8:02 AM	1,423	4,198	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/24/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271846	7 - Roof, East Facade	1/22/2008	7:10 AM	1/23/2008	7:00 AM	1,430	4,465	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/24/2008	0.00005	<0.00005	0.0009 f/cc	No	
5271898	8 - Roof, North Facade	1/22/2008	7:50 AM	1/23/2008	7:35 AM	1,425	4,408	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/24/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271854	3 - 90 West Courtyard at 2nd Floor Level	1/23/2008	7:17 AM	1/24/2008	7:02 AM	1,425	4,204	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271858	4 - Albany St 6th Floor Scaffolding	1/23/2008	7:35 AM	1/24/2008	7:17 AM	1,422	4,266	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271862	5 - Washington St 6th Floor Scaffolding	1/23/2008	7:54 AM	1/24/2008	7:29 AM	1,415	4,245	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271866	6 - Cedar St 6th Floor Scaffolding	1/23/2008	8:07 AM	1/24/2008	7:38 AM	1,411	4,092	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271870	7 - Roof, East Facade	1/23/2008	7:06 AM	1/24/2008	6:48 AM	1,422	4,410	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271850	8 - Roof, North Facade	1/23/2008	7:47 AM	1/24/2008	7:21 AM	1,414	4,344	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/25/2008	0.00005	<0.00005	0.0009 f/cc	No	
5271878	3 - 90 West Courtyard at 2nd Floor Level	1/24/2008	7:06 AM	1/25/2008	7:13 AM	1,447	4,196	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/26/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271882	4 - Albany St 6th Floor Scaffolding	1/24/2008	7:21 AM	1/25/2008	7:48 AM	1,467	4,218	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/26/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271886	5 - Washington St 6th Floor Scaffolding	1/24/2008	7:33 AM	1/25/2008	8:02 AM	1,469	4,370	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/26/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271890	6 - Cedar St 6th Floor Scaffolding	1/24/2008	7:42 AM	1/25/2008	8:16 AM	1,474	4,348	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/26/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271894	7 - Roof, East Facade	1/24/2008	6:57 AM	1/25/2008	6:53 AM	1,436	4,380	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/26/2008	0.00005	0.00009	0.0009 f/cc	No	
5271874	8 - Roof, North Facade	1/24/2008	7:31 AM	1/25/2008	7:27 AM	1,436	4,392	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/26/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271655	3 - 90 West Courtyard at 2nd Floor Level	1/25/2008	7:19 AM	1/26/2008	7:40 AM	1,461	4,383	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/28/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271659	4 - Albany St 6th Floor Scaffolding	1/25/2008	7:54 AM	1/26/2008	8:45 AM	1,491	4,473	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/28/2008	<0.00005	0.00009	0.0009 f/cc	No	
5271663	5 - Washington St 6th Floor Scaffolding	1/25/2008	8:09 AM	1/26/2008	9:01 AM	1,492	4,551	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/28/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5271667	6 - Cedar St 6th Floor Scaffolding	1/25/2008	8:18 AM	1/26/2008	9:15 AM	1,497	4,566	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/28/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5271671	7 - Roof, East Facade	1/25/2008	7:00 AM	1/26/2008	7:31 AM	1,471	4,682	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/28/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5271675	8 - Roof, North Facade	1/25/2008	7:37 AM	1/26/2008	7:49 AM	1,452	4,581	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/28/2008	0.00009	0.00009	0.0009 f/cc	No	
5271679	3 - 90 West Courtyard at 2nd Floor Level	1/26/2008	7:45 AM	1/27/2008	9:26 AM	1,541	4,546	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5271683	4 - Albany St 6th Floor Scaffolding	1/26/2008	8:50 AM	1/27/2008	8:25 AM	1,415	4,139	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271687	5 - Washington St 6th Floor Scaffolding	1/26/2008	9:06 AM	1/27/2008	8:45 AM	1,419	4,257	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271691	6 - Cedar St 6th Floor Scaffolding	1/26/2008	9:19 AM	1/27/2008	9:00 AM	1,421	4,263	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271695	7 - Roof, East Facade	1/26/2008	7:34 AM	1/27/2008	8:07 AM	1,473	4,270	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271699	8 - Roof, North Facade	1/26/2008	7:54 AM	1/27/2008	7:54 AM	1,440	4,243	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	

Works - 130 Cedar Building, Community Monitoring


Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	Respirable Dust Concentration (mg/m <sup>3</sup> )	Respirable Quartz Concentration (mg/m <sup>3</sup> )	Target Air quality Level for Respirable Quartz (mg/m <sup>3</sup> )	EPA Site Specific Trigger Level for Respirable Quartz (mg/m <sup>3</sup> )	Exceeds Target Air quality or EPA Site Specific Level?	Comments
5271815	3 - 90 West Courtyard at 2nd Floor Level	1/20/2008	7:40 AM	1/21/2008	7:10 AM	1,410	3,596	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/22/2008	< 0.28	< .001	0.01	0.01	No	
5271801	4 - Albany St 6th Floor Scaffolding	1/20/2008	9:01 AM	1/21/2008	7:26 AM	1,347	3,166	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/22/2008	< 0.02	< .002	0.01	0.01	No	
5271795	5 - Washington St 6th Floor Scaffolding	1/20/2008	8:29 AM	1/21/2008	7:36 AM	1,389	3,334	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/22/2008	< 0.30	< .001	0.01	0.01	No	
5271787	6 - Cedar St 6th Floor Scaffolding	1/20/2008	8:07 AM	1/21/2008	7:52 AM	1,426	3,634	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/22/2008	< 0.28	< .001	0.01	0.01	No	
5271775	7 - Roof, East Facade	1/20/2008	7:30 AM	1/21/2008	7:09 AM	1,418	3,474	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/22/2008	< 0.28	< .001	0.01	0.01	No	
5271779	8 - Roof, North Facade	1/20/2008	7:55 AM	1/21/2008	7:51 AM	1,436	3,626	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/22/2008	< 0.28	< .001	0.01	0.01	No	
5271811	3 - 90 West Courtyard at 2nd Floor Level	1/21/2008	7:14 AM	1/22/2008	7:09 AM	1,436	3,731	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/23/2008	< 0.27	< .001	0.01	0.01	No	
5271807	4 - Albany St 6th Floor Scaffolding	1/21/2008	7:33 AM	1/22/2008	7:31 AM	1,438	3,595	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/23/2008	< 0.28	< .001	0.01	0.01	No	
5271783	5 - Washington St 6th Floor Scaffolding	1/21/2008	7:43 AM	1/22/2008	7:59 AM	1,456	3,640	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/23/2008	< 0.27	< .001	0.01	0.01	No	
5271767	6 - Cedar St 6th Floor Scaffolding	1/21/2008	7:56 AM	1/22/2008	8:16 AM	1,460	3,723	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/23/2008	< 0.27	< .001	0.01	0.01	No	
5271791	7 - Roof, East Facade	1/21/2008	7:16 AM	1/22/2008	7:03 AM	1,427	3,782	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/23/2008	< 0.26	< .001	0.01	0.01	No	
5271771	8 - Roof, North Facade	1/21/2008	8:00 AM	1/22/2008	7:40 AM	1,420	3,621	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/23/2008	< 0.28	< .001	0.01	0.01	No	
5271829	3 - 90 West Courtyard at 2nd Floor Level	1/22/2008	7:14 AM	1/23/2008	7:13 AM	1,439	3,598	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/24/2008	< 0.28	< .001	0.01	0.01	No	
5271833	4 - Albany St 6th Floor Scaffolding	1/22/2008	7:35 AM	1/23/2008	7:31 AM	1,436	3,016	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/24/2008	< 0.33	< 0.02	0.01	0.01	No	
5271614	5 - Washington St 6th Floor Scaffolding	1/22/2008	7:52 AM	1/23/2008	7:44 AM	1,432	2,649	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/24/2008	< 0.38	< 0.02	0.01	0.01	No	
5271837	5 - Washington St 6th Floor Scaffolding	1/22/2008	8:04 AM	1/23/2008	7:50 AM	1,426	3,638	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/24/2008	< 0.28	< .001	0.01	0.01	No	
5271841	6 - Cedar St 6th Floor Scaffolding	1/22/2008	8:19 AM	1/23/2008	8:02 AM	1,423	3,558	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/24/2008	< 0.28	< .001	0.01	0.01	No	
5271845	7 - Roof, East Facade	1/22/2008	7:10 AM	1/23/2008	7:00 AM	1,430	3,718	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/24/2008	< 0.27	< .001	0.01	0.01	No	
5271897	8 - Roof, North Facade	1/22/2008	7:50 AM	1/23/2008	7:36 AM	1,425	3,634	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/24/2008	< 0.28	< .001	0.01	0.01	No	
5271853	3 - 90 West Courtyard at 2nd Floor Level	1/23/2008	7:17 AM	1/24/2008	7:02 AM	1,425	3,563	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/25/2008	< 0.28	< .001	0.01	0.01	No	
5271857	4 - Albany St 6th Floor Scaffolding	1/23/2008	7:35 AM	1/24/2008	7:17 AM	1,422	3,342	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/25/2008	< 0.30	< 0.02	0.01	0.01	No	
5271861	5 - Washington St 6th Floor Scaffolding	1/23/2008	7:54 AM	1/24/2008	7:26 AM	1,415	3,467	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/25/2008	< 0.29	< .001	0.01	0.01	No	
5271865	6 - Cedar St 6th Floor Scaffolding	1/23/2008	8:07 AM	1/24/2008	7:36 AM	1,411	3,457	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/25/2008	< 0.29	< .001	0.01	0.01	No	
5271869	7 - Roof, East Facade	1/23/2008	7:06 AM	1/24/2008	6:48 AM	1,422	3,555	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/25/2008	< 0.28	< .001	0.01	0.01	No	
5271849	8 - Roof, North Facade	1/23/2008	7:47 AM	1/24/2008	7:21 AM	1,414	3,606	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/25/2008	< 0.28	< .001	0.01	0.01	No	
5271877	3 - 90 West Courtyard at 2nd Floor Level	1/24/2008	7:06 AM	1/25/2008	7:13 AM	1,447	3,545	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/26/2008	< 0.28	< .001	0.01	0.01	No	
5271881	4 - Albany St 6th Floor Scaffolding	1/24/2008	7:21 AM	1/25/2008	7:48 AM	1,467	3,448	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/26/2008	< 0.29	< .001	0.01	0.01	No	
5271885	5 - Washington St 6th Floor Scaffolding	1/24/2008	7:33 AM	1/25/2008	8:02 AM	1,469	3,673	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/26/2008	< 0.27	< .001	0.01	0.01	No	
5271889	6 - Cedar St 6th Floor Scaffolding	1/24/2008	7:42 AM	1/25/2008	8:16 AM	1,474	3,685	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/26/2008	< 0.27	< .001	0.01	0.01	No	
5271893	7 - Roof, East Facade	1/24/2008	6:57 AM	1/25/2008	6:53 AM	1,436	3,590	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/26/2008	< 0.28	< .001	0.01	0.01	No	
5271873	8 - Roof, North Facade	1/24/2008	7:31 AM	1/25/2008	7:27 AM	1,436	3,690	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/26/2008	< 0.28	< .001	0.01	0.01	No	
5271654	3 - 90 West Courtyard at 2nd Floor Level	1/25/2008	7:19 AM	1/26/2008	7:40 AM	1,461	3,726	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/28/2008	< 0.27	< .001	0.01	0.01	No	
5271658	4 - Albany St 6th Floor Scaffolding	1/25/2008	7:54 AM	1/26/2008	8:45 AM	1,491	3,504	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/28/2008	< 0.29	< .001	0.01	0.01	No	
5271662	5 - Washington St 6th Floor Scaffolding	1/25/2008	8:09 AM	1/26/2008	9:01 AM	1,492	3,730	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/28/2008	< 0.27	< .001	0.01	0.01	No	
5271666	6 - Cedar St 6th Floor Scaffolding	1/25/2008	8:18 AM	1/26/2008	9:15 AM	1,497	3,668	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/28/2008	< 0.27	< .001	0.01	0.01	No	
5271670	7 - Roof, East Facade	1/25/2008	7:00 AM	1/26/2008	7:31 AM	1,471	3,751	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/28/2008	< 0.27	< .001	0.01	0.01	No	
5271674	8 - Roof, North Facade	1/25/2008	7:37 AM	1/26/2008	7:49 AM	1,452	3,703	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/28/2008	< 0.27	< .001	0.01	0.01	No	
5271678	3 - 90 West Courtyard at 2nd Floor Level	1/26/2008	7:45 AM	1/27/2008	9:26 AM	1,541	3,776	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.26	< .001	0.01	0.01	No	
5271682	4 - Albany St 6th Floor Scaffolding	1/26/2008	8:50 AM	1/27/2008	8:25 AM	1,415	3,184	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.31	< 0.02	0.01	0.01	No	
5271686	5 - Washington St 6th Floor Scaffolding	1/26/2008	9:06 AM	1/27/2008	8:45 AM	1,419	3,548	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.28	< .001	0.01	0.01	No	
5271690	6 - Cedar St 6th Floor Scaffolding	1/26/2008	9:19 AM	1/27/2008	9:00 AM	1,421	3,624	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.28	< .001	0.01	0.01	No	
5271694	7 - Roof, East Facade	1/26/2008	7:34 AM	1/27/2008	8:07 AM	1,473	3,683	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.27	< .001	0.01	0.01	No	
5271698	8 - Roof, North Facade	1/26/2008	7:54 AM	1/27/2008	7:54 AM	1,440	3,600	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.27	< .001	0.01	0.01	No	

MasterWorks - 130 Cedar Building, Community Monitoring														
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM <sub>2.5</sub> Avg. Concentration (µg/m <sup>3</sup> )	EPA Site Specific Trigger Level for PM <sub>2.5</sub> (µg/m <sup>3</sup> )	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4526	N/A	10	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4728	N/A	10	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4729	N/A	9	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4527	N/A	11	65	No	
N/A	7 - Roof, East	1/20/2008	12:00 AM	1/21/2008	12:00 AM	780	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # F5003	N/A	11	65	No	
N/A	8 - Roof, North	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4607	N/A	10	65	No	Power Interruption - Result is not a 24 hour average
N/A	3 - Courtyard, 2nd Floor Level	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4526	N/A	20	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4728	N/A	12	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4729	N/A	13	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4527	N/A	15	65	No	
N/A	7 - Roof, East	1/21/2008	12:00 AM	1/22/2008	12:00 AM	935	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # F5003	N/A	12	65	No	Power Interruption - Result is not a 24 hour average
N/A	8 - Roof, North	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4607	N/A	13	65	No	
N/A	3 - Courtyard, 2nd Floor Level	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4526	N/A	14	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4728	N/A	15	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4729	N/A	16	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4527	N/A	17	65	No	
N/A	7 - Roof, East	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # F5003	N/A	17	65	No	
N/A	8 - Roof, North	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4607	N/A	18	65	No	
N/A	3 - Courtyard, 2nd Floor Level	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4526	N/A	13	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4728	N/A	13	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4729	N/A	13	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4527	N/A	14	65	No	
N/A	7 - Roof, East	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,405	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # F5003	N/A	13	65	No	
N/A	8 - Roof, North	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4607	N/A	15	65	No	
N/A	3 - Courtyard, 2nd Floor Level	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4526	N/A	14	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4728	N/A	15	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4729	N/A	14	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4527	N/A	16	65	No	
N/A	7 - Roof, East	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # F5003	N/A	13	65	No	
N/A	8 - Roof, North	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4607	N/A	15	65	No	
N/A	3 - Courtyard, 2nd Floor Level	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4526	N/A	11	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4728	N/A	9	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4729	N/A	11	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4527	N/A	14	65	No	
N/A	7 - Roof, East	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # F5003	N/A	10	65	No	
N/A	8 - Roof, North	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4607	N/A	12	65	No	
N/A	3 - Courtyard, 2nd Floor Level	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4526	N/A	14	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4728	N/A	15	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4729	N/A	15	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4527	N/A	16	65	No	
N/A	7 - Roof, East	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # F5003	N/A	13	65	No	
N/A	8 - Roof, North	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>2.5</sub>	Direct Read	Met One E-BAM Unit # G4607	N/A	15	65	No	

MasterWorks - 130 Cedar Building, Community Monitoring														
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM <sub>10</sub> Avg. Concentration (µg/m <sup>3</sup> )	EPA Site Specific Trigger Level for PM <sub>10</sub> (µg/m <sup>3</sup> )	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4606	N/A	11	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4731	N/A	13	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4604	N/A	12	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4605	N/A	12	150	No	Power Interruption - Result is not a 24 hour average
N/A	7 - Roof, East	1/20/2008	12:00 AM	1/21/2008	12:00 AM	780	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # E3364	N/A	14	150	No	
N/A	8 - Roof, North	1/20/2008	12:00 AM	1/21/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # F5001	N/A	13	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4606	N/A	14	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4731	N/A	14	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4604	N/A	15	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4605	N/A	17	150	No	
N/A	7 - Roof, East	1/21/2008	12:00 AM	1/22/2008	12:00 AM	935	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # E3364	N/A	19	150	No	Power Interruption - Result is not a 24 hour average
N/A	8 - Roof, North	1/21/2008	12:00 AM	1/22/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # F5001	N/A	16	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4606	N/A	17	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4731	N/A	20	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4604	N/A	21	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4605	N/A	25	150	No	
N/A	7 - Roof, East	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # E3364	N/A	27	150	No	
N/A	8 - Roof, North	1/22/2008	12:00 AM	1/23/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # F5001	N/A	22	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4606	N/A	15	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4731	N/A	16	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4604	N/A	17	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4605	N/A	18	150	No	
N/A	7 - Roof, East	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # E3364	N/A	18	150	No	
N/A	8 - Roof, North	1/23/2008	12:00 AM	1/24/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # F5001	N/A	18	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4606	N/A	15	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4731	N/A	18	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4604	N/A	18	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4605	N/A	19	150	No	
N/A	7 - Roof, East	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # E3364	N/A	20	150	No	
N/A	8 - Roof, North	1/24/2008	12:00 AM	1/25/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # F5001	N/A	21	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4606	N/A	13	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4731	N/A	12	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4604	N/A	16	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4605	N/A	17	150	No	
N/A	7 - Roof, East	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # E3364	N/A	16	150	No	
N/A	8 - Roof, North	1/25/2008	12:00 AM	1/26/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # F5001	N/A	18	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4606	N/A	16	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4731	N/A	16	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4604	N/A	17	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # G4605	N/A	18	150	No	
N/A	7 - Roof, East	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,440	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # E3364	N/A	19	150	No	
N/A	8 - Roof, North	1/26/2008	12:00 AM	1/27/2008	12:00 AM	1,430	PM <sub>10</sub>	Direct Read	Met One E-BAM Unit # F5001	N/A	17	150	No	

350 Hochberg Road, Monroeville, PA 15146  
 Phone: (724) 325-1776 Fax: (724) 733-1799

Mercury Vapor ( $Hg^0$ ) Air Results for Outdoor Community  
 Monitoring Stations by Location as recorded by the Lumex Analyzer

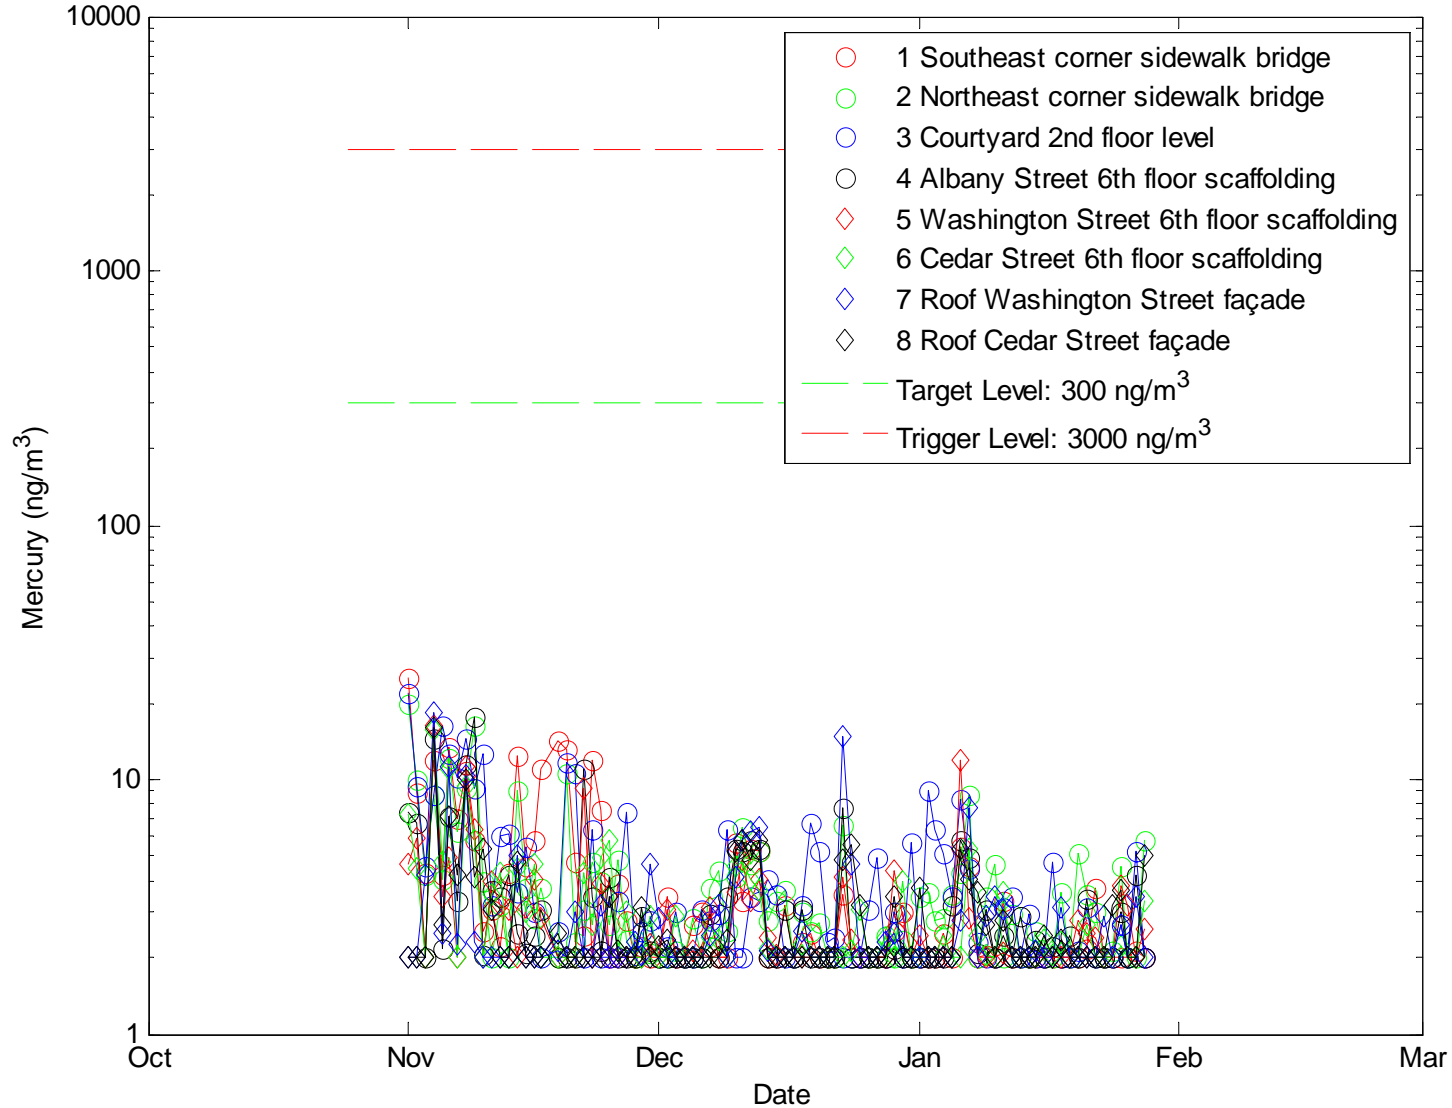

350 Hochberg Road, Monroeville, PA 15146  
Phone: (724) 325-1776 Fax: (724) 733-1799

## Report Summary

Air Mercury Results (Hg<sup>0</sup>, ng/m<sup>3</sup>) as recorded by the Lumex RA915+ analyzer  
Week of 01/20/08 to 01/26/08

Date	Mercury (Hg <sup>0</sup> ) ng/m <sup>3</sup> 30-sec readings	1 Southeast corner sidewalk bridge	2 Northeast corner sidewalk bridge	3 Courtyard 2nd floor level	4 Albany Street 6th floor scaffolding	5 Washington Street 6th floor scaffolding	6 Cedar Street 6th floor scaffolding	7 Roof Washington Street façade	8 Roof Cedar Street façade
20-Jan-08	# Samples	9	9	9	9	9	9	9	9
	Average	2	5	2	2	3	2	2	2
	Maximum	2	6	2	2	3	2	2	2
21-Jan-08	# Samples	18	18	18	18	18	18	18	18
	Average	2	4	3	3	3	3	2	2
	Maximum	4	5	5	5	4	4	3	3
22-Jan-08	# Samples	18	18	18	18	18	18	18	18
	Average	4	3	2	2	2	2	2	2
	Maximum	6	4	2	3	4	3	3	2
23-Jan-08	# Samples	18	18	9	18	18	18	18	18
	Average	2	2	2	2	2	2	3	2
	Maximum	3	3	2	2	2	3	4	2
24-Jan-08	# Samples	18	18	18	18	18	18	18	18
	Average	2	2	2	2	2	2	2	3
	Maximum	2	3	2	4	2	2	2	6
25-Jan-08	# Samples	18	18	18	18	18	18	18	18
	Average	2	5	3	3	4	2	3	4
	Maximum	2	6	7	4	5	4	5	8
26-Jan-08	# Samples	9	9	9	9	9	9	9	9
	Average	2	2	2	2	3	2	2	2
	Maximum	2	3	2	2	4	2	2	2