

MasterWorks - 130 Cedar Building, Community Monitoring														Total Structure Count		Asbestos < 5 µm		Asbestos ≥ 5 µm		Result (µm/m ³)	Concentration (f/cc)	EPA Site Specific Trigger Level	Exceeds EPA Site Specific Trigger Level?	Comments
Sample No	Sampling Location	Collection Start Date	Collection Time (AM/PM)	Collection End Date	Collection Time (off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	All Asbestos	Chrysotile	Amphibole	< 5 µm	≥ 5 µm								
5270837	3-90 West Courtyard at 2nd Floor Level	12/27/2008	7:32 AM	12/27/2008	12:35 PM	292	1,345	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/27/2008	0	0	0	0	0	< 6.8	< 0.020	70 Smm2	No				
5270838	4-Abany St 6th Floor Scalloffing	12/27/2008	7:40 AM	12/27/2008	12:08 PM	269	1,345	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	0	0	0	0	0	< 6.8	< 0.020	70 Smm2	No				
5270839	5-Washington St 6th Floor Scalloffing	12/27/2008	7:41 AM	12/27/2008	12:08 PM	267	1,335	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	0	0	0	0	0	< 6.8	< 0.020	70 Smm2	No				
5270840	6-Cedar St 6th Floor Scalloffing	12/27/2008	7:42 AM	12/27/2008	12:08 PM	267	1,335	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	0	0	0	0	0	< 6.8	< 0.020	70 Smm2	No				
5270841	7-Roof, East Facade	12/27/2008	7:45 AM	12/27/2008	12:06 PM	261	1,305	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	0	0	0	0	0	< 6.4	< 0.019	70 Smm2	No				
5270842	8-Roof, North Facade	12/27/2008	7:46 AM	12/27/2008	12:05 PM	259	1,290	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	1	1	0	0	0	6.4	0.019	70 Smm2	No				
5271351	3-90 West Courtyard at 2nd Floor Level	12/28/2008	7:49 AM	12/28/2008	1:09 PM	500	2,300	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/28/2008	0	0	0	0	0	< 6.9	< 0.019	70 Smm2	No				
5271352	4-Abany St 6th Floor Scalloffing	12/28/2008	7:35 AM	12/28/2008	1:33 PM	498	2,290	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/28/2008	0	0	0	0	0	< 6.9	< 0.019	70 Smm2	No				
5271353	5-Washington St 6th Floor Scalloffing	12/28/2008	7:36 AM	12/28/2008	1:35 PM	495	1,764	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	0	0	0	0	0	< 6.9	< 0.019	70 Smm2	No				
5271354	6-Cedar St 6th Floor Scalloffing	12/28/2008	7:37 AM	12/28/2008	1:35 PM	495	1,764	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	0	0	0	0	0	< 6.9	< 0.019	70 Smm2	No				
5271355	7-Roof, East Facade	12/28/2008	7:27 AM	12/28/2008	1:27 PM	493	1,815	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	0	0	0	0	0	< 6.9	< 0.019	70 Smm2	No				
5271356	8-Roof, North Facade	12/28/2008	7:28 AM	12/28/2008	1:35 PM	497	1,787	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	12/29/2008	0	0	0	0	0	< 6.9	< 0.019	70 Smm2	No				
5272449	3-90 West Courtyard at 2nd Floor Level	12/29/2008	7:46 AM	12/29/2008	1:30 PM	464	1,644	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/30/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272450	4-Abany St 6th Floor Scalloffing	12/29/2008	7:46 AM	12/29/2008	1:34 PM	463	1,644	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/30/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272451	5-Washington St 6th Floor Scalloffing	12/29/2008	7:35 AM	12/29/2008	1:22 PM	467	1,655	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/30/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272452	6-Cedar St 6th Floor Scalloffing	12/29/2008	7:36 AM	12/29/2008	1:25 PM	469	1,677	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/30/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272453	7-Roof, East Facade	12/29/2008	7:27 AM	12/29/2008	1:27 PM	467	1,658	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/30/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272454	8-Roof, North Facade	12/29/2008	7:28 AM	12/29/2008	1:17 PM	469	1,665	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/30/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272468	3-90 West Courtyard at 2nd Floor Level	12/29/2008	7:45 PM	12/29/2008	1:17 PM	392	1,431	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 7.2	< 0.020	70 Smm2	No				
5272469	4-Abany St 6th Floor Scalloffing	12/29/2008	7:46 PM	12/29/2008	1:28 PM	392	1,431	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 7.2	< 0.020	70 Smm2	No				
5272470	5-Washington St 6th Floor Scalloffing	12/29/2008	4:11 PM	12/29/2008	10:33 PM	388	1,387	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 7.2	< 0.020	70 Smm2	No				
5272471	6-Cedar St 6th Floor Scalloffing	12/29/2008	4:12 PM	12/29/2008	10:44 PM	392	1,411	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 7.2	< 0.020	70 Smm2	No				
5272472	7-Roof, East Facade	12/29/2008	4:02 PM	12/29/2008	10:29 PM	387	1,430	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 7.2	< 0.019	70 Smm2	No				
5272473	8-Roof, North Facade	12/29/2008	4:04 PM	12/29/2008	10:31 PM	387	1,374	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 6.8	< 0.019	70 Smm2	No				
5272475	3-90 West Courtyard at 2nd Floor Level	1/30/2008	7:49 AM	1/30/2008	1:42 PM	473	1,656	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272476	4-Abany St 6th Floor Scalloffing	1/30/2008	7:35 AM	1/30/2008	1:33 PM	478	1,673	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272477	5-Washington St 6th Floor Scalloffing	1/30/2008	7:34 AM	1/30/2008	1:31 PM	477	1,656	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272478	6-Cedar St 6th Floor Scalloffing	1/30/2008	7:32 AM	1/30/2008	1:28 PM	476	1,678	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272479	7-Roof, East Facade	1/30/2008	7:37 AM	1/30/2008	1:29 PM	472	1,664	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272480	8-Roof, North Facade	1/30/2008	7:25 AM	1/30/2008	1:21 PM	477	1,666	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	1/31/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5271101	3-90 West Courtyard at 2nd Floor Level	1/30/2008	3:42 PM	1/30/2008	10:20 PM	398	1,393	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 6.8	< 0.019	70 Smm2	No				
5271102	4-Abany St 6th Floor Scalloffing	1/30/2008	3:33 PM	1/30/2008	10:30 PM	399	1,491	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 7.7	< 0.020	70 Smm2	No				
5271103	5-Washington St 6th Floor Scalloffing	1/30/2008	3:31 PM	1/30/2008	10:40 PM	429	1,502	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 7.7	< 0.020	70 Smm2	No				
5271104	6-Cedar St 6th Floor Scalloffing	1/30/2008	3:28 PM	1/30/2008	10:42 PM	434	1,519	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 7.7	< 0.020	70 Smm2	No				
5271105	7-Roof, East Facade	1/30/2008	3:19 PM	1/30/2008	10:31 PM	432	1,512	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 7.7	< 0.020	70 Smm2	No				
5271106	8-Roof, North Facade	1/30/2008	3:21 PM	1/30/2008	10:32 PM	431	1,508	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 7.7	< 0.020	70 Smm2	No				
5272461	3-90 West Courtyard at 2nd Floor Level	1/31/2008	7:39 AM	1/31/2008	1:34 PM	484	1,742	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 8.9	< 0.020	70 Smm2	No				
5272462	4-Abany St 6th Floor Scalloffing	1/31/2008	7:31 AM	1/31/2008	1:35 PM	484	1,716	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 8.9	< 0.020	70 Smm2	No				
5272463	5-Washington St 6th Floor Scalloffing	1/31/2008	7:30 AM	1/31/2008	1:33 PM	483	1,715	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5272464	6-Cedar St 6th Floor Scalloffing	1/31/2008	7:28 AM	1/31/2008	1:30 PM	482	1,736	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 8.9	< 0.020	70 Smm2	No				
5272465	7-Roof, East Facade	1/31/2008	7:29 AM	1/31/2008	1:24 PM	484	1,716	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 8.3	< 0.020	70 Smm2	No				
5272466	8-Roof, North Facade	1/31/2008	7:22 AM	1/31/2008	1:25 PM	483	1,681	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/1/2008	0	0	0	0	0	< 8.3	< 0.019	70 Smm2	No				
5271127	3-90 West Courtyard at 2nd Floor Level	1/31/2008	3:43 PM	1/31/2008	10:34 PM	411	1,439	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/2/2008	0	0	0	0	0	< 7.2	< 0.019	70 Smm2	No				
5271128	4-Abany St 6th Floor Scalloffing	1/31/2008	3:35 PM	1/31/2008	10:35 PM	370	1,314	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/2/2008	0	0	0	0	0	< 6.8	< 0.020	70 Smm2	No				
5271129	5-Washington St 6th Floor Scalloffing	1/31/2008	3:33 PM	1/31/2008	10:47 PM	374	1,309	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/2/2008	0	0	0	0	0	< 6.4	< 0.019	70 Smm2	No				
5271130	6-Cedar St 6th Floor Scalloffing	1/31/2008	3:30 PM	1/31/2008	10:48 PM	379	1,327	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/2/2008	0	0	0	0	0	< 6.8	< 0.020	70 Smm2	No				
5271131	7-Roof, East Facade	1/31/2008	3:24 PM	1/31/2008	10:34 PM	390	1,408	Asbestos	AHERA 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/2/2008	0	0	0	0	0	<							

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Volumes (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Mercury Concentration (ng/m ³)	EPA Site Specific Trigger Level for Mercury (ng/m ³)	Exceeds Target Air Quality or EPA Site Specific Level?	Comments
5271207	3 - 90 West Courtyard at 2nd Floor Level	1/27/2008	9:29 AM	1/28/2008	7:07 AM	1,298	454	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 7	3000 ng/m3	No	
5271215	4 - Albany St 6th Floor Scaffolding	1/27/2008	8:25 AM	1/28/2008	7:26 AM	1,381	262	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 12	3000 ng/m3	No	Sample volume estimated
5271211	5 - Washington St 6th Floor Scaffolding	1/27/2008	8:49 AM	1/28/2008	7:38 AM	1,369	554	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 6	3000 ng/m3	No	
5271219	6 - Cedar St 6th Floor Scaffolding	1/27/2008	9:03 AM	1/28/2008	7:49 AM	1,366	546	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 6	3000 ng/m3	No	
5271223	7 - Roof, East Facade	1/27/2008	8:11 AM	1/28/2008	7:05 AM	1,374	573	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 6	3000 ng/m3	No	
5271227	8 - Roof, North Facade	1/27/2008	7:57 AM	1/28/2008	7:31 AM	1,414	573	Mercury	EPA 324/1631 mod.	BRL	01/29/2008	< 5	3000 ng/m3	No	
5271231	3 - 90 West Courtyard at 2nd Floor Level	1/28/2008	7:14 AM	1/29/2008	7:06 AM	1,432	287	Mercury	EPA 324/1631 mod.	BRL	01/30/2008	< 11	3000 ng/m3	No	Sample volume estimated
5271235	4 - Albany St 6th Floor Scaffolding	1/28/2008	8:06 AM	1/29/2008	7:24 AM	1,398	559	Mercury	EPA 324/1631 mod.	BRL	01/30/2008	< 6	3000 ng/m3	No	
5271247	5 - Washington St 6th Floor Scaffolding	1/28/2008	7:43 AM	1/29/2008	7:33 AM	1,430	572	Mercury	EPA 324/1631 mod.	BRL	01/30/2008	6	3000 ng/m3	No	
5271243	6 - Cedar St 6th Floor Scaffolding	1/28/2008	7:53 AM	1/29/2008	7:43 AM	1,430	565	Mercury	EPA 324/1631 mod.	BRL	01/30/2008	6	3000 ng/m3	No	
5271263	7 - Roof, East Facade	1/28/2008	7:10 AM	1/29/2008	6:56 AM	1,426	563	Mercury	EPA 324/1631 mod.	BRL	01/30/2008	< 5	3000 ng/m3	No	
5271239	8 - Roof, North Facade	1/28/2008	7:39 AM	1/29/2008	7:33 AM	1,434	574	Mercury	EPA 324/1631 mod.	BRL	01/30/2008	< 5	3000 ng/m3	No	
5271271	3 - 90 West Courtyard at 2nd Floor Level	1/29/2008	7:11 AM	1/30/2008	7:08 AM	1,437	568	Mercury	EPA 324/1631 mod.	BRL	01/31/2008	< 5	3000 ng/m3	No	
5271275	4 - Albany St 6th Floor Scaffolding	1/29/2008	7:28 AM	1/30/2008	7:30 AM	1,442	570	Mercury	EPA 324/1631 mod.	BRL	01/31/2008	< 5	3000 ng/m3	No	
5271267	5 - Washington St 6th Floor Scaffolding	1/29/2008	7:37 AM	1/30/2008	7:44 AM	1,447	521	Mercury	EPA 324/1631 mod.	BRL	01/31/2008	< 6	3000 ng/m3	No	
5271279	6 - Cedar St 6th Floor Scaffolding	1/29/2008	7:47 AM	1/30/2008	8:02 AM	1,455	575	Mercury	EPA 324/1631 mod.	BRL	01/31/2008	< 5	3000 ng/m3	No	
5271283	7 - Roof, East Facade	1/29/2008	7:04 AM	1/30/2008	6:59 AM	1,435	560	Mercury	EPA 324/1631 mod.	BRL	01/31/2008	< 6	3000 ng/m3	No	
5271287	8 - Roof, North Facade	1/29/2008	7:41 AM	1/30/2008	7:40 AM	1,439	568	Mercury	EPA 324/1631 mod.	BRL	01/31/2008	< 5	3000 ng/m3	No	
5271055	3 - 90 West Courtyard at 2nd Floor Level	1/30/2008	7:12 AM	1/31/2008	7:11 AM	1,439	576	Mercury	EPA 324/1631 mod.	BRL	02/01/2008	N/A	3000 ng/m3	N/A	Sample voided at BRL laboratory, error in sample preparation
5271059	4 - Albany St 6th Floor Scaffolding	1/30/2008	7:34 AM	1/31/2008	7:38 AM	1,444	578	Mercury	EPA 324/1631 mod.	BRL	02/01/2008	N/A	3000 ng/m3	N/A	Sample voided at BRL laboratory, error in sample preparation
5271063	5 - Washington St 6th Floor Scaffolding	1/30/2008	7:49 AM	1/31/2008	7:54 AM	1,445	578	Mercury	EPA 324/1631 mod.	BRL	02/01/2008	N/A	3000 ng/m3	N/A	Sample voided at BRL laboratory, error in sample preparation
5271067	6 - Cedar St 6th Floor Scaffolding	1/30/2008	8:06 AM	1/31/2008	8:10 AM	1,444	578	Mercury	EPA 324/1631 mod.	BRL	02/01/2008	N/A	3000 ng/m3	N/A	Sample voided at BRL laboratory, error in sample preparation
5271071	6 - Cedar St 6th Floor Scaffolding	1/30/2008	8:13 AM	1/31/2008	7:11 AM	1,378	531	Mercury	EPA 324/1631 mod.	BRL	02/01/2008	N/A	3000 ng/m3	N/A	Sample voided at BRL laboratory, error in sample preparation
5271172	7 - Roof, East Facade	1/30/2008	7:07 AM	1/31/2008	7:02 AM	1,435	588	Mercury	EPA 324/1631 mod.	BRL	02/01/2008	N/A	3000 ng/m3	N/A	Sample voided at BRL laboratory, error in sample preparation
5271075	8 - Roof, North Facade	1/30/2008	7:49 AM	1/31/2008	7:39 AM	1,430	572	Mercury	EPA 324/1631 mod.	BRL	02/01/2008	N/A	3000 ng/m3	N/A	Sample voided at BRL laboratory, error in sample preparation
5271176	3 - 90 West Courtyard at 2nd Floor Level	1/31/2008	7:15 AM	2/1/2008	7:10 AM	1,435	553	Mercury	EPA 324/1631 mod.	BRL	02/02/2008	< 6	3000 ng/m3	No	
5271180	4 - Albany St 6th Floor Scaffolding	1/31/2008	7:42 AM	2/1/2008	7:31 AM	1,429	572	Mercury	EPA 324/1631 mod.	BRL	02/02/2008	< 5	3000 ng/m3	No	
5271184	5 - Washington St 6th Floor Scaffolding	1/31/2008	7:58 AM	2/1/2008	7:43 AM	1,425	527	Mercury	EPA 324/1631 mod.	BRL	02/02/2008	< 6	3000 ng/m3	No	
5271188	6 - Cedar St 6th Floor Scaffolding	1/31/2008	8:15 AM	2/1/2008	7:53 AM	1,418	589	Mercury	EPA 324/1631 mod.	BRL	02/02/2008	< 5	3000 ng/m3	No	
5271192	7 - Roof, East Facade	1/31/2008	7:09 AM	2/1/2008	6:55 AM	1,426	570	Mercury	EPA 324/1631 mod.	BRL	02/02/2008	< 6	3000 ng/m3	No	
5271196	8 - Roof, North Facade	1/31/2008	7:48 AM	2/1/2008	7:30 AM	1,422	569	Mercury	EPA 324/1631 mod.	BRL	02/02/2008	< 5	3000 ng/m3	No	
5271003	3 - 90 West Courtyard at 2nd Floor Level	2/1/2008	7:14 AM	2/2/2008	7:30 AM	1,456	575	Mercury	EPA 324/1631 mod.	BRL	02/04/2008	< 6	3000 ng/m3	No	
5271007	4 - Albany St 6th Floor Scaffolding	2/1/2008	7:34 AM	2/2/2008	8:44 AM	1,510	604	Mercury	EPA 324/1631 mod.	BRL	02/04/2008	< 5	3000 ng/m3	No	
5271011	5 - Washington St 6th Floor Scaffolding	2/1/2008	7:47 AM	2/2/2008	8:23 AM	1,476	590	Mercury	EPA 324/1631 mod.	BRL	02/04/2008	6	3000 ng/m3	No	
5271015	6 - Cedar St 6th Floor Scaffolding	2/1/2008	7:57 AM	2/2/2008	8:09 AM	1,452	595	Mercury	EPA 324/1631 mod.	BRL	02/04/2008	8	3000 ng/m3	No	
5271019	7 - Roof, East Facade	2/1/2008	7:02 AM	2/2/2008	7:40 AM	1,478	569	Mercury	EPA 324/1631 mod.	BRL	02/04/2008	7	3000 ng/m3	No	
5271023	8 - Roof, North Facade	2/1/2008	7:39 AM	2/2/2008	7:58 AM	1,459	292	Mercury	EPA 324/1631 mod.	BRL	02/04/2008	< 11	3000 ng/m3	No	Sample volume estimated
5272403	3 - 90 West Courtyard at 2nd Floor Level	2/2/2008	7:34 AM	2/3/2008	7:35 AM	1,441	576	Mercury	EPA 324/1631 mod.	BRL	02/05/2008	< 5	3000 ng/m3	No	
5272407	4 - Albany St 6th Floor Scaffolding	2/2/2008	8:50 AM	2/3/2008	7:58 AM	1,388	555	Mercury	EPA 324/1631 mod.	BRL	02/05/2008	< 6	3000 ng/m3	No	
5272411	5 - Washington St 6th Floor Scaffolding	2/2/2008	8:29 AM	2/3/2008	8:07 AM	1,418	553	Mercury	EPA 324/1631 mod.	BRL	02/05/2008	< 6	3000 ng/m3	No	
5272415	6 - Cedar St 6th Floor Scaffolding	2/2/2008	8:13 AM	2/3/2008	8:12 AM	1,444	578	Mercury	EPA 324/1631 mod.	BRL	02/05/2008	< 5	3000 ng/m3	No	
5272419	7 - Roof, East Facade	2/2/2008	7:45 AM	2/3/2008	8:07 AM	1,457	583	Mercury	EPA 324/1631 mod.	BRL	02/05/2008	< 5	3000 ng/m3	No	
5272423	8 - Roof, North Facade	2/2/2008	8:15 AM	2/3/2008	8:41 AM	1,466	586	Mercury	EPA 324/1631 mod.	BRL	02/05/2008	< 5	3000 ng/m3	No	

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Asbestos Concentration (f/cc)	MMVF Concentration (f/cc)	EPA Site Specific Trigger Level	Exceeds EPA Site Specific Trigger Level?	Comments
5271206	3 - 90 West Courtyard at 2nd Floor Level	1/27/2008	9:29 AM	1/28/2008	7:07 AM	1,298	3,959	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271214	4 - Albany St 6th Floor Scaffolding	1/27/2008	8:25 AM	1/28/2008	7:26 AM	1,381	4,247	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271210	5 - Washington St 6th Floor Scaffolding	1/27/2008	8:49 AM	1/28/2008	7:38 AM	1,369	4,176	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271218	6 - Cedar St 6th Floor Scaffolding	1/27/2008	9:03 AM	1/28/2008	7:49 AM	1,366	4,132	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271222	7 - Roof, East Facade	1/27/2008	8:11 AM	1/28/2008	7:05 AM	1,374	4,237	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	0.00005	0.00010	0.0009 f/cc	No	
5271226	8 - Roof, North Facade	1/27/2008	7:57 AM	1/28/2008	7:31 AM	1,414	4,289	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/29/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271230	3 - 90 West Courtyard at 2nd Floor Level	1/28/2008	7:14 AM	1/29/2008	7:06 AM	1,432	4,296	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/30/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271234	4 - Albany St 6th Floor Scaffolding	1/28/2008	7:32 AM	1/29/2008	7:24 AM	1,432	4,153	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/30/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271246	5 - Washington St 6th Floor Scaffolding	1/28/2008	7:43 AM	1/29/2008	7:33 AM	1,430	4,362	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/30/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271242	6 - Cedar St 6th Floor Scaffolding	1/28/2008	7:53 AM	1/29/2008	7:43 AM	1,430	4,290	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/30/2008	0.00005	0.00005	0.0009 f/cc	No	
5271262	7 - Roof, East Facade	1/28/2008	7:10 AM	1/29/2008	6:56 AM	1,426	4,302	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/30/2008	0.00005	<0.00005	0.0009 f/cc	No	
5271238	8 - Roof, North Facade	1/28/2008	7:39 AM	1/29/2008	7:33 AM	1,434	4,400	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/30/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271270	3 - 90 West Courtyard at 2nd Floor Level	1/29/2008	7:11 AM	1/30/2008	7:08 AM	1,437	4,096	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/31/2008	0.00005	<0.00005	0.0009 f/cc	No	
5271274	4 - Albany St 6th Floor Scaffolding	1/29/2008	7:28 AM	1/30/2008	7:30 AM	1,442	3,821	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271266	5 - Washington St 6th Floor Scaffolding	1/29/2008	7:37 AM	1/30/2008	7:44 AM	1,447	4,196	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271278	6 - Cedar St 6th Floor Scaffolding	1/29/2008	7:47 AM	1/30/2008	8:02 AM	1,455	4,292	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271282	7 - Roof, East Facade	1/29/2008	7:04 AM	1/30/2008	6:59 AM	1,435	4,174	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271286	8 - Roof, North Facade	1/29/2008	7:41 AM	1/30/2008	7:40 AM	1,439	4,208	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	1/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271054	3 - 90 West Courtyard at 2nd Floor Level	1/30/2008	7:12 AM	1/31/2008	7:11 AM	1,439	4,209	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271058	4 - Albany St 6th Floor Scaffolding	1/30/2008	7:34 AM	1/31/2008	7:38 AM	1,444	4,224	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271062	5 - Washington St 6th Floor Scaffolding	1/30/2008	7:49 AM	1/31/2008	7:54 AM	1,445	4,263	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271066	6 - Cedar St 6th Floor Scaffolding	1/30/2008	8:06 AM	1/31/2008	8:10 AM	1,444	4,188	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271171	6 - Cedar St 6th Floor Scaffolding	1/30/2008	8:13 AM	1/31/2008	8:21 AM	1,448	4,272	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271070	7 - Roof, East Facade	1/30/2008	7:07 AM	1/31/2008	7:02 AM	1,435	4,334	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/1/2008	<0.00005	0.00005	0.0009 f/cc	No	
5271074	8 - Roof, North Facade	1/30/2008	7:49 AM	1/31/2008	7:39 AM	1,430	4,368	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271175	3 - 90 West Courtyard at 2nd Floor Level	1/31/2008	7:15 AM	2/1/2008	7:10 AM	1,435	4,305	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/2/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271179	4 - Albany St 6th Floor Scaffolding	1/31/2008	7:42 AM	2/1/2008	7:31 AM	1,429	4,359	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/2/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271183	5 - Washington St 6th Floor Scaffolding	1/31/2008	7:58 AM	2/1/2008	7:43 AM	1,425	4,418	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/2/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271187	6 - Cedar St 6th Floor Scaffolding	1/31/2008	8:15 AM	2/1/2008	7:53 AM	1,418	4,396	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/2/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271191	7 - Roof, East Facade	1/31/2008	7:09 AM	2/1/2008	6:55 AM	1,426	4,431	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/2/2008	<0.00005	0.00009	0.0009 f/cc	No	
5271195	8 - Roof, North Facade	1/31/2008	7:48 AM	2/1/2008	7:30 AM	1,422	4,400	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/2/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271002	3 - 90 West Courtyard at 2nd Floor Level	2/1/2008	7:14 AM	2/2/2008	7:30 AM	1,456	4,332	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/4/2008	0.00009	<0.00005	0.0009 f/cc	No	
5271006	4 - Albany St 6th Floor Scaffolding	2/1/2008	7:34 AM	2/2/2008	8:44 AM	1,510	4,455	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/4/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271010	5 - Washington St 6th Floor Scaffolding	2/1/2008	7:47 AM	2/2/2008	8:23 AM	1,476	4,428	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/4/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271014	6 - Cedar St 6th Floor Scaffolding	2/1/2008	7:57 AM	2/2/2008	8:09 AM	1,452	4,283	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/4/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5271018	7 - Roof, East Facade	2/1/2008	7:02 AM	2/2/2008	7:40 AM	1,478	4,557	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/4/2008	<0.00004	0.00004	0.0009 f/cc	No	
5271022	8 - Roof, North Facade	2/1/2008	7:39 AM	2/2/2008	7:58 AM	1,459	4,485	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/4/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272402	3 - 90 West Courtyard at 2nd Floor Level	2/2/2008	7:34 AM	2/3/2008	7:35 AM	1,441	4,179	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/5/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272406	4 - Albany St 6th Floor Scaffolding	2/2/2008	8:50 AM	2/3/2008	7:58 AM	1,388	4,095	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/5/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272410	5 - Washington St 6th Floor Scaffolding	2/2/2008	8:29 AM	2/3/2008	8:07 AM	1,418	4,183	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/5/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272414	6 - Cedar St 6th Floor Scaffolding	2/2/2008	8:13 AM	2/3/2008	8:17 AM	1,444	4,188	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/5/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272418	7 - Roof, East Facade	2/2/2008	7:45 AM	2/3/2008	8:02 AM	1,457	4,219	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/5/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272422	8 - Roof, North Facade	2/2/2008	8:15 AM	2/3/2008	8:41 AM	1,466	4,230	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/5/2008	<0.00005	<0.00005	0.0009 f/cc	No	

Works - 130 Cedar Building, Community Monitoring


Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Date	Respirable Dust Concentration (mg/m ³)	Respirable Quartz Concentration (mg/m ³)	Target Air quality Level for Respirable Quartz (mg/m ³)	EPA Site Specific Trigger Level for Respirable Quartz (mg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
5271205	3 - 90 West Courtyard at 2nd Floor Level	1/27/2008	8:25 AM	1/28/2008	7:07 AM	1,298	3,440	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.29	< .001	0.01	0.01	No	
5271213	4 - Albany St 6th Floor Scaffolding	1/27/2008	8:25 AM	1/28/2008	7:26 AM	1,381	3,453	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.29	< .001	0.01	0.01	No	
5271209	5 - Washington St 6th Floor Scaffolding	1/27/2008	8:49 AM	1/28/2008	7:36 AM	1,369	3,423	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.29	< .001	0.01	0.01	No	
5271217	6 - Cedar St 6th Floor Scaffolding	1/27/2008	9:03 AM	1/28/2008	7:46 AM	1,396	3,415	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.29	< .001	0.01	0.01	No	
5271221	7 - Roof, East Facade	1/27/2008	8:11 AM	1/28/2008	7:05 AM	1,374	3,504	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.29	< .001	0.01	0.01	No	
5271225	8 - Roof, North Facade	1/27/2008	7:57 AM	1/28/2008	7:31 AM	1,414	3,356	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/29/2008	< 0.28	< .001	0.01	0.01	No	
5271229	3 - 90 West Courtyard at 2nd Floor Level	1/28/2008	7:14 AM	1/29/2008	7:06 AM	1,432	3,580	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/30/2008	< 0.28	< .001	0.01	0.01	No	
5271233	4 - Albany St 6th Floor Scaffolding	1/28/2008	7:32 AM	1/29/2008	7:24 AM	1,432	3,580	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/30/2008	< 0.28	< .001	0.01	0.01	No	
5271245	5 - Washington St 6th Floor Scaffolding	1/28/2008	7:43 AM	1/29/2008	7:33 AM	1,430	3,575	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/30/2008	< 0.28	< .001	0.01	0.01	No	
5271241	6 - Cedar St 6th Floor Scaffolding	1/28/2008	7:53 AM	1/29/2008	7:43 AM	1,430	3,611	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/30/2008	< 0.28	< .001	0.01	0.01	No	
5271261	7 - Roof, East Facade	1/28/2008	7:10 AM	1/29/2008	6:56 AM	1,426	3,672	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/30/2008	< 0.27	< .001	0.01	0.01	No	
5271237	8 - Roof, North Facade	1/28/2008	7:39 AM	1/29/2008	7:33 AM	1,434	3,693	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/30/2008	< 0.27	< .001	0.01	0.01	No	
5271269	3 - 90 West Courtyard at 2nd Floor Level	1/29/2008	7:11 AM	1/30/2008	7:06 AM	1,437	3,664	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/31/2008	0.033	< .001	0.01	0.01	No	
5271273	4 - Albany St 6th Floor Scaffolding	1/29/2008	7:28 AM	1/30/2008	7:30 AM	1,442	3,461	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/31/2008	0.033	< .001	0.01	0.01	No	
5271265	5 - Washington St 6th Floor Scaffolding	1/29/2008	7:37 AM	1/30/2008	7:40 AM	1,447	3,616	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/31/2008	0.032	< .001	0.01	0.01	No	
5271277	6 - Cedar St 6th Floor Scaffolding	1/29/2008	7:47 AM	1/30/2008	8:02 AM	1,455	3,710	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/31/2008	0.033	< .001	0.01	0.01	No	
5271281	7 - Roof, East Facade	1/29/2008	7:04 AM	1/30/2008	6:59 AM	1,435	3,659	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/31/2008	0.031	< .001	0.01	0.01	No	
5271285	8 - Roof, North Facade	1/29/2008	7:41 AM	1/30/2008	7:40 AM	1,439	3,670	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	1/31/2008	0.032	< .001	0.01	0.01	No	
5271053	3 - 90 West Courtyard at 2nd Floor Level	1/30/2008	7:12 AM	1/31/2008	7:11 AM	1,439	3,454	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/1/2008	< 0.29	< .001	0.01	0.01	No	
5271057	4 - Albany St 6th Floor Scaffolding	1/30/2008	7:34 AM	1/31/2008	7:36 AM	1,444	3,249	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/1/2008	< 0.31	< 0.02	0.01	0.01	No	
5271061	5 - Washington St 6th Floor Scaffolding	1/30/2008	7:49 AM	1/31/2008	7:54 AM	1,445	3,540	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/1/2008	< 0.28	< .001	0.01	0.01	No	
5271065	6 - Cedar St 6th Floor Scaffolding	1/30/2008	8:06 AM	1/31/2008	8:10 AM	1,444	3,466	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/1/2008	< 0.29	< .001	0.01	0.01	No	
5271170	6 - Cedar St 6th Floor Scaffolding	1/30/2008	8:13 AM	1/31/2008	8:21 AM	1,448	3,548	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/1/2008	< 0.28	< .001	0.01	0.01	No	
5271069	7 - Roof, East Facade	1/30/2008	7:07 AM	1/31/2008	7:02 AM	1,435	3,588	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/1/2008	< 0.28	< .001	0.01	0.01	No	
5271073	8 - Roof, North Facade	1/30/2008	7:49 AM	1/31/2008	7:39 AM	1,430	3,504	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/1/2008	< 0.29	< .001	0.01	0.01	No	
5271174	3 - 90 West Courtyard at 2nd Floor Level	1/31/2008	7:15 AM	2/1/2008	7:10 AM	1,435	3,659	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/2/2008	< 0.27	< .001	0.01	0.01	No	
5271178	4 - Albany St 6th Floor Scaffolding	1/31/2008	7:42 AM	2/1/2008	7:31 AM	1,429	3,358	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/2/2008	< 0.3	< .001	0.01	0.01	No	
5271182	5 - Washington St 6th Floor Scaffolding	1/31/2008	7:58 AM	2/1/2008	7:54 AM	1,425	3,634	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/2/2008	< 0.28	< .001	0.01	0.01	No	
5271186	6 - Cedar St 6th Floor Scaffolding	1/31/2008	8:15 AM	2/1/2008	7:43 AM	1,418	3,616	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/2/2008	< 0.28	< .001	0.01	0.01	No	
5271190	7 - Roof, East Facade	1/31/2008	7:09 AM	2/1/2008	6:55 AM	1,426	3,636	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/2/2008	< 0.28	< .001	0.01	0.01	No	
5271194	8 - Roof, North Facade	1/31/2008	7:48 AM	2/1/2008	7:30 AM	1,422	3,697	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/2/2008	< 0.27	< .001	0.01	0.01	No	
5271001	3 - 90 West Courtyard at 2nd Floor Level	2/1/2008	7:14 AM	2/2/2008	7:30 AM	1,456	3,931	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/4/2008	< 0.26	< .001	0.01	0.01	No	
5271005	4 - Albany St 6th Floor Scaffolding	2/1/2008	7:34 AM	2/2/2008	8:44 AM	1,510	3,511	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/4/2008	< 0.28	< .001	0.01	0.01	No	
5271009	5 - Washington St 6th Floor Scaffolding	2/1/2008	7:47 AM	2/2/2008	8:23 AM	1,476	3,616	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/4/2008	< 0.28	< .001	0.01	0.01	No	
5271013	6 - Cedar St 6th Floor Scaffolding	2/1/2008	7:57 AM	2/2/2008	8:06 AM	1,452	3,630	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/4/2008	< 0.28	< .001	0.01	0.01	No	
5271017	7 - Roof, East Facade	2/1/2008	7:02 AM	2/2/2008	7:40 AM	1,476	3,695	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/4/2008	< 0.27	< .001	0.01	0.01	No	
5271021	8 - Roof, North Facade	2/1/2008	7:39 AM	2/2/2008	7:58 AM	1,459	3,648	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/4/2008	< 0.27	< .001	0.01	0.01	No	
5272401	3 - 90 West Courtyard at 2nd Floor Level	2/2/2008	7:34 AM	2/3/2008	7:36 AM	1,441	3,603	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/5/2008	< 0.28	< .001	0.01	0.01	No	
5272405	4 - Albany St 6th Floor Scaffolding	2/2/2008	8:50 AM	2/3/2008	7:55 AM	1,388	3,192	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/5/2008	< 0.31	< 0.02	0.01	0.01	No	
5272409	5 - Washington St 6th Floor Scaffolding	2/2/2008	8:29 AM	2/3/2008	8:07 AM	1,418	3,463	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/5/2008	< 0.29	< .001	0.01	0.01	No	
5272413	6 - Cedar St 6th Floor Scaffolding	2/2/2008	8:13 AM	2/3/2008	8:17 AM	1,444	3,393	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/5/2008	< 0.28	< .001	0.01	0.01	No	
5272417	7 - Roof, East Facade	2/2/2008	7:45 AM	2/3/2008	8:02 AM	1,457	3,643	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/5/2008	< 0.27	< .001	0.01	0.01	No	
5272421	8 - Roof, North Facade	2/2/2008	8:11 AM	2/3/2008	8:41 AM	1,466	3,702	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	2/5/2008	< 0.27	< .001	0.01	0.01	No	

meterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM _{2.5} Avg. Concentration (µg/m ³)	EPA Site Specific Trigger Level for PM _{2.5} (µg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	15	65	No
N/A	4 - Albany St 6th Floor Level Scaffolding	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	16	65	No
N/A	5 - Washington St 6th Floor Level Scaffolding	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	16	65	No
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	16	65	No
N/A	7 - Roof, East	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,415	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	17	65	No
N/A	8 - Roof, North	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	16	65	No
N/A	3 - Courtyard, 2nd Floor Level	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	17	65	No
N/A	4 - Albany St 6th Floor Level Scaffolding	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	18	65	No
N/A	5 - Washington St 6th Floor Level Scaffolding	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	18	65	No
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	18	65	No
N/A	7 - Roof, East	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,020	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	18	65	No
N/A	8 - Roof, North	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	18	65	No
N/A	3 - Courtyard, 2nd Floor Level	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	32	65	No
N/A	4 - Albany St 6th Floor Level Scaffolding	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	32	65	No
N/A	5 - Washington St 6th Floor Level Scaffolding	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,435	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	35	65	No
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	35	65	No
N/A	7 - Roof, East	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,435	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	35	65	No
N/A	8 - Roof, North	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	37	65	No
N/A	3 - Courtyard, 2nd Floor Level	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	16	65	No
N/A	4 - Albany St 6th Floor Level Scaffolding	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	16	65	No
N/A	5 - Washington St 6th Floor Level Scaffolding	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	18	65	No
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	19	65	No
N/A	7 - Roof, East	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	18	65	No
N/A	8 - Roof, North	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	21	65	No
N/A	3 - Courtyard, 2nd Floor Level	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	11	65	No
N/A	4 - Albany St 6th Floor Level Scaffolding	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	12	65	No
N/A	5 - Washington St 6th Floor Level Scaffolding	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	11	65	No
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	13	65	No
N/A	7 - Roof, East	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	10	65	No
N/A	8 - Roof, North	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	11	65	No
N/A	3 - Courtyard, 2nd Floor Level	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	19	65	No
N/A	4 - Albany St 6th Floor Level Scaffolding	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	29	65	No
N/A	5 - Washington St 6th Floor Level Scaffolding	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	31	65	No
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	29	65	No
N/A	7 - Roof, East	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	12	65	No
N/A	8 - Roof, North	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	16	65	No
N/A	3 - Courtyard, 2nd Floor Level	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	17	65	No
N/A	4 - Albany St 6th Floor Level Scaffolding	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	14	65	No
N/A	5 - Washington St 6th Floor Level Scaffolding	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	15	65	No
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	18	65	No
N/A	7 - Roof, East	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	18	65	No
N/A	8 - Roof, North	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	21	65	No

MasterWorks - 130 Cedar Building, Community Monitoring														
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM ₁₀ Avg. Concentration (µg/m ³)	EPA Site Specific Trigger Level for PM ₁₀ (µg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	16	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	17	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	17	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	20	150	No	
N/A	7 - Roof, East	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	19	150	No	
N/A	8 - Roof, North	1/27/2008	12:00 AM	1/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	19	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,425	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	21	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	20	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	21	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	23	150	No	
N/A	7 - Roof, East	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	22	150	No	
N/A	8 - Roof, North	1/28/2008	12:00 AM	1/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	34	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	36	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,435	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	37	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	42	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	42	150	No	
N/A	7 - Roof, East	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	60	150	No	
N/A	8 - Roof, North	1/29/2008	12:00 AM	1/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	43	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	27	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	21	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	26	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	27	150	No	
N/A	7 - Roof, East	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	32	150	No	
N/A	8 - Roof, North	1/30/2008	12:00 AM	1/31/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	34	150	No	
N/A	3 - Courtyard, 2nd Floor Level	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	14	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	14	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	17	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	16	150	No	
N/A	7 - Roof, East	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	16	150	No	
N/A	8 - Roof, North	1/31/2008	12:00 AM	2/1/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	14	150	No	
N/A	3 - Courtyard, 2nd Floor Level	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	23	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	43	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	36	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	43	150	No	
N/A	7 - Roof, East	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	16	150	No	
N/A	8 - Roof, North	2/1/2008	12:00 AM	2/2/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	18	150	No	
N/A	3 - Courtyard, 2nd Floor Level	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	22	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	26	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	24	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	28	150	No	
N/A	7 - Roof, East	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	19	150	No	
N/A	8 - Roof, North	2/2/2008	12:00 AM	2/3/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	23	150	No	

Mercury Vapor (Hg^0) Air Results for Outdoor Community
Monitoring Stations by Location as recorded by the Lumex Analyzer

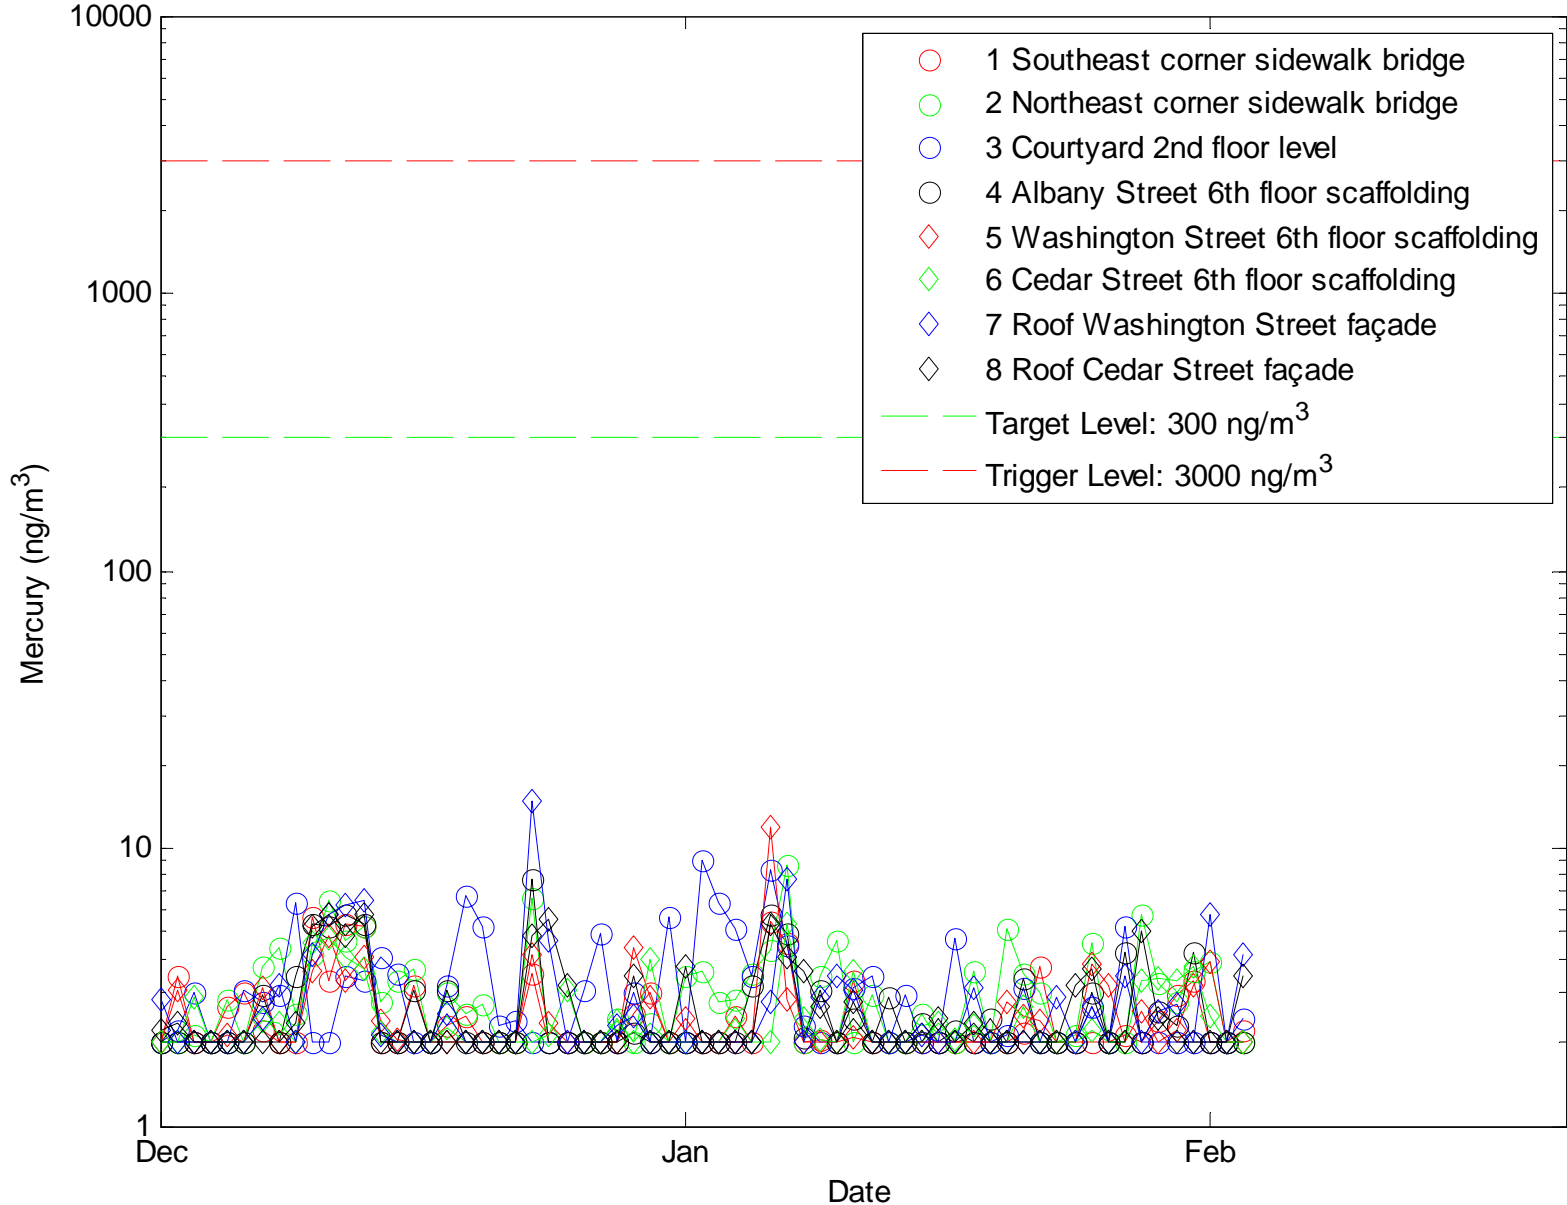

Report Summary

Air Mercury Results (Hg⁰, ng/m³) as recorded by the Lumex RA915+ analyzer

Week of 01/27/08 to 02/02/08

Date	Mercury (Hg ⁰) ng/m ³ 30-sec readings	1 Southeast corner sidewalk bridge	2 Northeast corner sidewalk bridge	3 Courtyard 2nd floor level	4 Albany Street 6th floor scaffolding	5 Washington Street 6th floor scaffolding	6 Cedar Street 6th floor scaffolding	7 Roof Washington Street façade	8 Roof Cedar Street façade
27-Jan-08	# Samples	9	9	9	9	9	9	9	9
	Average	2	2	5	4	2	2	3	2
	Maximum	3	2	6	5	2	2	4	2
28-Jan-08	# Samples	9	9	18	18	18	18	18	18
	Average	2	6	2	2	3	3	2	5
	Maximum	2	7	3	3	3	4	3	7
29-Jan-08	# Samples	36	36	36	36	36	36	36	36
	Average	2	3	2	3	2	3	3	2
	Maximum	4	6	2	6	3	6	5	6
30-Jan-08	# Samples	36	36	36	36	36	36	36	36
	Average	3	3	2	2	2	3	3	2
	Maximum	4	6	3	4	3	6	7	3
31-Jan-08	# Samples	36	36	36	36	36	36	36	36
	Average	3	4	2	4	3	4	2	2
	Maximum	5	5	2	7	4	6	3	4
1-Feb-08	# Samples	27	27	36	27	27	27	27	27
	Average	2	4	2	2	4	2	6	2
	Maximum	4	6	3	4	5	5	13	3
2-Feb-08	# Samples	9	9	9	9	9	9	9	9
	Average	2	2	2	2	2	2	2	2
	Maximum	2	2	3	2	2	2	2	2