

MasterWorks - 130 Cedar Building, Community Monitoring																					
Sample No.	Sampling Location	Collection Start/End Dates	Collection (Time on)	Collection End/Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	Total Structure Count			Asbestos < 5 µm	Asbestos ≥ 5 µm	Result (µm/m)	Concentration (fsc)	EPA Site Specific Trigger Level	Exceeds EPA Site Specific Trigger Level?	Comments
												All Asbestos	Chrysotile	Amphibole							
5222016	3-90 West Courtyard at 2nd Floor Level	2/17/2008	7:22 AM	2/17/2008	11:19 AM	277	1,697	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222017	4- Albany St 6th Floor Scaffolding	2/17/2008	7:30 AM	2/17/2008	11:38 AM	248	1,426	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222018	5- Washington St 6th Floor Scaffolding	2/17/2008	7:32 AM	2/17/2008	11:41 AM	249	1,525	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222019	6- Cedar St 6th Floor Scaffolding	2/17/2008	7:34 AM	2/17/2008	11:45 AM	251	1,506	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222020	7- Roof, East Facade	2/17/2008	7:09 AM	2/17/2008	11:23 AM	254	1,744	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.9	< 0.020	70 fpm/m2	No	
5222021	8- Roof, North Facade	2/17/2008	7:13 AM	2/17/2008	11:31 AM	258	1,787	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	1	1	0	1	0	8.9	0.019	70 fpm/m2	No	
5222022	3-90 West Courtyard at 2nd Floor Level	2/18/2008	8:02 AM	2/18/2008	11:59 AM	464	1,659	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222023	4- Albany St 6th Floor Scaffolding	2/18/2008	7:13 AM	2/18/2008	3:39 PM	477	1,670	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222024	5- Washington St 6th Floor Scaffolding	2/18/2008	7:14 AM	2/18/2008	3:28 PM	476	1,644	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222025	7- Roof, East Facade	2/18/2008	7:28 AM	2/18/2008	3:28 PM	475	1,677	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222026	8- Roof, North Facade	2/18/2008	7:30 AM	2/18/2008	3:32 PM	482	1,735	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/19/2008	0	0	0	0	0	8.9	< 0.020	70 fpm/m2	No	
5222187	3-90 West Courtyard at 2nd Floor Level	2/18/2008	8:04 AM	2/18/2008	11:48 PM	432	1,512	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222188	4- Albany St 6th Floor Scaffolding	2/18/2008	8:37 PM	2/18/2008	11:03 PM	446	1,561	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222189	5- Washington St 6th Floor Scaffolding	2/18/2008	8:39 PM	2/18/2008	11:10 PM	445	1,546	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222190	6- Cedar St 6th Floor Scaffolding	2/18/2008	8:40 PM	2/18/2008	11:05 PM	446	1,540	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222191	7- Roof, East Facade	2/18/2008	8:28 PM	2/18/2008	11:10 PM	462	1,594	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.7	< 0.019	70 fpm/m2	No	
5222192	8- Roof, North Facade	2/18/2008	8:32 PM	2/18/2008	11:08 PM	456	1,573	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.7	< 0.019	70 fpm/m2	No	
5222193	3-90 West Courtyard at 2nd Floor Level	2/19/2008	8:01 AM	2/19/2008	11:57 AM	478	1,701	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222706	4- Albany St 6th Floor Scaffolding	2/19/2008	7:35 AM	2/19/2008	3:31 PM	476	1,630	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222704	4- Albany St 6th Floor Scaffolding	2/19/2008	7:36 AM	2/19/2008	3:32 PM	476	1,499	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.7	< 0.020	70 fpm/m2	No	
5222705	5- Washington St 6th Floor Scaffolding	2/19/2008	7:38 AM	2/19/2008	3:34 PM	475	1,678	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222706	6- Cedar St 6th Floor Scaffolding	2/19/2008	7:40 AM	2/19/2008	3:35 PM	475	1,663	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222709	7- Roof, East Facade	2/19/2008	7:27 AM	2/19/2008	3:24 PM	477	1,693	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222710	8- Roof, North Facade	2/19/2008	7:28 AM	2/19/2008	3:28 PM	478	1,697	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/20/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222180	3-90 West Courtyard at 2nd Floor Level	2/19/2008	8:04 PM	2/19/2008	11:00 PM	476	1,642	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222181	4- Albany St 6th Floor Scaffolding	2/19/2008	8:31 PM	2/19/2008	11:18 PM	467	1,635	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222182	5- Washington St 6th Floor Scaffolding	2/19/2008	8:34 PM	2/19/2008	11:19 PM	465	1,604	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222183	6- Cedar St 6th Floor Scaffolding	2/19/2008	8:35 PM	2/19/2008	11:20 PM	465	1,604	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222184	7- Roof, East Facade	2/19/2008	8:24 PM	2/19/2008	11:11 PM	467	1,611	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222185	8- Roof, North Facade	2/19/2008	8:26 PM	2/19/2008	11:12 PM	468	1,608	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222204	3-90 West Courtyard at 2nd Floor Level	2/20/2008	8:12 AM	2/20/2008	3:30 PM	438	1,577	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.7	< 0.019	70 fpm/m2	No	
5222505	4- Albany St 6th Floor Scaffolding	2/20/2008	8:03 AM	2/20/2008	3:09 PM	426	1,459	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222506	5- Washington St 6th Floor Scaffolding	2/20/2008	8:01 AM	2/20/2008	3:21 PM	440	1,562	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222507	6- Cedar St 6th Floor Scaffolding	2/20/2008	7:58 AM	2/20/2008	3:23 PM	445	1,492	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222508	7- Roof, East Facade	2/20/2008	7:39 AM	2/20/2008	3:07 PM	448	1,635	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222509	8- Roof, North Facade	2/20/2008	7:38 AM	2/20/2008	3:07 PM	448	1,635	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/21/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222577	3-90 West Courtyard at 2nd Floor Level	2/20/2008	8:30 PM	2/20/2008	11:07 PM	457	1,622	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222578	4- Albany St 6th Floor Scaffolding	2/20/2008	8:19 PM	2/20/2008	11:28 PM	489	1,712	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222579	5- Washington St 6th Floor Scaffolding	2/20/2008	8:21 PM	2/20/2008	11:27 PM	486	1,725	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.9	< 0.020	70 fpm/m2	No	
5222580	6- Cedar St 6th Floor Scaffolding	2/20/2008	8:23 PM	2/20/2008	11:28 PM	483	1,691	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222581	7- Roof, East Facade	2/20/2008	8:07 PM	2/20/2008	11:20 PM	493	1,726	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.9	< 0.020	70 fpm/m2	No	
5222582	8- Roof, North Facade	2/20/2008	8:08 PM	2/20/2008	11:21 PM	493	1,729	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.9	< 0.020	70 fpm/m2	No	
5222332	3-90 West Courtyard at 2nd Floor Level	2/21/2008	7:33 AM	2/21/2008	3:55 PM	502	1,807	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.9	< 0.019	70 fpm/m2	No	
5222333	4- Albany St 6th Floor Scaffolding	2/21/2008	7:26 AM	2/21/2008	3:44 PM	498	1,706	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222334	5- Washington St 6th Floor Scaffolding	2/21/2008	7:27 AM	2/21/2008	3:46 PM	499	1,759	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	0	0	0	0	0	8.9	< 0.019	70 fpm/m2	No	
5222335	6- Cedar St 6th Floor Scaffolding	2/21/2008	7:28 AM	2/21/2008	3:47 PM	499	1,821	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	1	1	0	1	0	8.9	0.019	70 fpm/m2	No	
5222336	7- Roof, East Facade	2/21/2008	7:20 AM	2/21/2008	3:28 PM	438	1,745	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	1	1	0	1	0	8.9	0.02	70 fpm/m2	No	
5222337	8- Roof, North Facade	2/21/2008	7:21 AM	N/A	N/A	N/A	N/A	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/22/2008	N/A	N/A	N/A	N/A	N/A	N/A	N/A	70 fpm/m2	No	Void sample due to loss of power. [cont was found unlogged]
5222719	3-90 West Courtyard at 2nd Floor Level	2/21/2008	8:55 PM	2/21/2008	11:08 PM	488	1,537	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/23/2008	0	0	0	0	0	8.7	< 0.019	70 fpm/m2	No	
5222720	4- Albany St 6th Floor Scaffolding	2/21/2008	8:44 PM	2/21/2008	11:40 PM	476	1,666	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/23/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222721	5- Washington St 6th Floor Scaffolding	2/21/2008	8:39 PM	2/21/2008	11:37 PM	473	1,608	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/23/2008	0	0	0	0	0	8.3	< 0.020	70 fpm/m2	No	
5222722	6- Cedar St 6th Floor Scaffolding	2/21/2008	8:47 PM	2/21/2008	11:37 PM	470	1,645	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	2/23/2008	0	0	0	0	0	8.3	< 0.019	70 fpm/m2	No	
5222723	7- Roof, East Facade	2/21/2008	8:28 PM	2/21/2008	11:25 PM	477	1,670	Asbestos	AMERA, 40 CFR, Part 763, October 30, 198												

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	EPA Site Specific Trigger Levels														Exceeds Target Air Quality Levels	Exceeds EPA Site Specific Trigger Levels	Comments
												Barium Concentration (µg/m³)	Chromium Concentration (µg/m³)	Manganese Concentration (µg/m³)	Zinc Concentration (µg/m³)	Beryllium Concentration (µg/m³)	Copper Concentration (µg/m³)	Mercury Particulate Concentration (µg/m³)	Cadmium Concentration (µg/m³)	Lead Concentration (µg/m³)	Nickel Concentration (µg/m³)	Antimony Concentration (µg/m³)						
												0.05	0.05	0.50	165.00	0.02	10.00	0.30	0.04	0.50	0.20	0.02						
5272680	3-90 West Courtyard at 2nd Floor Level	2/17/2008	7:12 AM	2/18/2008	7:12 AM	1,440	5,040	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/19/2008	0.015	< 0.040	< 0.008	0.11	< 0.0020	0.015	< 0.0020	0.009	0.012	< 0.012	No	No					
5272684	4-Albany St 6th Floor Scaffolding	2/17/2008	7:43 AM	2/18/2008	7:28 AM	1,425	5,130	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/19/2008	0.016	< 0.039	< 0.008	0.10	< 0.0020	0.016	< 0.0020	< 0.008	< 0.008	0.010	< 0.012	No	No				
5272688	5-Washington St 6th Floor Scaffolding	2/17/2008	7:53 AM	2/18/2008	7:37 AM	1,424	3,987	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/19/2008	0.023	< 0.050	0.011	0.13	< 0.0025	0.021	< 0.0025	< 0.010	< 0.010	0.019	< 0.015	No	No				
5272696	5-Cedar St 6th Floor Scaffolding	2/17/2008	8:03 AM	2/18/2008	7:47 AM	1,424	5,198	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/19/2008	0.044	0.056	0.009	0.11	< 0.0019	0.018	< 0.0019	0.010	0.011	< 0.012	No	No					
5272692	7-Roof, East Facade	2/17/2008	7:30 AM	2/18/2008	7:02 AM	1,412	5,099	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/19/2008	0.024	< 0.039	0.009	0.12	< 0.0020	0.023	< 0.0020	< 0.020	0.018	0.015	< 0.012	No	No				
5272719	8-Roof, North Facade	2/17/2008	7:17 AM	2/18/2008	7:39 AM	1,422	5,102	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/19/2008	0.012	0.045	< 0.008	0.12	< 0.0020	0.013	< 0.0020	< 0.020	< 0.008	0.008	< 0.012	No	No				
5272100	3-90 West Courtyard at 2nd Floor Level	2/18/2008	7:17 AM	2/18/2008	7:06 AM	1,439	5,144	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/20/2008	0.012	0.043	0.008	0.13	< 0.0019	0.016	< 0.0019	< 0.018	< 0.008	0.010	< 0.012	No	No				
5272104	4-Albany St 6th Floor Scaffolding	2/18/2008	7:32 AM	2/19/2008	7:31 AM	1,439	4,821	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/20/2008	0.011	0.046	< 0.008	0.11	< 0.0021	0.011	< 0.0021	< 0.0021	< 0.008	0.009	< 0.012	No	No				
5272108	5-Washington St 6th Floor Scaffolding	2/18/2008	7:41 AM	2/19/2008	7:43 AM	1,442	4,670	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/20/2008	0.011	0.049	< 0.009	0.11	< 0.0022	0.012	< 0.0022	< 0.009	0.009	< 0.012	No	No					
5272112	5-Cedar St 6th Floor Scaffolding	2/18/2008	7:51 AM	2/19/2008	8:00 AM	1,449	5,072	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/20/2008	0.012	< 0.039	0.009	0.13	< 0.0020	0.012	< 0.0020	< 0.009	0.009	< 0.012	No	No					
5272116	7-Roof, East Facade	2/18/2008	7:10 AM	2/19/2008	6:59 AM	1,429	5,189	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/20/2008	0.011	< 0.039	< 0.008	0.13	< 0.0019	0.010	< 0.0019	< 0.008	0.010	< 0.012	No	No					
5272120	8-Roof, North Facade	2/18/2008	7:46 AM	2/19/2008	7:26 AM	1,420	4,936	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/20/2008	0.010	0.058	0.006	0.10	< 0.0020	0.014	< 0.0020	< 0.008	0.008	< 0.012	No	No					
5272124	3-90 West Courtyard at 2nd Floor Level	2/18/2008	7:10 AM	2/20/2008	7:18 AM	1,448	5,213	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/21/2008	0.008	0.061	0.015	0.17	< 0.0019	0.024	< 0.0019	< 0.009	0.020	< 0.012	No	No					
5272025	4-Albany St 6th Floor Scaffolding	2/18/2008	7:22 AM	2/20/2008	7:56 AM	1,474	5,233	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/21/2008	0.011	0.070	0.013	0.14	< 0.0019	0.013	< 0.0019	< 0.019	0.012	0.011	< 0.012	No	No				
5272128	4-Albany St 6th Floor Scaffolding	2/18/2008	7:35 AM	2/20/2008	7:39 AM	1,444	4,821	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/21/2008	0.011	< 0.043	0.050	0.13	< 0.0022	0.013	< 0.0022	0.009	0.011	< 0.013	No	No					
5272132	5-Washington St 6th Floor Scaffolding	2/18/2008	7:50 AM	2/20/2008	8:12 AM	1,482	5,117	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/21/2008	0.018	< 0.039	0.012	0.12	< 0.0020	0.022	< 0.0020	< 0.020	0.018	0.009	< 0.012	No	No				
5272136	6-Cedar St 6th Floor Scaffolding	2/18/2008	8:07 AM	2/20/2008	8:25 AM	1,458	4,967	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/21/2008	0.017	0.047	0.016	0.13	< 0.0020	0.019	< 0.0020	< 0.020	< 0.008	0.008	< 0.012	No	No				
5272140	7-Roof, East Facade	2/18/2008	7:26 AM	2/20/2008	6:52 AM	1,426	5,081	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/21/2008	0.019	0.049	0.014	0.15	< 0.0020	0.022	< 0.0020	0.027	0.021	< 0.012	No	No					
5272144	8-Roof, North Facade	2/18/2008	7:35 AM	2/20/2008	7:23 AM	1,428	4,995	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/21/2008	0.017	0.055	0.017	0.13	< 0.0020	0.026	< 0.0020	< 0.020	0.016	0.008	< 0.012	No	No				
5272032	3-90 West Courtyard at 2nd Floor Level	2/20/2008	7:26 AM	2/21/2008	7:02 AM	1,417	5,101	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/22/2008	0.016	0.044	0.014	0.13	< 0.0020	0.021	< 0.0020	< 0.020	0.011	0.008	< 0.012	No	No				
5272044	4-Albany St 6th Floor Scaffolding	2/20/2008	7:46 AM	2/21/2008	7:25 AM	1,419	5,108	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/22/2008	0.015	< 0.039	0.010	0.14	< 0.0020	0.015	< 0.0020	0.032	0.009	0.009	< 0.012	No	No				
5272048	5-Washington St 6th Floor Scaffolding	2/20/2008	8:16 AM	2/21/2008	7:40 AM	1,404	4,844	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/22/2008	0.019	0.042	0.024	0.15	< 0.0021	0.025	< 0.0021	< 0.020	0.010	0.008	< 0.012	No	No				
5272052	6-Cedar St 6th Floor Scaffolding	2/20/2008	8:30 AM	2/21/2008	8:00 AM	1,410	4,835	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/22/2008	0.020	0.059	0.027	0.15	< 0.0020	0.023	< 0.0020	< 0.020	0.021	0.008	< 0.012	No	No				
5272056	7-Roof, East Facade	2/20/2008	7:00 AM	2/21/2008	7:16 AM	1,456	5,340	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/22/2008	0.014	< 0.038	0.018	0.14	< 0.0019	0.027	< 0.0019	0.015	0.013	< 0.011	No	No					
5272060	8-Roof, North Facade	2/20/2008	7:26 AM	2/21/2008	7:27 AM	1,435	5,141	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/22/2008	0.017	0.044	0.023	0.13	< 0.0020	0.034	< 0.0020	< 0.020	0.029	0.011	< 0.012	No	No				
5272244	3-90 West Courtyard at 2nd Floor Level	2/21/2008	7:09 AM	2/22/2008	7:15 AM	1,446	5,133	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/23/2008	0.023	0.044	0.013	0.16	< 0.0020	0.018	< 0.0020	0.011	0.009	< 0.012	No	No					
5272248	4-Albany St 6th Floor Scaffolding	2/21/2008	7:31 AM	2/22/2008	7:39 AM	1,448	5,068	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/23/2008	0.015	0.042	0.012	0.12	< 0.0020	0.015	< 0.0020	< 0.008	0.008	< 0.012	No	No					
5272252	5-Washington St 6th Floor Scaffolding	2/21/2008	7:46 AM	2/22/2008	8:01 AM	1,466	4,987	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/23/2008	0.019	< 0.040	0.012	0.11	< 0.0020	0.015	< 0.0020	< 0.020	0.010	0.008	< 0.012	No	No				
5272256	6-Cedar St 6th Floor Scaffolding	2/21/2008	8:06 AM	2/22/2008	8:16 AM	1,449	4,999	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/23/2008	0.023	0.046	0.023	0.17	< 0.0020	0.026	< 0.0020	0.009	0.010	< 0.012	No	No					
5272260	7-Roof, East Facade	2/21/2008	7:07 AM	2/22/2008	7:19 AM	1,439	5,036	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/23/2008	0.013	0.040	0.012	0.12	< 0.0020	0.021	< 0.0020	0.022	0.014	0.008	< 0.012	No	No				
5272264	8-Roof, North Facade	2/21/2008	7:32 AM	2/22/2008	7:36 AM	1,444	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	Void due to power failure (cord found unplugged)			
5272270	3-90 West Courtyard at 2nd Floor Level	2/22/2008	7:02 AM	2/23/2008	7:10 AM	1,422	5,066	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/25/2008	0.013	0.044	0.012	0.12	< 0.0020	0.016	< 0.0020	0.014	0.008	< 0.012	No	No					
5272074	4-Albany St 6th Floor Scaffolding	2/22/2008	7:45 AM	2/23/2008	7:23 AM	1,418	4,963	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/25/2008	0.012	0.046	0.015	0.23	< 0.0020	0.022	< 0.0020	< 0.020	< 0.008	0.018	< 0.012	No	No				
5272078	5-Washington St 6th Floor Scaffolding	2/22/2008	8:06 AM	2/23/2008	7:35 AM	1,407	4,643	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/25/2008	0.009	0.044	0.014	0.12	< 0.0022	0.009	< 0.0022	< 0.009	0.011	< 0.013	No	No					
5272082	6-Cedar St 6th Floor Scaffolding	2/22/2008	8:26 AM	2/23/2008	7:49 AM	1,404	4,844	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/25/2008	0.014	0.046	0.016	0.14	< 0.0021	0.013	< 0.0021	0.021	0.019	< 0.012	No	No					
5272086	7-Roof, East Facade	2/22/2008	7:54 AM	2/23/2008	6:53 AM	1,409	4,973	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/25/2008	0.010	< 0.040	0.012	0.12	< 0.0020	0.013	< 0.0020	< 0.020	< 0.008	0.018	< 0.012	No	No				
5272090	8-Roof, North Facade	2/22/2008	7:41 AM	2/23/2008	7:29 AM	1,428	5,235	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/25/2008	0.010	< 0.038	0.016	0.13	< 0.0019	0.021	< 0.0019	< 0.019	0.011	0.018	< 0.012	No	No				
5272094	3-90 West Courtyard at 2nd Floor Level	2/23/2008	7:08 AM	2/24/2008	7:25 AM	1,467	5,098	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/26/2008	0.011	0.050	0.019	0.17	< 0.0020	0.018	< 0.0020	< 0.008	0.018	< 0.012	No	No					
5272000	4-Albany St 6th Floor Scaffolding	2/23/2008	7:26 AM	2/24/2008	8:21 AM	1,495	5,120	Metals	NICOSH 7300 Modified ICP-MS	R/LG Metals	2/26/2008	0.014	< 0.039	0.013	0.23													

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Mercury Concentration (ng/m ³)	EPA Site Specific Trigger Level for Mercury (ng/m ³)	Exceeds Target Air Quality or EPA Site Specific Level?	Comments
5272683	3 - 90 West Courtyard at 2nd Floor Level	2/17/2008	7:12 AM	2/18/2008	7:12 AM	1,440	576	Mercury	EPA 324/1631 mod.	BRL	02/19/2008	11	3000 ng/m ³	No	
5272687	4 - Albany St 6th Floor Scaffolding	2/17/2008	7:43 AM	2/18/2008	7:28 AM	1,425	570	Mercury	EPA 324/1631 mod.	BRL	02/19/2008	8	3000 ng/m ³	No	
5272691	5 - Washington St 6th Floor Scaffolding	2/17/2008	7:53 AM	2/18/2008	7:37 AM	1,424	577	Mercury	EPA 324/1631 mod.	BRL	02/19/2008	7	3000 ng/m ³	No	
5272699	6 - Cedar St 6th Floor Scaffolding	2/17/2008	8:03 AM	2/18/2008	7:47 AM	1,424	584	Mercury	EPA 324/1631 mod.	BRL	02/19/2008	12	3000 ng/m ³	No	
5272695	7 - Roof, East Facade	2/17/2008	7:30 AM	2/18/2008	7:02 AM	1,412	551	Mercury	EPA 324/1631 mod.	BRL	02/19/2008	7	3000 ng/m ³	No	
5272382	8 - Roof, North Facade	2/17/2008	7:57 AM	2/18/2008	7:39 AM	1,422	569	Mercury	EPA 324/1631 mod.	BRL	02/19/2008	9	3000 ng/m ³	No	
5272103	3 - 90 West Courtyard at 2nd Floor Level	2/18/2008	7:17 AM	2/19/2008	7:06 AM	1,429	593	Mercury	EPA 324/1631 mod.	BRL	02/20/2008	< 5	3000 ng/m ³	No	
5272107	4 - Albany St 6th Floor Scaffolding	2/18/2008	7:32 AM	2/19/2008	7:31 AM	1,439	576	Mercury	EPA 324/1631 mod.	BRL	02/20/2008	< 5	3000 ng/m ³	No	
5272111	5 - Washington St 6th Floor Scaffolding	2/18/2008	7:41 AM	2/19/2008	7:43 AM	1,442	570	Mercury	EPA 324/1631 mod.	BRL	02/20/2008	< 5	3000 ng/m ³	No	
5272115	6 - Cedar St 6th Floor Scaffolding	2/18/2008	7:51 AM	2/19/2008	8:00 AM	1,449	580	Mercury	EPA 324/1631 mod.	BRL	02/20/2008	< 5	3000 ng/m ³	No	
5272119	7 - Roof, East Facade	2/18/2008	7:10 AM	2/19/2008	6:59 AM	1,429	572	Mercury	EPA 324/1631 mod.	BRL	02/20/2008	< 5	3000 ng/m ³	No	
5272123	8 - Roof, North Facade	2/18/2008	7:46 AM	2/19/2008	7:26 AM	1,420	518	Mercury	EPA 324/1631 mod.	BRL	02/20/2008	< 6	3000 ng/m ³	No	
5272127	3 - 90 West Courtyard at 2nd Floor Level	2/19/2008	7:10 AM	2/20/2008	7:18 AM	1,448	558	Mercury	EPA 324/1631 mod.	BRL	02/21/2008	< 6	3000 ng/m ³	No	
5272028	4 - Albany St 6th Floor Scaffolding	2/19/2008	7:22 AM	2/20/2008	7:56 AM	1,474	582	Mercury	EPA 324/1631 mod.	BRL	02/21/2008	< 5	3000 ng/m ³	No	
5272131	4 - Albany St 6th Floor Scaffolding	2/19/2008	7:35 AM	2/20/2008	7:39 AM	1,444	570	Mercury	EPA 324/1631 mod.	BRL	02/21/2008	6	3000 ng/m ³	No	
5272135	5 - Washington St 6th Floor Scaffolding	2/19/2008	7:50 AM	2/20/2008	8:12 AM	1,462	563	Mercury	EPA 324/1631 mod.	BRL	02/21/2008	14	3000 ng/m ³	No	
5272139	6 - Cedar St 6th Floor Scaffolding	2/19/2008	8:07 AM	2/20/2008	8:25 AM	1,458	569	Mercury	EPA 324/1631 mod.	BRL	02/21/2008	< 5	3000 ng/m ³	No	
5272143	7 - Roof, East Facade	2/19/2008	7:06 AM	2/20/2008	6:52 AM	1,426	570	Mercury	EPA 324/1631 mod.	BRL	02/21/2008	< 5	3000 ng/m ³	No	
5272147	8 - Roof, North Facade	2/19/2008	7:35 AM	2/20/2008	7:23 AM	1,428	550	Mercury	EPA 324/1631 mod.	BRL	02/21/2008	< 6	3000 ng/m ³	No	
5272035	3 - 90 West Courtyard at 2nd Floor Level	2/20/2008	7:25 AM	2/21/2008	7:02 AM	1,417	567	Mercury	EPA 324/1631 mod.	BRL	02/22/2008	< 5	3000 ng/m ³	No	
5272047	4 - Albany St 6th Floor Scaffolding	2/20/2008	7:46 AM	N/A	N/A	N/A	N/A	Mercury	EPA 324/1631 mod.	BRL	N/A	N/A	N/A	N/A	Sample voided - power loss
5272051	5 - Washington St 6th Floor Scaffolding	2/20/2008	8:16 AM	2/21/2008	7:40 AM	1,404	562	Mercury	EPA 324/1631 mod.	BRL	02/22/2008	< 5	3000 ng/m ³	No	
5272055	6 - Cedar St 6th Floor Scaffolding	2/20/2008	8:30 AM	2/21/2008	8:00 AM	1,410	564	Mercury	EPA 324/1631 mod.	BRL	02/22/2008	< 5	3000 ng/m ³	No	
5272059	7 - Roof, East Facade	2/20/2008	7:00 AM	2/21/2008	7:16 AM	1,456	575	Mercury	EPA 324/1631 mod.	BRL	02/22/2008	< 5	3000 ng/m ³	No	
5272063	8 - Roof, North Facade	2/20/2008	7:32 AM	2/21/2008	7:27 AM	1,435	560	Mercury	EPA 324/1631 mod.	BRL	02/22/2008	< 6	3000 ng/m ³	No	
5272247	3 - 90 West Courtyard at 2nd Floor Level	2/21/2008	7:09 AM	2/22/2008	7:15 AM	1,446	571	Mercury	EPA 324/1631 mod.	BRL	02/23/2008	< 5	3000 ng/m ³	No	
5272251	4 - Albany St 6th Floor Scaffolding	2/21/2008	8:30 AM	N/A	N/A	N/A	N/A	Mercury	EPA 324/1631 mod.	BRL	N/A	N/A	N/A	N/A	Void due to flow fault on pump
5272255	5 - Washington St 6th Floor Scaffolding	2/21/2008	7:45 AM	2/22/2008	8:01 AM	1,456	582	Mercury	EPA 324/1631 mod.	BRL	02/23/2008	< 5	3000 ng/m ³	No	
5272259	6 - Cedar St 6th Floor Scaffolding	2/21/2008	8:06 AM	2/22/2008	8:15 AM	1,449	580	Mercury	EPA 324/1631 mod.	BRL	02/23/2008	6	3000 ng/m ³	No	
5272263	7 - Roof, East Facade	2/21/2008	7:20 AM	2/22/2008	7:19 AM	1,439	568	Mercury	EPA 324/1631 mod.	BRL	02/23/2008	< 5	3000 ng/m ³	No	
5272267	8 - Roof, North Facade	2/21/2008	7:32 AM	N/A	N/A	N/A	N/A	Mercury	EPA 324/1631 mod.	BRL	N/A	N/A	N/A	N/A	Void due to power failure [cord found unplugged]
5272073	3 - 90 West Courtyard at 2nd Floor Level	2/22/2008	7:22 AM	2/23/2008	7:04 AM	1,422	569	Mercury	EPA 324/1631 mod.	BRL	02/25/2008	< 5	3000 ng/m ³	No	
5272077	4 - Albany St 6th Floor Scaffolding	2/22/2008	8:21 AM	2/23/2008	7:23 AM	1,382	511	Mercury	EPA 324/1631 mod.	BRL	02/25/2008	< 6	3000 ng/m ³	No	
5272081	5 - Washington St 6th Floor Scaffolding	2/22/2008	8:08 AM	2/23/2008	7:35 AM	1,407	563	Mercury	EPA 324/1631 mod.	BRL	02/25/2008	< 5	3000 ng/m ³	No	
5272085	6 - Cedar St 6th Floor Scaffolding	2/22/2008	8:25 AM	2/23/2008	7:49 AM	1,404	562	Mercury	EPA 324/1631 mod.	BRL	02/25/2008	< 5	3000 ng/m ³	No	
5272099	7 - Roof, East Facade	2/22/2008	7:24 AM	2/23/2008	6:53 AM	1,409	550	Mercury	EPA 324/1631 mod.	BRL	02/25/2008	< 6	3000 ng/m ³	No	
5272093	8 - Roof, North Facade	2/22/2008	7:41 AM	2/23/2008	7:29 AM	1,428	571	Mercury	EPA 324/1631 mod.	BRL	02/25/2008	< 5	3000 ng/m ³	No	
5272097	3 - 90 West Courtyard at 2nd Floor Level	2/23/2008	7:08 AM	2/24/2008	7:35 AM	1,467	587	Mercury	EPA 324/1631 mod.	BRL	02/26/2008	< 5	3000 ng/m ³	No	
5272203	4 - Albany St 6th Floor Scaffolding	2/23/2008	7:26 AM	2/24/2008	8:21 AM	1,495	484	Mercury	EPA 324/1631 mod.	BRL	02/26/2008	< 495	3000 ng/m ³	No	
5272207	5 - Washington St 6th Floor Scaffolding	2/23/2008	7:39 AM	2/24/2008	8:30 AM	1,491	522	Mercury	EPA 324/1631 mod.	BRL	02/26/2008	< 6	3000 ng/m ³	No	
5272211	6 - Cedar St 6th Floor Scaffolding	2/23/2008	7:53 AM	2/24/2008	8:43 AM	1,490	596	Mercury	EPA 324/1631 mod.	BRL	02/26/2008	< 5	3000 ng/m ³	No	
5272215	7 - Roof, East Facade	2/23/2008	7:02 AM	2/24/2008	8:02 AM	1,500	578	Mercury	EPA 324/1631 mod.	BRL	02/26/2008	6	3000 ng/m ³	No	
5272219	8 - Roof, North Facade	2/23/2008	7:37 AM	2/24/2008	8:47 AM	1,510	604	Mercury	EPA 324/1631 mod.	BRL	02/26/2008	6	3000 ng/m ³	No	

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Asbestos Concentration (f/cc)	MMVF Concentration (f/cc)	EPA Site Specific Trigger Level	Exceeds EPA Site Specific Trigger Level?	Comments
5272682	3 - 90 West Courtyard at 2nd Floor Level	2/17/2008	7:12 AM	2/18/2008	7:12 AM	1,440	4,464	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/19/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272686	4 - Albany St 6th Floor Scaffolding	2/17/2008	7:43 AM	2/18/2008	7:28 AM	1,425	4,418	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/19/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272690	5 - Washington St 6th Floor Scaffolding	2/17/2008	7:53 AM	2/18/2008	7:37 AM	1,424	4,486	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/19/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272698	6 - Cedar St 6th Floor Scaffolding	2/17/2008	8:03 AM	2/18/2008	7:47 AM	1,424	4,414	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/19/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272694	7 - Roof, East Facade	2/17/2008	7:30 AM	2/18/2008	7:02 AM	1,412	4,637	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/19/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5272381	8 - Roof, North Facade	2/17/2008	7:34 AM	2/18/2008	7:39 AM	1,445	4,445	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/19/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272102	3 - 90 West Courtyard at 2nd Floor Level	2/18/2008	7:17 AM	2/19/2008	7:06 AM	1,429	4,216	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/20/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272106	4 - Albany St 6th Floor Scaffolding	2/18/2008	7:32 AM	2/19/2008	7:31 AM	1,439	4,173	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/20/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272110	5 - Washington St 6th Floor Scaffolding	2/18/2008	7:41 AM	2/19/2008	7:43 AM	1,442	4,290	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/20/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272114	6 - Cedar St 6th Floor Scaffolding	2/18/2008	7:51 AM	2/19/2008	8:00 AM	1,449	4,202	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/20/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272118	7 - Roof, East Facade	2/18/2008	7:10 AM	2/19/2008	6:59 AM	1,429	4,236	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/20/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272122	8 - Roof, North Facade	2/18/2008	7:46 AM	2/19/2008	7:26 AM	1,420	4,247	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/20/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272126	3 - 90 West Courtyard at 2nd Floor Level	2/19/2008	7:10 AM	2/20/2008	7:18 AM	1,448	4,308	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/21/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272027	4 - Albany St 6th Floor Scaffolding	2/19/2008	7:22 AM	2/20/2008	7:56 AM	1,474	4,496	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/21/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272130	4 - Albany St 6th Floor Scaffolding	2/19/2008	7:35 AM	2/20/2008	7:39 AM	1,444	4,188	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/21/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272134	5 - Washington St 6th Floor Scaffolding	2/19/2008	7:50 AM	2/20/2008	8:12 AM	1,462	4,313	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/21/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272138	6 - Cedar St 6th Floor Scaffolding	2/19/2008	8:07 AM	2/20/2008	8:25 AM	1,458	4,301	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/21/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272142	7 - Roof, East Facade	2/19/2008	7:06 AM	2/20/2008	6:52 AM	1,426	4,250	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/21/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272146	8 - Roof, North Facade	2/19/2008	7:35 AM	2/20/2008	7:23 AM	1,428	4,436	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/21/2008	<0.00005	0.00005	0.0009 f/cc	No	
5272034	3 - 90 West Courtyard at 2nd Floor Level	2/20/2008	7:25 AM	2/21/2008	7:02 AM	1,417	4,180	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272046	4 - Albany St 6th Floor Scaffolding	2/20/2008	7:46 AM	2/21/2008	7:25 AM	1,419	4,328	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272050	5 - Washington St 6th Floor Scaffolding	2/20/2008	8:16 AM	2/21/2008	7:40 AM	1,404	4,282	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272054	6 - Cedar St 6th Floor Scaffolding	2/20/2008	8:30 AM	2/21/2008	8:00 AM	1,410	4,230	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272058	7 - Roof, East Facade	2/20/2008	7:00 AM	2/21/2008	7:16 AM	1,456	4,466	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/22/2008	0.00005	<0.00005	0.0009 f/cc	No	
5272062	8 - Roof, North Facade	2/20/2008	7:32 AM	2/21/2008	7:27 AM	1,435	4,468	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/22/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272246	3 - 90 West Courtyard at 2nd Floor Level	2/21/2008	7:09 AM	2/22/2008	7:15 AM	1,446	4,266	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/23/2008	<0.00005	0.00005	0.0009 f/cc	No	
5272250	4 - Albany St 6th Floor Scaffolding	2/21/2008	7:31 AM	2/22/2008	7:39 AM	1,448	4,272	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/23/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272254	5 - Washington St 6th Floor Scaffolding	2/21/2008	7:45 AM	2/22/2008	8:01 AM	1,456	4,295	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/23/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272258	6 - Cedar St 6th Floor Scaffolding	2/21/2008	8:06 AM	2/22/2008	8:15 AM	1,449	4,275	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/23/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272262	7 - Roof, East Facade	2/21/2008	7:20 AM	2/22/2008	7:19 AM	1,439	4,454	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/23/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272266	8 - Roof, North Facade	2/21/2008	7:32 AM	N/A	N/A	N/A	N/A	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	N/A	N/A	N/A	0.0009 f/cc	N/A	Void due to power failure [cord found unplugged]
5272072	3 - 90 West Courtyard at 2nd Floor Level	2/22/2008	7:22 AM	2/23/2008	7:04 AM	1,422	4,159	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272076	4 - Albany St 6th Floor Scaffolding	2/22/2008	7:45 AM	2/23/2008	7:23 AM	1,418	4,183	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272080	5 - Washington St 6th Floor Scaffolding	2/22/2008	8:08 AM	2/23/2008	7:35 AM	1,407	4,186	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272084	6 - Cedar St 6th Floor Scaffolding	2/22/2008	8:25 AM	2/23/2008	7:49 AM	1,404	4,177	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272088	7 - Roof, East Facade	2/22/2008	7:24 AM	2/23/2008	6:53 AM	1,409	4,345	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272092	8 - Roof, North Facade	2/22/2008	7:41 AM	2/23/2008	7:29 AM	1,428	4,255	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272096	3 - 90 West Courtyard at 2nd Floor Level	2/23/2008	7:08 AM	2/24/2008	7:35 AM	1,467	4,328	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/26/2008	<0.00005	0.00005	0.0009 f/cc	No	
5272202	4 - Albany St 6th Floor Scaffolding	2/23/2008	7:26 AM	2/24/2008	8:21 AM	1,495	4,298	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/26/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272206	5 - Washington St 6th Floor Scaffolding	2/23/2008	7:39 AM	2/24/2008	8:30 AM	1,491	4,361	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/26/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5272210	6 - Cedar St 6th Floor Scaffolding	2/23/2008	7:53 AM	2/24/2008	8:43 AM	1,490	4,917	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/26/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5272214	7 - Roof, East Facade	2/23/2008	7:02 AM	2/24/2008	8:02 AM	1,500	4,619	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/26/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5272218	8 - Roof, North Facade	2/23/2008	7:37 AM	2/24/2008	8:47 AM	1,510	4,640	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	2/26/2008	<0.00004	<0.00004	0.0009 f/cc	No	

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab XRD	Lab Sample Receipt Date	Respirable Dust Concentration (mg/m ³)	Respirable Quartz Concentration (mg/m ³)	Target Air Quality Level for Respirable Quartz (mg/m ³)	EPA Site Specific Trigger Level for Respirable Quartz (mg/m ³)	Exceeds Target Air Quality or EPA Site Specific Levels?	Comments
5272661	3- 90 West Courtyard at 2nd Floor Level	2/17/2008	7:15 AM	2/18/2008	7:12 AM	1,440	3,744	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/19/2008	< 0.027	< 0.001	0.01	0.01	No	
5272665	4- Albany St 6th Floor Scaffolding	2/17/2008	7:43 AM	2/18/2008	7:28 AM	1,425	3,491	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/19/2008	< 0.029	< 0.001	0.01	0.01	No	
5272668	6- Washington St 6th Floor Scaffolding	2/17/2008	7:53 AM	2/18/2008	7:37 AM	1,424	3,631	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/19/2008	< 0.028	< 0.001	0.01	0.01	No	
5272667	6- Cedar St 6th Floor Scaffolding	2/17/2008	8:03 AM	2/18/2008	7:47 AM	1,424	3,774	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/19/2008	< 0.028	< 0.001	0.01	0.01	No	
5272663	7- Roof, East Facade	2/17/2008	7:30 AM	2/18/2008	7:02 AM	1,412	3,671	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/19/2008	< 0.027	< 0.001	0.01	0.01	No	
5272380	8- Roof, North Facade	2/17/2008	7:57 AM	2/18/2008	7:39 AM	1,422	3,768	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/19/2008	< 0.027	< 0.001	0.01	0.01	No	
5272101	3- 90 West Courtyard at 2nd Floor Level	2/19/2008	7:17 AM	2/19/2008	7:06 AM	1,429	3,430	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/20/2008	< 0.029	< 0.001	0.01	0.01	No	
5272105	4- Albany St 6th Floor Scaffolding	2/19/2008	7:32 AM	2/19/2008	7:31 AM	1,439	3,454	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/20/2008	< 0.028	< 0.001	0.01	0.01	No	
5272109	5- Washington St 6th Floor Scaffolding	2/19/2008	7:41 AM	2/19/2008	7:43 AM	1,442	3,461	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/20/2008	< 0.029	< 0.001	0.01	0.01	No	
5272113	6- Cedar St 6th Floor Scaffolding	2/19/2008	7:51 AM	2/19/2008	8:00 AM	1,449	3,478	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/20/2008	< 0.029	< 0.001	0.01	0.01	No	
5272117	7- Roof, East Facade	2/19/2008	7:10 AM	2/19/2008	6:59 AM	1,429	3,430	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/20/2008	< 0.029	< 0.001	0.01	0.01	No	
5272121	8- Roof, North Facade	2/19/2008	7:49 AM	2/19/2008	7:29 AM	1,420	3,479	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/20/2008	< 0.029	< 0.001	0.01	0.01	No	
5272125	3- 90 West Courtyard at 2nd Floor Level	2/19/2008	7:10 AM	2/20/2008	7:18 AM	1,448	3,475	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/21/2008	< 0.029	< 0.001	0.01	0.01	No	
5272026	4- Albany St 6th Floor Scaffolding	2/19/2008	7:22 AM	2/20/2008	7:59 AM	1,477	3,693	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/21/2008	< 0.027	< 0.001	0.01	0.01	No	
5272129	4- Albany St 6th Floor Scaffolding	2/19/2008	7:35 AM	2/20/2008	7:39 AM	1,444	3,393	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/21/2008	< 0.029	< 0.001	0.01	0.01	No	
5272133	5- Washington St 6th Floor Scaffolding	2/19/2008	7:50 AM	2/20/2008	8:12 AM	1,462	3,582	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/21/2008	< 0.028	< 0.001	0.01	0.01	No	
5272137	6- Cedar St 6th Floor Scaffolding	2/19/2008	8:07 AM	2/20/2008	8:25 AM	1,458	3,572	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/21/2008	< 0.028	< 0.001	0.01	0.01	No	
5272141	7- Roof, East Facade	2/19/2008	7:08 AM	2/20/2008	6:52 AM	1,426	3,494	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/21/2008	< 0.028	< 0.001	0.01	0.01	No	
5272145	8- Roof, North Facade	2/19/2008	7:35 AM	2/20/2008	7:23 AM	1,428	3,534	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/21/2008	< 0.028	< 0.001	0.01	0.01	No	
5272033	3- 90 West Courtyard at 2nd Floor Level	2/20/2008	7:25 AM	2/21/2008	7:02 AM	1,417	3,543	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/22/2008	< 0.028	< 0.001	0.01	0.01	No	
5272045	4- Albany St 6th Floor Scaffolding	2/20/2008	7:46 AM	2/21/2008	7:25 AM	1,419	3,477	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/22/2008	< 0.029	< 0.001	0.01	0.01	No	
5272049	5- Washington St 6th Floor Scaffolding	2/20/2008	8:16 AM	2/21/2008	7:40 AM	1,404	3,696	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/22/2008	< 0.027	< 0.001	0.01	0.01	No	
5272053	6- Cedar St 6th Floor Scaffolding	2/20/2008	8:30 AM	2/21/2008	8:00 AM	1,410	3,560	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/22/2008	< 0.028	< 0.001	0.01	0.01	No	
5272057	7- Roof, East Facade	2/20/2008	7:00 AM	2/21/2008	7:15 AM	1,456	3,713	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/22/2008	< 0.027	< 0.001	0.01	0.01	No	
5272061	8- Roof, North Facade	2/20/2008	7:32 AM	2/21/2008	7:27 AM	1,435	4,426	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/22/2008	< 0.023	< 0.001	0.01	0.01	No	
5272245	3- 90 West Courtyard at 2nd Floor Level	2/21/2008	7:09 AM	2/22/2008	7:16 AM	1,446	3,667	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/23/2008	< 0.027	< 0.001	0.01	0.01	No	
5272249	4- Albany St 6th Floor Scaffolding	2/21/2008	7:31 AM	2/22/2008	7:39 AM	1,448	3,475	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/23/2008	< 0.029	< 0.001	0.01	0.01	No	
5272253	5- Washington St 6th Floor Scaffolding	2/21/2008	7:45 AM	2/22/2008	8:01 AM	1,456	3,640	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/23/2008	< 0.027	< 0.001	0.01	0.01	No	
5272257	6- Cedar St 6th Floor Scaffolding	2/21/2008	8:06 AM	2/22/2008	8:15 AM	1,449	3,623	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/23/2008	< 0.028	< 0.001	0.01	0.01	No	
5272261	7- Roof, East Facade	2/21/2008	7:20 AM	2/22/2008	7:19 AM	1,439	3,598	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/23/2008	< 0.028	< 0.001	0.01	0.01	No	
5272265	8- Roof, North Facade	2/21/2008	N/A	N/A	N/A	N/A	N/A	Dust and Quartz	NIOSH 06007500	R/LG XRD	N/A	N/A	N/A	N/A	N/A	Sample voided due to power failure (cord found unplugged)	
5272071	3- 90 West Courtyard at 2nd Floor Level	2/22/2008	7:32 AM	2/23/2008	7:04 AM	1,422	3,655	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5272075	4- Albany St 6th Floor Scaffolding	2/22/2008	7:45 AM	2/23/2008	7:23 AM	1,418	3,545	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5272079	5- Washington St 6th Floor Scaffolding	2/22/2008	8:08 AM	2/23/2008	7:35 AM	1,407	3,516	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5272083	6- Cedar St 6th Floor Scaffolding	2/22/2008	8:25 AM	2/23/2008	7:49 AM	1,404	3,510	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5272087	7- Roof, East Facade	2/22/2008	7:24 AM	2/23/2008	6:53 AM	1,409	3,523	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5272091	8- Roof, North Facade	2/22/2008	7:41 AM	2/23/2008	7:29 AM	1,428	3,570	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5272095	3- 90 West Courtyard at 2nd Floor Level	2/23/2008	7:09 AM	2/24/2008	7:35 AM	1,467	3,668	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/26/2008	< 0.027	< 0.001	0.01	0.01	No	
5272201	4- Albany St 6th Floor Scaffolding	2/23/2008	7:26 AM	2/24/2008	8:21 AM	1,495	3,513	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/26/2008	< 0.028	< 0.001	0.01	0.01	No	
5272205	5- Washington St 6th Floor Scaffolding	2/23/2008	7:39 AM	2/24/2008	8:30 AM	1,491	3,653	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/26/2008	< 0.027	< 0.001	0.01	0.01	No	
5272209	6- Cedar St 6th Floor Scaffolding	2/23/2008	7:50 AM	2/24/2008	8:43 AM	1,460	3,725	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/26/2008	< 0.027	< 0.001	0.01	0.01	No	
5272213	7- Roof, East Facade	2/23/2008	7:02 AM	2/24/2008	8:02 AM	1,500	3,750	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/26/2008	< 0.027	< 0.001	0.01	0.01	No	
5272217	8- Roof, North Facade	2/23/2008	7:37 AM	2/24/2008	8:47 AM	1,510	3,775	Dust and Quartz	NIOSH 06007500	R/LG XRD	2/26/2008	< 0.026	< 0.001	0.01	0.01	No	


MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM _{2.5} Avg. Concentration (µg/m ³)	EPA Site Specific Trigger Level for PM _{2.5} (µg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	17	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	23	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	21	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	18	65	No	
N/A	7 - Roof, East	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	17	65	No	
N/A	8 - Roof, North	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	13	65	No	
N/A	3 - Courtyard, 2nd Floor Level	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	14	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	20	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	20	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	18	65	No	
N/A	7 - Roof, East	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	13	65	No	
N/A	8 - Roof, North	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	14	65	No	
N/A	3 - Courtyard, 2nd Floor Level	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	11	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,210	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	12	65	No	Instrument off-line for portion of day, conc. is not a 24hr. avg.
N/A	5 - Washington St 6th Floor Level Scaffolding	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	11	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	13	65	No	
N/A	7 - Roof, East	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	12	65	No	
N/A	8 - Roof, North	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	12	65	No	
N/A	3 - Courtyard, 2nd Floor Level	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	11	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	10	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	11	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	14	65	No	
N/A	7 - Roof, East	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	10	65	No	
N/A	8 - Roof, North	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	12	65	No	
N/A	3 - Courtyard, 2nd Floor Level	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	12	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	10	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	10	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	12	65	No	
N/A	7 - Roof, East	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	9	65	No	
N/A	8 - Roof, North	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	15	65	No	
N/A	3 - Courtyard, 2nd Floor Level	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	16	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	19	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	18	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	20	65	No	
N/A	7 - Roof, East	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	15	65	No	
N/A	8 - Roof, North	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	22	65	No	
N/A	3 - Courtyard, 2nd Floor Level	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	15	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	18	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	18	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	19	65	No	
N/A	7 - Roof, East	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	18	65	No	
N/A	8 - Roof, North	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	21	65	No	

MasterWorks - 130 Cedar Building, Community Monitoring														
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM ₁₀ Avg. Concentration (µg/m ³)	EPA Site Specific Trigger Level for PM ₁₀ (µg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	25	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	23	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	30	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	33	150	No	
N/A	7 - Roof, East	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	29	150	No	
N/A	8 - Roof, North	2/17/2008	12:00 AM	2/18/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	23	150	No	
N/A	3 - Courtyard, 2nd Floor Level	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	26	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	24	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	34	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	27	150	No	
N/A	7 - Roof, East	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	29	150	No	
N/A	8 - Roof, North	2/18/2008	12:00 AM	2/19/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	31	150	No	
N/A	3 - Courtyard, 2nd Floor Level	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	13	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	13	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	14	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	17	150	No	
N/A	7 - Roof, East	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	15	150	No	
N/A	8 - Roof, North	2/19/2008	12:00 AM	2/20/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	15	150	No	
N/A	3 - Courtyard, 2nd Floor Level	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	13	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	12	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	14	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	17	150	No	
N/A	7 - Roof, East	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	14	150	No	
N/A	8 - Roof, North	2/20/2008	12:00 AM	2/21/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	15	150	No	
N/A	3 - Courtyard, 2nd Floor Level	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	11	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	12	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	13	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	14	150	No	
N/A	7 - Roof, East	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	12	150	No	
N/A	8 - Roof, North	2/21/2008	12:00 AM	2/22/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	13	150	No	
N/A	3 - Courtyard, 2nd Floor Level	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	27	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	27	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	25	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	35	150	No	
N/A	7 - Roof, East	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	37	150	No	
N/A	8 - Roof, North	2/22/2008	12:00 AM	2/23/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	66	150	No	
N/A	3 - Courtyard, 2nd Floor Level	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	30	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	25	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	22	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	33	150	No	
N/A	7 - Roof, East	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	28	150	No	
N/A	8 - Roof, North	2/23/2008	12:00 AM	2/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	36	150	No	

350 Hochberg Road, Monroeville, PA 15146
 Phone: (724) 325-1776 Fax: (724) 733-1799

Mercury Vapor (Hg^0) Air Results for Outdoor Community
 Monitoring Stations by Location as recorded by the Lumex Analyzer

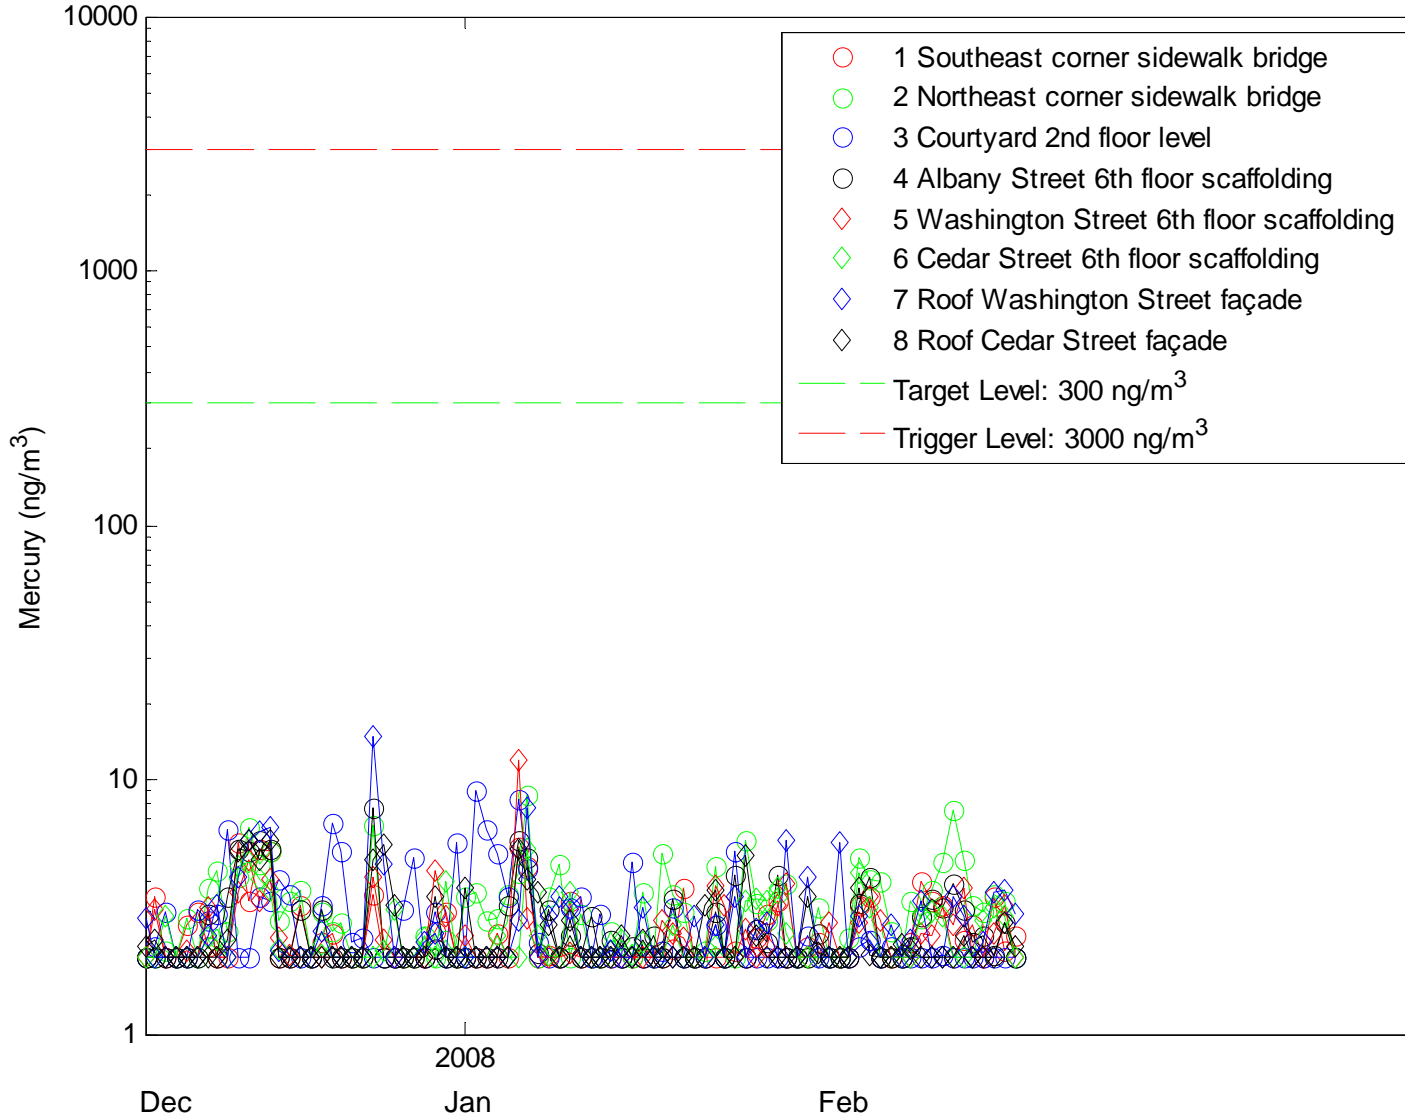

Report Summary

Air Mercury Results (Hg⁰, ng/m³) as recorded by the Lumex RA915+ analyzer
Week of 02/17/08 to 02/23/08

Date	Mercury (Hg ⁰) ng/m ³ 30-sec readings	1 Southeast corner sidewalk bridge	2 Northeast corner sidewalk bridge	3 Courtyard 2nd floor level	4 Albany Street 6th floor scaffolding	5 Washington Street 6th floor scaffolding	6 Cedar Street 6th floor scaffolding	7 Roof Washington Street façade	8 Roof Cedar Street façade
17-Feb-08	# Samples	9	9	9	9	9	9	9	9
	Average	2	8	2	4	3	2	3	2
	Maximum	2	8	2	5	3	2	5	2
18-Feb-08	# Samples	18	18	18	18	18	18	18	18
	Average	2	5	2	3	4	2	3	2
	Maximum	4	10	2	6	8	3	6	3
19-Feb-08	# Samples	36	36	36	36	36	36	36	36
	Average	3	3	2	2	2	2	2	2
	Maximum	4	5	4	4	3	4	3	4
20-Feb-08	# Samples	36	36	36	36	36	36	36	36
	Average	2	3	2	2	2	3	2	2
	Maximum	3	5	2	4	2	6	3	3
21-Feb-08	# Samples	36	36	36	36	36	36	36	36
	Average	3	4	2	2	3	3	4	2
	Maximum	5	6	3	5	6	5	9	3
22-Feb-08	# Samples	36	36	27	36	36	36	36	36
	Average	2	3	2	3	3	3	4	3
	Maximum	3	4	3	5	5	5	9	4
23-Feb-08	# Samples	18	18	18	18	18	18	18	18
	Average	2	2	2	2	2	2	3	2
	Maximum	5	2	2	3	3	4	6	3