

MasterWorks - 130 Cedar Building, Community Monitoring										Total Structure Count		Asbestos < 5 µm		Asbestos ≥ 5 µm		Result (µm/m)		Concentration (B/C)		EPA Site Specific Trigger Level		Exceeds EPA Site Specific Trigger Level?		Comments
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Time (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	All Asbestos	Charryotic	Amphibole	< 5 µm	≥ 5 µm	µm/m	B/C	Trigger Level	Trigger Level	Trigger Level	Trigger Level	Trigger Level	Comments
5275244	3-90 West Courtyard at 2nd Floor Level	3/23/2008	7:17 AM	3/23/2008	11:33 AM	234	1,369	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275245	4- Albany St 6th Floor Scalloffing	3/23/2008	7:33 AM	3/23/2008	11:33 AM	240	1,440	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275246	5- Washington St 6th Floor Scalloffing	3/23/2008	7:33 AM	3/23/2008	11:33 AM	239	1,435	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 7.5	< 0.020	70 µm/m2	No			
5275247	6- Cedar St 6th Floor Scalloffing	3/23/2008	7:38 AM	3/23/2008	11:37 AM	239	1,435	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 7.5	< 0.020	70 µm/m2	No			
5275248	7- Roof, East Facade	3/23/2008	7:48 AM	3/23/2008	11:37 AM	229	1,351	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 6.7	< 0.019	70 µm/m2	No			
5275249	8- Roof, North Facade	3/23/2008	7:51 AM	3/23/2008	11:32 AM	227	1,363	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 6.7	< 0.019	70 µm/m2	No			
5275250	9- 90 West Courtyard at 2nd Floor Level	3/23/2008	7:47 AM	3/23/2008	11:32 AM	240	1,440	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275251	4- Albany St 6th Floor Scalloffing	3/23/2008	7:36 AM	3/23/2008	11:33 AM	241	1,448	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 6.7	< 0.019	70 µm/m2	No			
5275252	5- Washington St 6th Floor Scalloffing	3/24/2008	7:36 AM	3/24/2008	11:34 PM	487	1,729	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 8.7	< 0.019	70 µm/m2	No			
5275253	6- Cedar St 6th Floor Scalloffing	3/24/2008	7:38 AM	3/24/2008	11:34 PM	473	1,639	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275257	7- Roof, East Facade	3/23/2008	7:26 AM	3/23/2008	11:32 PM	484	1,646	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 8.7	< 0.019	70 µm/m2	No			
5275258	8- Roof, North Facade	3/24/2008	7:29 AM	3/24/2008	11:33 PM	484	1,694	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 8.7	< 0.020	70 µm/m2	No			
5275259	9- 90 West Courtyard at 2nd Floor Level	3/24/2008	7:27 AM	3/24/2008	11:33 PM	429	1,502	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/25/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275260	4- Albany St 6th Floor Scalloffing	3/24/2008	7:33 PM	3/24/2008	11:11 PM	449	1,548	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 7.5	< 0.020	70 µm/m2	No			
5275261	5- Washington St 6th Floor Scalloffing	3/24/2008	7:34 PM	3/24/2008	11:12 PM	472	1,594	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275262	6- Cedar St 6th Floor Scalloffing	3/24/2008	7:38 PM	3/24/2008	11:12 PM	479	1,679	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275263	7- Roof, East Facade	3/24/2008	7:32 PM	3/24/2008	11:14 PM	472	1,652	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	3	3	0	2	1	24.3	0.057	70 µm/m2	No				
5275264	8- Roof, North Facade	3/24/2008	7:33 PM	3/24/2008	11:23 PM	470	1,622	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275265	9- 90 West Courtyard at 2nd Floor Level	3/25/2008	7:37 AM	3/25/2008	11:08 PM	469	1,635	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275266	4- Albany St 6th Floor Scalloffing	3/25/2008	7:29 AM	3/25/2008	11:09 PM	470	1,692	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.7	< 0.020	70 µm/m2	No			
5275267	4- Albany St 6th Floor Scalloffing	3/25/2008	7:48 AM	3/25/2008	11:09 PM	453	1,563	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275268	5- Washington St 6th Floor Scalloffing	3/25/2008	7:43 AM	3/25/2008	11:07 PM	470	1,687	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275269	6- Cedar St 6th Floor Scalloffing	3/25/2008	7:34 AM	3/25/2008	11:07 PM	463	1,583	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	2	2	0	2	0	16.2	0.037	70 µm/m2	No				
5275270	7- Roof, East Facade	3/25/2008	7:25 AM	3/25/2008	11:12 PM	467	1,635	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275271	8- Roof, North Facade	3/25/2008	7:25 AM	3/25/2008	11:12 PM	467	1,635	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/26/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275272	9- 90 West Courtyard at 2nd Floor Level	3/25/2008	7:26 PM	3/25/2008	11:07 PM	461	1,607	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275262	4- Albany St 6th Floor Scalloffing	3/25/2008	7:31 PM	3/25/2008	11:08 PM	469	1,642	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275263	5- Washington St 6th Floor Scalloffing	3/25/2008	7:30 PM	3/25/2008	11:08 PM	469	1,638	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275264	6- Cedar St 6th Floor Scalloffing	3/25/2008	7:32 PM	3/25/2008	11:07 PM	469	1,659	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275265	7- Roof, East Facade	3/25/2008	7:11 PM	3/25/2008	11:13 PM	481	1,684	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	1	1	0	0	1	8.7	0.020	70 µm/m2	No				
5275266	8- Roof, North Facade	3/25/2008	7:14 PM	3/25/2008	11:12 PM	478	1,673	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275267	9- 90 West Courtyard at 2nd Floor Level	3/26/2008	7:47 AM	3/26/2008	11:06 PM	473	1,653	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	1	0	0	0	1	8.1	0.019	70 µm/m2	No				
5275268	4- Albany St 6th Floor Scalloffing	3/26/2008	7:31 AM	3/26/2008	11:08 PM	487	1,729	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.7	< 0.019	70 µm/m2	No			
5275269	5- Washington St 6th Floor Scalloffing	3/26/2008	7:38 AM	3/26/2008	11:06 PM	482	1,667	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	1	0	0	0	1	8.7	0.020	70 µm/m2	No				
5275270	6- Cedar St 6th Floor Scalloffing	3/26/2008	7:42 AM	3/26/2008	11:07 PM	474	1,659	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275269	7- Roof, East Facade	3/26/2008	7:24 AM	3/26/2008	11:03 PM	487	1,656	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275270	8- Roof, North Facade	3/26/2008	7:24 AM	3/26/2008	11:03 PM	488	1,757	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/27/2008	0	0	0	0	0	0	< 8.7	< 0.019	70 µm/m2	No			
5275271	9- 90 West Courtyard at 2nd Floor Level	3/26/2008	7:46 PM	3/26/2008	11:00 PM	434	1,519	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/28/2008	0	0	0	0	0	0	< 7.5	< 0.019	70 µm/m2	No			
5275272	4- Albany St 6th Floor Scalloffing	3/26/2008	7:38 PM	3/26/2008	11:13 PM	455	1,593	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/28/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275273	5- Washington St 6th Floor Scalloffing	3/26/2008	7:40 PM	3/26/2008	11:14 PM	454	1,589	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/28/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275274	6- Cedar St 6th Floor Scalloffing	3/26/2008	7:36 PM	3/26/2008	11:09 PM	453	1,563	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/28/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No			
5275275	7- Roof, East Facade	3/26/2008	7:31 PM	3/26/2008	11:24 PM	474	1,659	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/28/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275268	8- Roof, North Facade	3/26/2008	7:32 PM	3/26/2008	11:24 PM	472	1,629	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/28/2008	0	0	0	0	0	0	< 8.1	< 0.019	70 µm/m2	No			
5275276	9- 90 West Courtyard at 2nd Floor Level	3/27/2008	7:46 AM	3/27/2008	11:05 PM	454	1,566	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	3/28/2008	0	0	0	0	0	0	< 8.1	< 0.020	70 µm/m2	No	</		

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	Target Air Quality Levels														Exceeds Target Air Quality Levels	Exceeds EPA Site Specific Trigger Levels	Comments								
												Barium Concentration (µg/m³)		Chromium Concentration (µg/m³)		Manganese Concentration (µg/m³)		Zinc Concentration (µg/m³)		Beryllium Concentration (µg/m³)		Copper Concentration (µg/m³)		Mercury Particulate Concentration (µg/m³)					Cadmium Concentration (µg/m³)		Lead Concentration (µg/m³)		Nickel Concentration (µg/m³)		Antimony Concentration (µg/m³)	
												0.60	0.60	0.30	18.00	0.80	18.00	0.80	18.00	0.20	180.00	0.30	180.00	3.00	3.00				0.20	0.20	5.00	28.00	1.00	0.30	0.30	0.30
0279948	3 - 90 West Courtyard at 2nd Floor Level	3/23/2008	7:34 AM	3/24/2008	7:12 AM	1,418	5,024	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/25/2008	0.014	< 0.040	0.010	0.11	< 0.0020	0.018	< 0.0020	< 0.0020	< 0.0020	< 0.008	0.016	< 0.012	No	No											
0279952	4 - Albany St 6th Floor Scalloping	3/23/2008	7:50 AM	3/24/2008	7:28 AM	1,403	4,787	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/25/2008	0.024	0.046	0.012	0.12	< 0.0021	0.000	< 0.0021	< 0.0021	< 0.0021	< 0.008	0.016	< 0.012	No	No											
0279956	5 - Washington St 6th Floor Scalloping	3/23/2008	8:01 AM	3/24/2008	7:52 AM	1,431	5,029	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/25/2008	0.018	< 0.040	0.009	0.12	< 0.0020	0.017	< 0.0020	< 0.0020	< 0.0020	< 0.008	0.013	< 0.012	No	No											
0279960	6 - Cedar St 6th Floor Scalloping	3/23/2008	7:48 AM	3/24/2008	7:25 AM	1,415	5,108	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/25/2008	0.018	< 0.039	0.009	0.12	< 0.0020	0.014	< 0.0020	< 0.0020	< 0.0020	< 0.008	0.012	< 0.012	No	No											
0279964	7 - Roof East Facade	3/23/2008	7:28 AM	3/24/2008	7:20 AM	1,432	5,105	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/25/2008	0.019	< 0.039	0.008	0.12	< 0.0021	0.013	< 0.0021	< 0.0021	< 0.0021	< 0.008	0.011	< 0.012	No	No											
0279968	8 - Roof North Facade	3/23/2008	8:50 AM	3/24/2008	7:31 AM	1,361	4,816	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/25/2008	0.017	0.052	0.010	0.11	< 0.0021	0.018	< 0.0021	< 0.0021	< 0.0021	< 0.008	0.014	< 0.012	No	No											
0279970	1 - 90 West Courtyard at 2nd Floor Level	3/24/2008	7:14 AM	3/25/2008	7:56 AM	1,430	5,005	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/26/2008	0.006	< 0.040	0.022	0.16	< 0.0020	0.000	< 0.0020	< 0.0020	< 0.0020	< 0.008	0.017	< 0.012	No	No											
0279978	4 - Albany St 6th Floor Scalloping	3/24/2008	7:38 AM	3/25/2008	7:41 AM	1,442	4,875	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/26/2008	0.040	< 0.040	0.022	0.16	< 0.0020	0.032	< 0.0020	< 0.0020	< 0.0020	0.015	0.018	< 0.012	No	No											
0279974	5 - Washington St 6th Floor Scalloping	3/24/2008	7:56 AM	3/25/2008	7:56 AM	1,426	5,100	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/26/2008	0.008	< 0.039	0.003	0.16	< 0.0020	0.003	< 0.0020	< 0.0020	< 0.0020	0.017	0.017	< 0.012	No	No											
0279978	6 - Cedar St 6th Floor Scalloping	3/24/2008	7:28 AM	3/25/2008	7:18 AM	1,420	5,005	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/26/2008	0.033	0.042	0.020	0.09	< 0.0020	0.000	< 0.0020	< 0.0020	< 0.0020	0.015	0.022	< 0.012	No	No											
0279984	7 - Roof East Facade	3/24/2008	7:24 AM	3/25/2008	7:42 AM	1,408	5,065	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/26/2008	0.062	0.041	0.052	0.17	< 0.0020	0.192	< 0.0020	< 0.0020	< 0.0020	0.031	0.036	< 0.012	No	No											
0279982	8 - Roof North Facade	3/24/2008	8:40 AM	3/25/2008	8:09 AM	1,406	5,102	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/26/2008	0.036	0.043	0.027	0.13	< 0.0020	0.074	< 0.0020	< 0.0020	< 0.0020	0.030	0.018	< 0.012	No	No											
0279970	3 - 90 West Courtyard at 2nd Floor Level	3/25/2008	7:08 AM	3/26/2008	7:20 AM	1,452	4,873	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/27/2008	0.023	0.054	0.018	0.11	< 0.0020	0.026	< 0.0020	< 0.0020	< 0.0020	0.026	0.011	< 0.012	No	No											
0279986	4 - Albany St 6th Floor Scalloping	3/25/2008	7:48 AM	3/26/2008	7:47 AM	1,443	4,867	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/27/2008	0.006	0.065	0.019	0.10	< 0.0021	0.007	< 0.0021	< 0.0021	< 0.0021	0.016	0.013	< 0.012	No	No											
0279978	4 - Albany St 6th Floor Scalloping	3/25/2008	7:38 AM	3/26/2008	7:59 AM	1,444	4,721	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/27/2008	0.027	0.047	0.018	0.08	< 0.0021	0.024	< 0.0021	< 0.0021	< 0.0021	0.012	0.011	< 0.012	No	No											
0279974	5 - Washington St 6th Floor Scalloping	3/25/2008	7:54 AM	3/26/2008	8:06 AM	1,461	4,833	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/27/2008	0.032	0.058	0.020	0.10	< 0.0020	0.070	< 0.0020	< 0.0020	< 0.0020	0.030	0.012	< 0.012	No	No											
0279982	6 - Cedar St 6th Floor Scalloping	3/25/2008	7:22 AM	3/26/2008	8:21 AM	1,499	5,172	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/27/2008	0.012	< 0.039	0.008	0.12	< 0.0021	0.000	< 0.0021	< 0.0021	< 0.0021	0.020	0.014	< 0.012	No	No											
0279978	7 - Roof East Facade	3/25/2008	7:47 AM	3/26/2008	8:48 AM	1,381	4,891	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/27/2008	0.047	0.046	0.045	0.12	< 0.0020	0.123	< 0.0020	< 0.0020	< 0.0020	0.038	0.018	< 0.012	No	No											
0279980	8 - Roof North Facade	3/25/2008	8:10 AM	3/26/2008	7:17 AM	1,397	4,787	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/27/2008	0.028	0.049	0.028	0.10	< 0.0021	0.063	< 0.0021	< 0.0021	< 0.0021	0.043	0.013	< 0.012	No	No											
0279987	1 - 90 West Courtyard at 2nd Floor Level	3/26/2008	7:24 AM	3/27/2008	7:05 AM	1,421	5,045	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/28/2008	0.029	0.067	0.026	0.11	< 0.0020	0.034	< 0.0020	< 0.0020	< 0.0020	0.038	0.008	< 0.012	No	No											
0279970	4 - Albany St 6th Floor Scalloping	3/26/2008	7:52 AM	3/27/2008	8:04 AM	1,452	4,937	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/28/2008	0.030	0.059	0.020	0.09	< 0.0020	0.021	< 0.0020	< 0.0020	< 0.0020	0.017	0.008	< 0.012	No	No											
0279989	5 - Washington St 6th Floor Scalloping	3/26/2008	8:10 AM	3/27/2008	8:14 AM	1,444	5,271	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/28/2008	0.024	0.056	0.019	0.10	< 0.0021	0.020	< 0.0021	< 0.0021	< 0.0021	0.017	0.008	< 0.012	No	No											
0279974	6 - Cedar St 6th Floor Scalloping	3/26/2008	8:28 AM	3/27/2008	7:36 AM	1,390	5,034	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/28/2008	0.033	0.048	0.040	0.13	< 0.0020	0.028	< 0.0020	< 0.0020	< 0.0020	0.021	0.009	< 0.012	No	No											
0279989	8 - Roof North Facade	3/26/2008	7:24 AM	3/27/2008	7:29 AM	1,444	4,725	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/28/2008	0.031	0.070	0.026	0.10	< 0.0021	0.048	< 0.0021	< 0.0021	< 0.0021	0.033	0.009	< 0.012	No	No											
0279985	3 - 90 West Courtyard at 2nd Floor Level	3/27/2008	7:10 AM	3/28/2008	7:11 AM	1,441	5,118	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/29/2008	0.042	0.057	0.020	0.19	< 0.0020	0.043	< 0.0020	< 0.0020	< 0.0020	0.017	0.017	< 0.012	No	No											
0279983	4 - Albany St 6th Floor Scalloping	3/27/2008	8:08 AM	3/28/2008	7:50 AM	1,422	4,862	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/29/2008	0.011	0.061	0.018	0.11	< 0.0020	0.043	< 0.0020	< 0.0020	< 0.0020	0.012	0.018	< 0.012	No	No											
0279977	5 - Washington St 6th Floor Scalloping	3/27/2008	8:17 AM	3/28/2008	8:01 AM	1,424	4,913	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/29/2008	0.046	0.042	0.020	0.11	< 0.0020	0.041	< 0.0020	< 0.0020	< 0.0020	0.019	0.017	< 0.012	No	No											
0279981	6 - Cedar St 6th Floor Scalloping	3/27/2008	7:41 AM	3/28/2008	7:33 AM	1,432	4,896	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/29/2008	0.050	0.059	0.026	0.11	< 0.0020	0.048	< 0.0020	< 0.0020	< 0.0020	0.016	0.019	< 0.012	No	No											
0279978	7 - Roof East Facade	3/27/2008	7:38 AM	3/28/2008	7:26 AM	1,448	5,069	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/29/2008	0.056	0.056	0.025	0.14	< 0.0020	0.106	< 0.0020	< 0.0020	< 0.0020	0.045	0.019	< 0.012	No	No											
0279972	8 - Roof North Facade	3/27/2008	7:13 AM	3/28/2008	7:48 AM	1,405	4,904	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/29/2008	0.042	0.066	0.023	0.12	< 0.0021	0.068	< 0.0021	< 0.0021	< 0.0021	0.021	0.019	< 0.012	No	No											
0279970	1 - 90 West Courtyard at 2nd Floor Level	3/28/2008	7:13 AM	3/29/2008	7:13 AM	1,438	4,745	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/31/2008	0.024	0.057	0.016	0.10	< 0.0021	0.046	< 0.0021	< 0.0021	< 0.0021	0.012	0.011	< 0.012	No	No											
0279973	4 - Albany St 6th Floor Scalloping	3/28/2008	7:54 AM	3/29/2008	8:11 AM	1,457	5,100	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/31/2008	0.025	0.052	0.017	0.09	< 0.0020	0.097	< 0.0020	< 0.0020	< 0.0020	0.011	0.022	< 0.012	No	No											
0279978	5 - Washington St 6th Floor Scalloping	3/28/2008	8:18 AM	3/29/2008	8:11 AM	1,456	5,020	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/31/2008	0.025	0.060	0.017	0.12	< 0.0020	0.012	< 0.0020	< 0.0020	< 0.0020	0.018	0.011	< 0.012	No	No											
0279981	6 - Cedar St 6th Floor Scalloping	3/28/2008	7:49 AM	3/29/2008	7:46 AM	1,449	4,837	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/31/2008	0.022	< 0.043	0.017	0.11	< 0.0022	0.011	< 0.0022	< 0.0022	< 0.0022	0.010	0.012	< 0.012	No	No											
0279987	7 - Roof East Facade	3/28/2008	7:31 AM	3/29/2008	7:03 AM	1,412	4,790	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/31/2008	0.029	0.071	0.026	0.11	< 0.0021	0.128	< 0.0021	< 0.0021	< 0.0021	0.039	0.015	< 0.012	No	No											
0279973	8 - Roof North Facade	3/28/2008	7:53 AM	3/29/2008	7:53 AM	1,424	4,706	Metals	NIOSH 7200 Modified ICP-MS	RALG Metals	3/31/2008	0.026	0.067	0.																						

MasterWorks - 130 Cedar Building, Community Monitoring															
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Mercury Concentration (ng/m ³)	EPA Site Specific Trigger Level for Mercury (ng/m ³)	Exceeds Target Air Quality or EPA Site Specific Level?	Comments
5275951	3 - 90 West Courtyard at 2nd Floor Level	3/23/2008	7:34 AM	3/24/2008	7:12 AM	1,418	567	Mercury	EPA 324/1631 mod.	BRL	03/25/2008	6	3000 ng/m3	No	
5275955	4 - Albany St 6th Floor Scaffolding	3/23/2008	7:55 AM	3/24/2008	7:38 AM	1,423	583	Mercury	EPA 324/1631 mod.	BRL	03/25/2008	< 5	3000 ng/m3	No	
5275959	5 - Washington St 6th Floor Scaffolding	3/23/2008	8:01 AM	3/24/2008	7:52 AM	1,431	565	Mercury	EPA 324/1631 mod.	BRL	03/25/2008	< 5	3000 ng/m3	No	
5275963	6 - Cedar St 6th Floor Scaffolding	3/23/2008	7:46 AM	3/24/2008	7:25 AM	1,419	568	Mercury	EPA 324/1631 mod.	BRL	03/25/2008	< 5	3000 ng/m3	No	
5275967	7 - Roof, East Facade	3/23/2008	7:28 AM	3/24/2008	7:20 AM	1,432	551	Mercury	EPA 324/1631 mod.	BRL	03/25/2008	< 6	3000 ng/m3	No	
5275971	8 - Roof, North Facade	3/23/2008	8:50 AM	3/24/2008	7:31 AM	1,361	531	Mercury	EPA 324/1631 mod.	BRL	03/25/2008	< 6	3000 ng/m3	No	
5275273	3 - 90 West Courtyard at 2nd Floor Level	3/24/2008	7:14 AM	3/25/2008	7:04 AM	1,430	558	Mercury	EPA 324/1631 mod.	BRL	03/26/2008	< 6	3000 ng/m3	No	
5275281	4 - Albany St 6th Floor Scaffolding	3/24/2008	7:39 AM	3/25/2008	7:41 AM	1,442	591	Mercury	EPA 324/1631 mod.	BRL	03/26/2008	< 5	3000 ng/m3	No	
5275277	5 - Washington St 6th Floor Scaffolding	3/24/2008	7:55 AM	3/25/2008	7:50 AM	1,435	574	Mercury	EPA 324/1631 mod.	BRL	03/26/2008	< 5	3000 ng/m3	No	
5275261	6 - Cedar St 6th Floor Scaffolding	3/24/2008	7:28 AM	3/25/2008	7:18 AM	1,430	551	Mercury	EPA 324/1631 mod.	BRL	03/26/2008	< 6	3000 ng/m3	No	
5275257	7 - Roof, East Facade	3/24/2008	7:24 AM	3/24/2008	4:13 PM	529	212	Mercury	EPA 324/1631 mod.	BRL	03/28/2008	< 15	3000 ng/m3	No	Sample time/volume estimated - pump flow fault
5275265	8 - Roof, North Facade	3/24/2008	7:36 AM	3/25/2008	8:05 AM	1,469	568	Mercury	EPA 324/1631 mod.	BRL	03/28/2008	< 6	3000 ng/m3	No	
5275373	3 - 90 West Courtyard at 2nd Floor Level	3/25/2008	7:08 AM	3/26/2008	7:20 AM	1,452	559	Mercury	EPA 324/1631 mod.	BRL	03/27/2008	< 6	3000 ng/m3	No	
5275369	4 - Albany St 6th Floor Scaffolding	3/25/2008	7:45 AM	3/26/2008	7:47 AM	1,442	570	Mercury	EPA 324/1631 mod.	BRL	03/27/2008	< 5	3000 ng/m3	No	
5275981	4 - Albany St 6th Floor Scaffolding	3/25/2008	7:35 AM	3/25/2008	7:50 PM	735	294	Mercury	EPA 324/1631 mod.	BRL	03/27/2008	< 10	3000 ng/m3	No	
5275377	5 - Washington St 6th Floor Scaffolding	3/25/2008	7:54 AM	3/26/2008	8:05 AM	1,451	559	Mercury	EPA 324/1631 mod.	BRL	03/27/2008	< 6	3000 ng/m3	No	
5275385	6 - Cedar St 6th Floor Scaffolding	3/25/2008	7:22 AM	3/26/2008	8:21 AM	1,499	570	Mercury	EPA 324/1631 mod.	BRL	03/27/2008	< 5	3000 ng/m3	No	
5275381	7 - Roof, East Facade	3/25/2008	7:47 AM	3/26/2008	6:48 AM	1,381	483	Mercury	EPA 324/1631 mod.	BRL	03/27/2008	< 6	3000 ng/m3	No	
5275393	8 - Roof, North Facade	3/25/2008	8:10 AM	3/26/2008	7:17 AM	1,387	472	Mercury	EPA 324/1631 mod.	BRL	03/27/2008	< 7	3000 ng/m3	No	
5275750	3 - 90 West Courtyard at 2nd Floor Level	3/26/2008	7:24 AM	3/27/2008	7:05 AM	1,421	519	Mercury	EPA 324/1631 mod.	BRL	03/28/2008	7	3000 ng/m3	No	
5275703	4 - Albany St 6th Floor Scaffolding	3/26/2008	7:52 AM	3/27/2008	8:04 AM	1,452	581	Mercury	EPA 324/1631 mod.	BRL	03/28/2008	6	3000 ng/m3	No	
5275692	5 - Washington St 6th Floor Scaffolding	3/26/2008	8:10 AM	3/27/2008	8:14 AM	1,444	570	Mercury	EPA 324/1631 mod.	BRL	03/28/2008	7	3000 ng/m3	No	
5275707	6 - Cedar St 6th Floor Scaffolding	3/26/2008	8:26 AM	3/27/2008	7:36 AM	1,390	535	Mercury	EPA 324/1631 mod.	BRL	03/28/2008	< 6	3000 ng/m3	No	
5275876	7 - Roof, East Facade	3/26/2008	8:54 AM	3/27/2008	7:14 AM	1,460	599	Mercury	EPA 324/1631 mod.	BRL	03/28/2008	6	3000 ng/m3	No	
5275872	8 - Roof, North Facade	3/26/2008	7:24 AM	3/27/2008	7:28 AM	1,444	527	Mercury	EPA 324/1631 mod.	BRL	03/28/2008	10	3000 ng/m3	No	
5275888	3 - 90 West Courtyard at 2nd Floor Level	3/27/2008	7:10 AM	3/28/2008	7:11 AM	1,441	548	Mercury	EPA 324/1631 mod.	BRL	03/29/2008	< 6	3000 ng/m3	No	
5275896	4 - Albany St 6th Floor Scaffolding	3/27/2008	8:08 AM	3/28/2008	7:50 AM	1,422	569	Mercury	EPA 324/1631 mod.	BRL	03/29/2008	< 5	3000 ng/m3	No	
5275880	5 - Washington St 6th Floor Scaffolding	3/27/2008	8:17 AM	3/28/2008	8:01 AM	1,424	555	Mercury	EPA 324/1631 mod.	BRL	03/29/2008	< 6	3000 ng/m3	No	
5275884	6 - Cedar St 6th Floor Scaffolding	3/27/2008	7:41 AM	3/28/2008	7:33 AM	1,432	551	Mercury	EPA 324/1631 mod.	BRL	03/29/2008	< 6	3000 ng/m3	No	
5275711	7 - Roof, East Facade	3/27/2008	7:18 AM	3/28/2008	7:26 AM	1,448	529	Mercury	EPA 324/1631 mod.	BRL	03/29/2008	< 6	3000 ng/m3	No	
5275715	8 - Roof, North Facade	3/27/2008	7:33 AM	3/28/2008	7:48 AM	1,455	538	Mercury	EPA 324/1631 mod.	BRL	03/29/2008	< 6	3000 ng/m3	No	
5275780	3 - 90 West Courtyard at 2nd Floor Level	3/28/2008	7:15 AM	3/29/2008	7:13 AM	1,438	554	Mercury	EPA 324/1631 mod.	BRL	03/31/2008	< 6	3000 ng/m3	No	
5275776	4 - Albany St 6th Floor Scaffolding	3/28/2008	7:54 AM	3/29/2008	8:11 AM	1,457	576	Mercury	EPA 324/1631 mod.	BRL	03/31/2008	< 5	3000 ng/m3	No	
5275772	5 - Washington St 6th Floor Scaffolding	3/28/2008	8:05 AM	3/29/2008	8:20 AM	1,455	575	Mercury	EPA 324/1631 mod.	BRL	03/31/2008	< 5	3000 ng/m3	No	
5275764	6 - Cedar St 6th Floor Scaffolding	3/28/2008	7:37 AM	3/29/2008	7:46 AM	1,449	580	Mercury	EPA 324/1631 mod.	BRL	03/31/2008	< 5	3000 ng/m3	No	
5275760	7 - Roof, East Facade	3/28/2008	7:31 AM	3/29/2008	7:03 AM	1,412	537	Mercury	EPA 324/1631 mod.	BRL	03/31/2008	< 6	3000 ng/m3	No	
5275756	8 - Roof, North Facade	3/28/2008	7:53 AM	3/29/2008	7:37 AM	1,424	577	Mercury	EPA 324/1631 mod.	BRL	03/31/2008	< 5	3000 ng/m3	No	
5275561	3 - 90 West Courtyard at 2nd Floor Level	3/29/2008	7:16 AM	3/30/2008	7:25 AM	1,449	580	Mercury	EPA 324/1631 mod.	BRL	04/02/2008	14	3000 ng/m3	No	
5275557	4 - Albany St 6th Floor Scaffolding	3/29/2008	8:17 AM	3/30/2008	8:00 AM	1,423	569	Mercury	EPA 324/1631 mod.	BRL	04/02/2008	12	3000 ng/m3	No	
5275553	5 - Washington St 6th Floor Scaffolding	3/29/2008	8:26 AM	3/30/2008	8:10 AM	1,424	570	Mercury	EPA 324/1631 mod.	BRL	04/02/2008	12	3000 ng/m3	No	
5275549	6 - Cedar St 6th Floor Scaffolding	3/29/2008	7:49 AM	3/30/2008	7:45 AM	1,436	574	Mercury	EPA 324/1631 mod.	BRL	04/02/2008	16	3000 ng/m3	No	
5275545	7 - Roof, East Facade	3/29/2008	7:10 AM	3/30/2008	7:22 AM	1,452	566	Mercury	EPA 324/1631 mod.	BRL	04/02/2008	14	3000 ng/m3	No	
5275541	8 - Roof, North Facade	3/29/2008	7:45 AM	3/30/2008	7:40 AM	1,435	531	Mercury	EPA 324/1631 mod.	BRL	04/02/2008	13	3000 ng/m3	No	

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Asbestos Concentration (f/cc)	MMVF Concentration (f/cc)	EPA Site Specific Trigger Level	Exceeds EPA Site Specific Trigger Level?	Comments
5275950	3 - 90 West Courtyard at 2nd Floor Level	3/23/2008	7:34 AM	3/24/2008	7:12 AM	1,418	4,325	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275954	4 - Albany St 6th Floor Scaffolding	3/23/2008	7:55 AM	3/24/2008	7:38 AM	1,423	4,269	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275958	5 - Washington St 6th Floor Scaffolding	3/23/2008	8:01 AM	3/24/2008	7:52 AM	1,431	4,365	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275962	6 - Cedar St 6th Floor Scaffolding	3/23/2008	7:46 AM	3/24/2008	7:25 AM	1,419	4,328	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275966	7 - Roof, East Facade	3/23/2008	7:28 AM	3/24/2008	7:20 AM	1,432	4,502	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275970	8 - Roof, North Facade	3/23/2008	8:50 AM	3/24/2008	7:31 AM	1,361	4,048	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/25/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275272	3 - 90 West Courtyard at 2nd Floor Level	3/24/2008	7:14 AM	3/25/2008	7:04 AM	1,430	4,219	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/26/2008	0.00005	0.00005	0.0009 f/cc	No	
5275280	4 - Albany St 6th Floor Scaffolding	3/24/2008	7:39 AM	3/25/2008	7:41 AM	1,442	4,398	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/26/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275276	5 - Washington St 6th Floor Scaffolding	3/24/2008	7:55 AM	3/25/2008	7:50 AM	1,435	4,449	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/26/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275260	6 - Cedar St 6th Floor Scaffolding	3/24/2008	7:28 AM	3/25/2008	7:18 AM	1,430	4,219	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/26/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275256	7 - Roof, East Facade	3/24/2008	7:24 AM	3/25/2008	7:42 AM	1,458	4,266	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/26/2008	0.00014	<0.00005	0.0009 f/cc	No	
5275264	8 - Roof, North Facade	3/24/2008	7:36 AM	3/25/2008	8:05 AM	1,469	4,549	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/26/2008	<0.00004	0.00004	0.0009 f/cc	No	
5275372	3 - 90 West Courtyard at 2nd Floor Level	3/25/2008	7:08 AM	3/26/2008	7:20 AM	1,452	4,247	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/27/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275368	4 - Albany St 6th Floor Scaffolding	3/25/2008	7:45 AM	3/26/2008	7:47 AM	1,442	4,146	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/27/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275980	4 - Albany St 6th Floor Scaffolding	3/25/2008	7:35 AM	3/26/2008	7:59 AM	1,464	4,502	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/27/2008	<0.00005	0.00005	0.0009 f/cc	No	
5275376	5 - Washington St 6th Floor Scaffolding	3/25/2008	7:54 AM	3/26/2008	8:05 AM	1,451	4,281	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/27/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275384	6 - Cedar St 6th Floor Scaffolding	3/25/2008	7:22 AM	3/26/2008	8:21 AM	1,499	4,572	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/27/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5275380	7 - Roof, East Facade	3/25/2008	7:47 AM	3/26/2008	6:48 AM	1,381	4,265	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/27/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275392	8 - Roof, North Facade	3/25/2008	8:10 AM	3/26/2008	7:17 AM	1,387	4,305	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/27/2008	<0.00005	0.00005	0.0009 f/cc	No	
5275749	3 - 90 West Courtyard at 2nd Floor Level	3/26/2008	7:24 AM	3/27/2008	7:05 AM	1,421	4,405	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/28/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275702	4 - Albany St 6th Floor Scaffolding	3/26/2008	7:52 AM	3/27/2008	8:04 AM	1,452	4,283	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/28/2008	<0.00005	0.00009	0.0009 f/cc	No	
5275891	5 - Washington St 6th Floor Scaffolding	3/26/2008	8:10 AM	3/27/2008	8:14 AM	1,444	4,621	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/28/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5275706	6 - Cedar St 6th Floor Scaffolding	3/26/2008	8:26 AM	3/27/2008	7:36 AM	1,390	4,309	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/28/2008	0.00005	<0.00005	0.0009 f/cc	No	
5275875	7 - Roof, East Facade	3/26/2008	6:54 AM	3/27/2008	7:14 AM	1,460	4,566	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/28/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5275871	8 - Roof, North Facade	3/26/2008	7:24 AM	3/27/2008	7:28 AM	1,444	4,566	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/28/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5275886	3 - 90 West Courtyard at 2nd Floor Level	3/27/2008	7:10 AM	3/28/2008	7:11 AM	1,441	4,251	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275895	4 - Albany St 6th Floor Scaffolding	3/27/2008	8:08 AM	3/28/2008	7:50 AM	1,422	4,053	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275879	5 - Washington St 6th Floor Scaffolding	3/27/2008	8:17 AM	3/28/2008	8:01 AM	1,424	4,343	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/29/2008	<0.00005	0.00005	0.0009 f/cc	No	
5275883	6 - Cedar St 6th Floor Scaffolding	3/27/2008	7:41 AM	3/28/2008	7:33 AM	1,432	4,189	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/29/2008	<0.00005	0.00005	0.0009 f/cc	No	
5275710	7 - Roof, East Facade	3/27/2008	7:18 AM	3/28/2008	7:26 AM	1,448	4,247	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/29/2008	<0.00005	0.00005	0.0009 f/cc	No	
5275714	8 - Roof, North Facade	3/27/2008	7:33 AM	3/28/2008	7:48 AM	1,455	4,408	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/29/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275779	3 - 90 West Courtyard at 2nd Floor Level	3/28/2008	7:15 AM	3/29/2008	7:13 AM	1,438	4,242	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275775	4 - Albany St 6th Floor Scaffolding	3/28/2008	7:54 AM	3/29/2008	8:11 AM	1,457	4,371	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275771	5 - Washington St 6th Floor Scaffolding	3/28/2008	8:05 AM	3/29/2008	8:20 AM	1,455	4,365	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275763	6 - Cedar St 6th Floor Scaffolding	3/28/2008	7:37 AM	3/29/2008	7:46 AM	1,449	4,202	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/31/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275759	7 - Roof, East Facade	3/28/2008	7:31 AM	3/29/2008	7:03 AM	1,412	3,866	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/31/2008	<0.00005	0.00005	0.0009 f/cc	No	
5275755	8 - Roof, North Facade	3/28/2008	7:53 AM	3/29/2008	7:37 AM	1,424	4,169	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	3/31/2008	<0.00005	0.00010	0.0009 f/cc	No	
5275560	3 - 90 West Courtyard at 2nd Floor Level	3/29/2008	7:16 AM	3/30/2008	7:25 AM	1,449	4,347	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275556	4 - Albany St 6th Floor Scaffolding	3/29/2008	8:17 AM	3/30/2008	8:00 AM	1,423	4,269	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275552	5 - Washington St 6th Floor Scaffolding	3/29/2008	8:26 AM	3/30/2008	8:10 AM	1,424	3,987	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275548	6 - Cedar St 6th Floor Scaffolding	3/29/2008	7:49 AM	3/30/2008	7:45 AM	1,436	4,308	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5275544	7 - Roof, East Facade	3/29/2008	7:10 AM	3/30/2008	7:22 AM	1,452	4,525	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/1/2008	<0.00004	0.00004	0.0009 f/cc	No	
5275540	8 - Roof, North Facade	3/29/2008	7:45 AM	3/30/2008	7:40 AM	1,435	4,419	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/1/2008	<0.00005	<0.00005	0.0009 f/cc	No	

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	Respirable Dust Concentration (mg/m ³)	Respirable Quartz Concentration (mg/m ³)	Target Air quality Level for Respirable Quartz (mg/m ³)	EPA Site Specific Trigger Level for Respirable Quartz (mg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
5275949	3 - 90 West Courtyard at 2nd Floor Level	3/23/2008	7:34 AM	3/24/2008	7:12 AM	1,418	3,416	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5275953	4 - Albany St 6th Floor Scaffolding	3/23/2008	7:55 AM	3/24/2008	7:38 AM	1,423	3,686	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5275957	5 - Washington St 6th Floor Scaffolding	3/23/2008	8:01 AM	3/24/2008	7:52 AM	1,431	3,649	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/25/2008	< 0.027	< 0.001	0.01	0.01	No	
5275961	6 - Cedar St 6th Floor Scaffolding	3/23/2008	7:46 AM	3/24/2008	7:25 AM	1,419	3,619	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5275965	7 - Roof, East Facade	3/23/2008	7:28 AM	3/24/2008	7:20 AM	1,432	3,723	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/25/2008	< 0.027	< 0.001	0.01	0.01	No	
5275969	8 - Roof, North Facade	3/23/2008	8:50 AM	3/24/2008	7:31 AM	1,361	3,539	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/25/2008	< 0.028	< 0.001	0.01	0.01	No	
5275271	3 - 90 West Courtyard at 2nd Floor Level	3/24/2008	7:14 AM	3/25/2008	7:04 AM	1,430	3,575	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/26/2008	< 0.028	< 0.001	0.01	0.01	No	
5275279	4 - Albany St 6th Floor Scaffolding	3/24/2008	7:39 AM	3/25/2008	7:41 AM	1,442	3,643	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/26/2008	< 0.027	< 0.001	0.01	0.01	No	
5275275	5 - Washington St 6th Floor Scaffolding	3/24/2008	7:55 AM	3/25/2008	7:50 AM	1,435	3,623	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/26/2008	< 0.028	< 0.001	0.01	0.01	No	
5275259	6 - Cedar St 6th Floor Scaffolding	3/24/2008	7:28 AM	3/25/2008	7:18 AM	1,430	3,575	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/26/2008	< 0.028	< 0.001	0.01	0.01	No	
5275255	7 - Roof, East Facade	3/24/2008	7:24 AM	3/25/2008	7:42 AM	1,458	3,718	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/26/2008	< 0.027	< 0.001	0.01	0.01	No	
5275263	8 - Roof, North Facade	3/24/2008	7:36 AM	3/25/2008	8:05 AM	1,469	3,599	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/26/2008	< 0.001	< 0.001	0.01	0.01	No	
5275371	3 - 90 West Courtyard at 2nd Floor Level	3/25/2008	7:08 AM	3/26/2008	7:20 AM	1,452	3,630	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/27/2008	< 0.028	< 0.001	0.01	0.01	No	
5275367	4 - Albany St 6th Floor Scaffolding	3/25/2008	7:45 AM	3/26/2008	7:49 AM	1,442	3,605	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/27/2008	< 0.028	< 0.001	0.01	0.01	No	
5275979	4 - Albany St 6th Floor Scaffolding	3/25/2008	7:35 AM	3/26/2008	7:59 AM	1,464	3,074	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/27/2008	< 0.033	< 0.001	0.01	0.01	No	
5275375	5 - Washington St 6th Floor Scaffolding	3/25/2008	7:54 AM	3/26/2008	8:05 AM	1,451	3,555	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/27/2008	< 0.028	< 0.001	0.01	0.01	No	
5275383	6 - Cedar St 6th Floor Scaffolding	3/25/2008	7:22 AM	3/26/2008	8:21 AM	1,499	3,897	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/27/2008	< 0.026	< 0.001	0.01	0.01	No	
5275379	7 - Roof, East Facade	3/25/2008	7:47 AM	3/26/2008	6:48 AM	1,381	3,660	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/27/2008	< 0.027	< 0.001	0.01	0.01	No	
5275391	8 - Roof, North Facade	3/25/2008	8:10 AM	3/26/2008	7:17 AM	1,387	3,745	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/27/2008	< 0.027	0.002	0.01	0.01	No	
5275988	3 - 90 West Courtyard at 2nd Floor Level	3/26/2008	7:24 AM	3/27/2008	7:05 AM	1,421	3,553	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/28/2008	< 0.028	< 0.001	0.01	0.01	No	
5275701	4 - Albany St 6th Floor Scaffolding	3/26/2008	7:52 AM	3/27/2008	8:04 AM	1,452	3,666	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/28/2008	< 0.027	< 0.001	0.01	0.01	No	
5275890	5 - Washington St 6th Floor Scaffolding	3/26/2008	8:10 AM	3/27/2008	8:14 AM	1,444	3,827	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/28/2008	< 0.026	< 0.001	0.01	0.01	No	
5275705	6 - Cedar St 6th Floor Scaffolding	3/26/2008	8:26 AM	3/27/2008	7:36 AM	1,390	3,475	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/28/2008	< 0.029	< 0.001	0.01	0.01	No	
5275874	7 - Roof, East Facade	3/26/2008	6:54 AM	3/27/2008	7:14 AM	1,460	3,869	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/28/2008	< 0.026	< 0.001	0.01	0.01	No	
5275870	8 - Roof, North Facade	3/26/2008	7:24 AM	3/27/2008	7:28 AM	1,444	3,682	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/28/2008	< 0.027	< 0.001	0.01	0.01	No	
5275967	3 - 90 West Courtyard at 2nd Floor Level	3/27/2008	7:10 AM	3/28/2008	7:11 AM	1,441	3,603	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/29/2008	< 0.028	< 0.001	0.01	0.01	No	
5275894	4 - Albany St 6th Floor Scaffolding	3/27/2008	8:08 AM	3/28/2008	7:50 AM	1,422	3,555	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/29/2008	< 0.028	< 0.001	0.01	0.01	No	
5275878	5 - Washington St 6th Floor Scaffolding	3/27/2008	8:17 AM	3/28/2008	8:01 AM	1,424	3,418	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/29/2008	< 0.029	< 0.001	0.01	0.01	No	
5275882	6 - Cedar St 6th Floor Scaffolding	3/27/2008	7:41 AM	3/28/2008	7:33 AM	1,432	3,508	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/29/2008	< 0.029	< 0.001	0.01	0.01	No	
5275709	7 - Roof, East Facade	3/27/2008	7:18 AM	3/28/2008	7:26 AM	1,448	3,692	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/29/2008	< 0.027	< 0.001	0.01	0.01	No	
5275713	8 - Roof, North Facade	3/27/2008	7:33 AM	3/28/2008	7:48 AM	1,455	3,565	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/29/2008	< 0.028	< 0.001	0.01	0.01	No	
5275778	3 - 90 West Courtyard at 2nd Floor Level	3/28/2008	7:15 AM	3/29/2008	7:13 AM	1,438	3,523	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/31/2008	< 0.028	< 0.001	0.01	0.01	No	
5275774	4 - Albany St 6th Floor Scaffolding	3/28/2008	7:54 AM	3/29/2008	8:11 AM	1,457	3,570	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/31/2008	< 0.028	< 0.001	0.01	0.01	No	
5275770	5 - Washington St 6th Floor Scaffolding	3/28/2008	8:05 AM	3/29/2008	8:02 AM	1,437	3,521	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/31/2008	< 0.028	< 0.001	0.01	0.01	No	
5275762	6 - Cedar St 6th Floor Scaffolding	3/28/2008	7:37 AM	3/29/2008	7:46 AM	1,449	3,623	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/31/2008	< 0.028	< 0.001	0.01	0.01	No	
5275768	7 - Roof, East Facade	3/28/2008	7:31 AM	3/29/2008	7:03 AM	1,412	3,671	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/31/2008	< 0.027	< 0.001	0.01	0.01	No	
5275754	8 - Roof, North Facade	3/28/2008	7:53 AM	3/29/2008	7:35 AM	1,424	3,346	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	3/31/2008	< 0.030	< 0.001	0.01	0.01	No	
5275559	3 - 90 West Courtyard at 2nd Floor Level	3/29/2008	7:16 AM	3/30/2008	7:25 AM	1,449	3,623	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/1/2008	< 0.028	< 0.001	0.01	0.01	No	
5275555	4 - Albany St 6th Floor Scaffolding	3/29/2008	8:17 AM	3/30/2008	8:00 AM	1,423	3,486	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/1/2008	< 0.029	< 0.001	0.01	0.01	No	
5275551	5 - Washington St 6th Floor Scaffolding	3/29/2008	8:26 AM	3/30/2008	8:10 AM	1,424	3,418	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/1/2008	< 0.029	< 0.001	0.01	0.01	No	
5275547	6 - Cedar St 6th Floor Scaffolding	3/29/2008	7:49 AM	3/30/2008	7:45 AM	1,436	3,518	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/1/2008	< 0.028	< 0.001	0.01	0.01	No	
5275543	7 - Roof, East Facade	3/29/2008	7:20 AM	3/30/2008	7:22 AM	1,452	3,775	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/1/2008	< 0.026	< 0.001	0.01	0.01	No	
5275539	8 - Roof, North Facade	3/29/2008	7:45 AM	3/30/2008	7:40 AM	1,435	3,588	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/1/2008	< 0.027	< 0.001	0.01	0.01	No	

MasterWorks - 130 Cedar Building, Community Monitoring


Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM _{2.5} Avg. Concentration (µg/m ³)	EPA Site Specific Trigger Level for PM _{2.5} (µg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	3/23/2008	12:00 AM	3/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	7	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/23/2008	12:00 AM	3/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	7	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/23/2008	12:00 AM	3/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	7	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/23/2008	12:00 AM	3/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	9	65	No	
N/A	7 - Roof, East	3/23/2008	12:00 AM	3/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	7	65	No	
N/A	8 - Roof, North	3/23/2008	12:00 AM	3/24/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	8	65	No	
N/A	3 - Courtyard, 2nd Floor Level	3/24/2008	12:00 AM	3/25/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	12	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/24/2008	12:00 AM	3/25/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	12	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/24/2008	12:00 AM	3/25/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	13	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/24/2008	12:00 AM	3/25/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	13	65	No	
N/A	7 - Roof, East	3/24/2008	12:00 AM	3/25/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	32	65	No	
N/A	8 - Roof, North	3/24/2008	12:00 AM	3/25/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	12	65	No	
N/A	3 - Courtyard, 2nd Floor Level	3/25/2008	12:00 AM	3/26/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	11	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/25/2008	12:00 AM	3/26/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	12	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/25/2008	12:00 AM	3/26/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	12	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/25/2008	12:00 AM	3/26/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	13	65	No	
N/A	7 - Roof, East	3/25/2008	12:00 AM	3/26/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	14	65	No	
N/A	8 - Roof, North	3/25/2008	12:00 AM	3/26/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	12	65	No	
N/A	3 - Courtyard, 2nd Floor Level	3/26/2008	12:00 AM	3/27/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	19	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/26/2008	12:00 AM	3/27/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	13	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/26/2008	12:00 AM	3/27/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	13	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/26/2008	12:00 AM	3/27/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	16	65	No	
N/A	7 - Roof, East	3/26/2008	12:00 AM	3/27/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	19	65	No	
N/A	8 - Roof, North	3/26/2008	12:00 AM	3/27/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	16	65	No	
N/A	3 - Courtyard, 2nd Floor Level	3/27/2008	12:00 AM	3/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	27	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/27/2008	12:00 AM	3/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	18	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/27/2008	12:00 AM	3/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	18	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/27/2008	12:00 AM	3/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	19	65	No	
N/A	7 - Roof, East	3/27/2008	12:00 AM	3/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	18	65	No	
N/A	8 - Roof, North	3/27/2008	12:00 AM	3/28/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	20	65	No	
N/A	3 - Courtyard, 2nd Floor Level	3/28/2008	12:00 AM	3/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	30	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/28/2008	12:00 AM	3/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	21	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/28/2008	12:00 AM	3/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	23	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/28/2008	12:00 AM	3/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	23	65	No	
N/A	7 - Roof, East	3/28/2008	12:00 AM	3/29/2008	12:00 AM	930	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	33	65	No	Instrument off-line for portion of day, conc. is not a 24 hr. avg.
N/A	8 - Roof, North	3/28/2008	12:00 AM	3/29/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	26	65	No	
N/A	3 - Courtyard, 2nd Floor Level	3/29/2008	12:00 AM	3/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	8	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/29/2008	12:00 AM	3/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	9	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/29/2008	12:00 AM	3/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	8	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/29/2008	12:00 AM	3/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	9	65	No	
N/A	7 - Roof, East	3/29/2008	12:00 AM	3/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5003	N/A	11	65	No	
N/A	8 - Roof, North	3/29/2008	12:00 AM	3/30/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	8	65	No	

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM ₁₀ Avg. Concentration (µg/m ³)	EPA Site Specific Trigger Level for PM10 (µg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	3/23/2008	12:00 AM	03/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	8	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/23/2008	12:00 AM	03/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	8	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/23/2008	12:00 AM	03/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	8	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/23/2008	12:00 AM	03/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	9	150	No	
N/A	7 - Roof, East	3/23/2008	12:00 AM	03/24/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	9	150	No	
N/A	8 - Roof, North	3/23/2008	12:00 AM	03/24/2008	12:00 AM	890	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	9	150	No	Instrument off-line for portion of day, conc. is not a 24 hr. avg.
N/A	3 - Courtyard, 2nd Floor Level	3/24/2008	12:00 AM	03/25/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	15	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/24/2008	12:00 AM	03/25/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	17	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/24/2008	12:00 AM	03/25/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	17	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/24/2008	12:00 AM	03/25/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	17	150	No	
N/A	7 - Roof, East	3/24/2008	12:00 AM	03/25/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	16	150	No	
N/A	8 - Roof, North	3/24/2008	12:00 AM	03/25/2008	12:00 AM	645	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	30	150	No	Instrument off-line for portion of day, conc. is not a 24 hr. avg.
N/A	3 - Courtyard, 2nd Floor Level	3/25/2008	12:00 AM	03/26/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	13	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/25/2008	12:00 AM	03/26/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	17	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/25/2008	12:00 AM	03/26/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	17	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/25/2008	12:00 AM	03/26/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	17	150	No	
N/A	7 - Roof, East	3/25/2008	12:00 AM	03/26/2008	12:00 AM	1,435	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	20	150	No	
N/A	8 - Roof, North	3/25/2008	12:00 AM	03/26/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	35	150	No	
N/A	3 - Courtyard, 2nd Floor Level	3/26/2008	12:00 AM	03/27/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	18	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/26/2008	12:00 AM	03/27/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	19	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/26/2008	12:00 AM	03/27/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	20	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/26/2008	12:00 AM	03/27/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	22	150	No	
N/A	7 - Roof, East	3/26/2008	12:00 AM	03/27/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	28	150	No	
N/A	8 - Roof, North	3/26/2008	12:00 AM	03/27/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	27	150	No	
N/A	3 - Courtyard, 2nd Floor Level	3/27/2008	12:00 AM	03/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	20	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/27/2008	12:00 AM	03/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	22	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/27/2008	12:00 AM	03/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	24	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/27/2008	12:00 AM	03/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	22	150	No	
N/A	7 - Roof, East	3/27/2008	12:00 AM	03/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	24	150	No	
N/A	8 - Roof, North	3/27/2008	12:00 AM	03/28/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	24	150	No	
N/A	3 - Courtyard, 2nd Floor Level	3/28/2008	12:00 AM	03/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	22	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/28/2008	12:00 AM	03/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	25	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/28/2008	12:00 AM	03/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	30	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/28/2008	12:00 AM	03/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	26	150	No	
N/A	7 - Roof, East	3/28/2008	12:00 AM	03/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	28	150	No	
N/A	8 - Roof, North	3/28/2008	12:00 AM	03/29/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	28	150	No	
N/A	3 - Courtyard, 2nd Floor Level	3/29/2008	12:00 AM	03/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	9	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	3/29/2008	12:00 AM	03/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	10	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	3/29/2008	12:00 AM	03/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	10	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	3/29/2008	12:00 AM	03/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	9	150	No	
N/A	7 - Roof, East	3/29/2008	12:00 AM	3/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3364	N/A	12	150	No	
N/A	8 - Roof, North	3/29/2008	12:00 AM	3/30/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5001	N/A	12	150	No	

350 Hochberg Road, Monroeville, PA 15146
 Phone: (724) 325-1776 Fax: (724) 733-1799

Mercury Vapor (Hg^0) Air Results for Outdoor Community
 Monitoring Stations by Location as recorded by the Lumex Analyzer

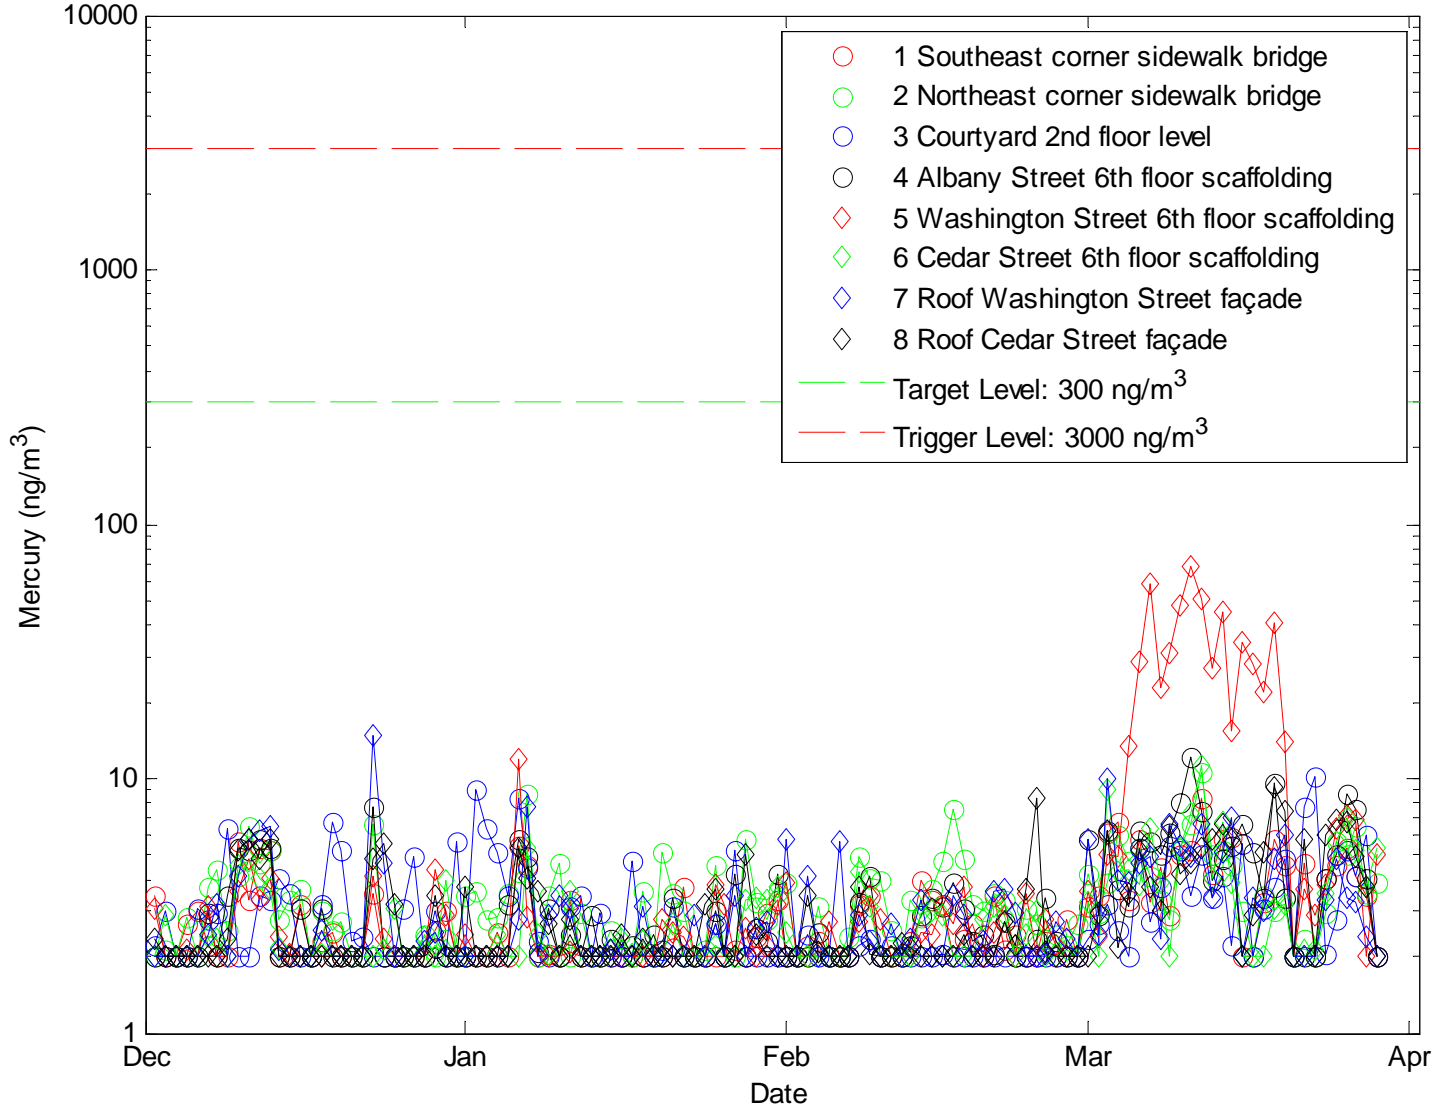

350 Hochberg Road, Monroeville, PA 15146
Phone: (724) 325-1776 Fax: (724) 733-1799

Report Summary

Air Mercury Results (Hg⁰, ng/m³) as recorded by the Lumex RA915+ analyzer

Week of 03/23/08 to 03/29/08

Date	Mercury (Hg ⁰) ng/m ³ 30-sec readings	1 Southeast corner sidewalk bridge	2 Northeast corner sidewalk bridge	3 Courtyard 2nd floor level	4 Albany Street 6th floor scaffolding	5 Washington Street 6th floor scaffolding	6 Cedar Street 6th floor scaffolding	7 Roof Washington Street façade	8 Roof Cedar Street façade
23-Mar-08	# Samples	9	9	9	9	9	9	9	9
	Average	2	2	10	2	3	2	2	2
	Maximum	2	2	11	2	5	3	2	2
24-Mar-08	# Samples	36	36	36	36	36	39	36	36
	Average	4	3	2	4	4	4	3	6
	Maximum	5	4	4	7	6	7	6	8
25-Mar-08	# Samples	36	36	36	36	36	36	36	36
	Average	5	6	3	5	6	6	5	7
	Maximum	8	11	6	10	17	15	15	17
26-Mar-08	# Samples	36	36	36	36	36	36	36	36
	Average	5	5	5	9	7	7	3	7
	Maximum	8	8	10	23	17	15	6	11
27-Mar-08	# Samples	36	36	36	36	36	36	36	36
	Average	4	6	4	8	7	5	3	5
	Maximum	6	14	7	21	19	8	6	8
28-Mar-08	# Samples	36	36	36	36	36	36	36	36
	Average	4	4	6	4	2	4	2	4
	Maximum	5	5	16	8	4	7	4	9
29-Mar-08	# Samples	9	9	9	9	9	9	9	12
	Average	2	4	2	2	5	5	2	2
	Maximum	2	5	4	2	6	6	2	2