

MasterWorks - 130 Cedar Building, Community Monitoring																					
Sample No.	Sampling Location	Collection Start Date	Collection Time (7am-6pm)	Collection End Date	Collection Time (off)	Total collection time, minutes	Sample Volume (L)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	Total Structure Count			Asbestos < 5 µm	Asbestos ≥ 5 µm	Result (µm/m)	Concentration (B/C)	EPA Site Specific Trigger Level	Exceeds EPA Site Specific Trigger Level?	Comments
												All Asbestos	Chrysotile	Amphibole							
5276232	3-90 West Courtyard at 2nd Floor Level	4/8/2008	7:52 AM	4/8/2008	7:52 AM	457	1,505	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276233	4-Albany St 6th Floor Scalloffing	4/8/2008	7:46 AM	4/8/2008	3:18 PM	457	1,605	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276235	5- Washington St 6th Floor Scalloffing	4/8/2008	7:47 AM	4/8/2008	3:19 PM	462	1,565	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	1	1	0	1	0	7.9	0.0019	70 µm/m2	No	
5276236	6-Cedar St 6th Floor Scalloffing	4/8/2008	7:40 AM	4/8/2008	3:10 PM	464	1,600	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276237	7-Roof, East Facade	4/8/2008	7:33 AM	4/8/2008	3:14 PM	461	1,607	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276237	8-Roof, North Facade	4/8/2008	7:34 AM	4/8/2008	3:15 PM	461	1,637	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276238	3-90 West Courtyard at 2nd Floor Level	4/8/2008	7:29 AM	4/8/2008	3:13 PM	473	1,733	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276238	4-Albany St 6th Floor Scalloffing	4/8/2008	7:18 AM	4/8/2008	2:35 AM	467	2,370	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276231	5- Washington St 6th Floor Scalloffing	4/8/2008	3:19 PM	4/7/2008	2:35 AM	676	2,300	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	12.3	< 0.0020	70 µm/m2	No	
5276231	6-Cedar St 6th Floor Scalloffing	4/8/2008	3:19 PM	4/7/2008	2:35 AM	676	2,366	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276233	7-Roof, East Facade	4/8/2008	3:14 PM	4/7/2008	2:32 AM	676	2,473	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276234	8-Roof, North Facade	4/8/2008	3:15 PM	4/7/2008	2:33 AM	678	2,373	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	11.1	< 0.0019	70 µm/m2	No	
5276264	3-90 West Courtyard at 2nd Floor Level	4/7/2008	7:07 AM	4/7/2008	3:26 AM	494	1,749	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276264	4-Albany St 6th Floor Scalloffing	4/7/2008	7:07 AM	4/7/2008	3:26 AM	494	1,747	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276269	5- Washington St 6th Floor Scalloffing	4/7/2008	7:08 AM	4/7/2008	3:27 PM	499	1,772	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	1	1	0	1	0	8.5	0.0019	70 µm/m2	No	
5276269	6-Cedar St 6th Floor Scalloffing	4/7/2008	7:10 AM	4/7/2008	3:32 PM	504	1,754	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276271	7-Roof, East Facade	4/7/2008	7:20 AM	4/7/2008	3:36 PM	496	1,686	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276272	8-Roof, North Facade	4/7/2008	7:18 AM	4/7/2008	3:32 PM	494	1,754	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276264	3-90 West Courtyard at 2nd Floor Level	4/7/2008	7:12 PM	4/7/2008	3:38 PM	498	1,688	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276262	4-Albany St 6th Floor Scalloffing	4/7/2008	7:26 PM	4/7/2008	3:52 PM	426	1,481	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.4	< 0.0019	70 µm/m2	No	
5276253	5- Washington St 6th Floor Scalloffing	4/7/2008	3:27 PM	4/7/2008	10:33 PM	426	1,448	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.4	< 0.0020	70 µm/m2	No	
5276253	6-Cedar St 6th Floor Scalloffing	4/7/2008	3:27 PM	4/7/2008	10:33 PM	426	1,448	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.4	< 0.0020	70 µm/m2	No	
5276255	7-Roof, East Facade	4/7/2008	3:36 PM	4/7/2008	10:39 PM	423	1,459	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.4	< 0.0020	70 µm/m2	No	
5276256	8-Roof, North Facade	4/7/2008	3:32 PM	4/7/2008	10:37 PM	425	1,445	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	7.4	< 0.0020	70 µm/m2	No	
5276264	3-90 West Courtyard at 2nd Floor Level	4/8/2008	7:11 AM	4/8/2008	3:40 PM	503	1,687	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276263	4-Albany St 6th Floor Scalloffing	4/8/2008	7:17 AM	4/8/2008	3:40 PM	505	1,786	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	9.2	< 0.0020	70 µm/m2	No	
5276264	5- Washington St 6th Floor Scalloffing	4/8/2008	7:19 AM	4/8/2008	3:39 PM	500	1,780	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276265	6-Cedar St 6th Floor Scalloffing	4/8/2008	7:08 AM	4/8/2008	3:32 PM	504	1,810	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	9.2	< 0.0020	70 µm/m2	No	
5276267	7-Roof, East Facade	4/8/2008	7:31 AM	4/8/2008	3:38 PM	495	1,763	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276267	8-Roof, North Facade	4/8/2008	7:30 AM	4/8/2008	3:45 PM	495	1,757	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/8/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276281	3-90 West Courtyard at 2nd Floor Level	4/8/2008	3:23 PM	4/8/2008	11:22 PM	479	1,617	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276282	4-Albany St 6th Floor Scalloffing	4/8/2008	3:40 PM	4/8/2008	11:23 PM	473	1,626	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276283	5- Washington St 6th Floor Scalloffing	4/8/2008	3:39 PM	4/8/2008	11:23 PM	474	1,683	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276284	6-Cedar St 6th Floor Scalloffing	4/8/2008	3:32 PM	4/8/2008	11:29 PM	477	1,693	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276285	7-Roof, East Facade	4/8/2008	3:46 PM	4/8/2008	11:37 PM	471	1,649	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276286	8-Roof, North Facade	4/8/2008	3:45 PM	4/8/2008	11:37 PM	472	1,652	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276288	3-90 West Courtyard at 2nd Floor Level	4/8/2008	8:07 AM	4/8/2008	3:40 PM	453	1,563	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	7.9	< 0.0020	70 µm/m2	No	
5276289	4-Albany St 6th Floor Scalloffing	4/8/2008	7:41 AM	4/8/2008	3:36 PM	466	1,651	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276290	5- Washington St 6th Floor Scalloffing	4/8/2008	7:41 AM	4/8/2008	3:24 PM	463	1,667	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276291	6-Cedar St 6th Floor Scalloffing	4/8/2008	7:42 AM	4/8/2008	3:31 PM	469	1,688	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276292	7-Roof, East Facade	4/8/2008	7:39 AM	4/8/2008	3:19 PM	467	1,567	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	7.9	0.0019	70 µm/m2	No	
5276293	8-Roof, North Facade	4/8/2008	7:39 AM	4/8/2008	3:21 PM	462	1,663	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/10/2008	0	0	0	0	0	7.9	0.0019	70 µm/m2	No	
5276294	3-90 West Courtyard at 2nd Floor Level	4/8/2008	3:40 PM	4/8/2008	11:07 PM	447	1,520	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/11/2008	0	0	0	0	0	7.4	< 0.0019	70 µm/m2	No	
5276295	4-Albany St 6th Floor Scalloffing	4/8/2008	3:26 PM	4/8/2008	11:18 PM	447	1,679	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/11/2008	0	0	0	0	0	8.5	< 0.0020	70 µm/m2	No	
5276296	5- Washington St 6th Floor Scalloffing	4/8/2008	3:24 PM	4/8/2008	11:28 PM	484	1,694	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/11/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276297	6-Cedar St 6th Floor Scalloffing	4/8/2008	3:31 PM	4/8/2008	11:14 PM	463	1,621	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/11/2008	0	0	0	0	0	7.9	< 0.0019	70 µm/m2	No	
5276298	7-Roof, East Facade	4/8/2008	3:19 PM	4/8/2008	11:24 PM	485	1,698	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/11/2008	0	0	0	0	0	8.5	< 0.0019	70 µm/m2	No	
5276299	8-Roof, North Facade	4/8/2008	3:21 PM	4/8/2008	11:22 PM	481	1,690	Asbestos	AMERA, 40 CFR, Part 763, October 30, 1987 (Modified)	RJLG TEM	4/11/2008	0									

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Receipt Date	Target Air Quality Levels											Exceeds Target Air Quality Levels	Exceeds EPA Site Specific Trigger Levels	Comments
												Barium Concentration (µg/m³)	Chromium Concentration (µg/m³)	Manganese Concentration (µg/m³)	Zinc Concentration (µg/m³)	Beryllium Concentration (µg/m³)	Copper Concentration (µg/m³)	Mercury Particulate Concentration (µg/m³)	Cadmium Concentration (µg/m³)	Lead Concentration (µg/m³)	Nickel Concentration (µg/m³)	Antimony Concentration (µg/m³)			
												5.00	0.60	0.50	16.00	0.52	10.00	0.30	0.04	1.50	0.20	0.80			
5276921	3-90 West Courtyard at 2nd Floor Level	4/6/2008	7:26 AM	4/7/2008	7:23 AM	1,437	5,030	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.012	0.052	0.011	0.11	< 0.0020	0.012	< 0.0020	< 0.008	0.008	< 0.012	No	No		
5276917	4- Albany St 6th Floor Scaffolding	4/6/2008	7:56 AM	4/7/2008	8:12 AM	1,456	5,096	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.013	< 0.039	0.011	0.16	< 0.0020	0.017	< 0.0020	< 0.008	0.014	< 0.012	No	No		
5276905	5- Washington St 6th Floor Scaffolding	4/6/2008	8:06 AM	4/7/2008	8:24 AM	1,469	5,107	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.014	< 0.039	0.023	0.18	< 0.0020	0.023	< 0.0020	< 0.008	0.015	< 0.012	No	No		
5276909	6- Cedar St 6th Floor Scaffolding	4/6/2008	7:46 AM	4/7/2008	7:49 AM	1,443	5,051	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.013	0.041	0.013	0.11	< 0.0020	0.012	< 0.0020	< 0.008	0.008	< 0.012	No	No		
5276913	7- Roof, East Facade	4/6/2008	7:22 AM	4/7/2008	7:13 AM	1,431	4,838	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.013	0.065	0.018	0.11	< 0.0022	0.014	< 0.0022	< 0.009	0.009	< 0.013	No	No		
5276901	8- Roof, North Facade	4/6/2008	7:33 AM	4/7/2008	7:47 AM	1,454	5,077	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.013	< 0.039	0.013	0.18	< 0.0020	0.019	< 0.0020	< 0.008	0.020	< 0.012	No	No		
5276928	3-90 West Courtyard at 2nd Floor Level	4/7/2008	7:27 AM	4/9/2008	7:24 AM	1,437	5,030	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.027	0.065	0.019	0.10	< 0.0020	0.044	< 0.0020	0.010	0.011	< 0.012	No	No		
5276936	5- Washington St 6th Floor Scaffolding	4/7/2008	8:29 AM	4/9/2008	8:26 AM	1,439	5,109	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.048	0.042	0.022	0.16	< 0.0020	0.302	< 0.0020	< 0.020	0.024	0.012	< 0.012	No	No	
5276940	6- Cedar St 6th Floor Scaffolding	4/7/2008	7:56 AM	4/9/2008	7:59 AM	1,442	5,047	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.041	0.049	0.025	0.17	< 0.0020	0.085	< 0.0020	0.016	0.013	< 0.012	No	No		
5276944	7- Roof, East Facade	4/7/2008	7:19 AM	4/9/2008	7:13 AM	1,434	5,144	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.026	< 0.039	0.020	0.14	< 0.0019	0.107	< 0.0019	0.020	0.017	< 0.012	No	No		
5276948	8- Roof, North Facade	4/7/2008	7:56 AM	4/9/2008	7:43 AM	1,427	4,813	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/9/2008	0.030	0.052	0.023	0.12	< 0.0021	0.103	< 0.0021	0.021	0.015	0.012	< 0.013	No	No	
5276952	3-90 West Courtyard at 2nd Floor Level	4/8/2008	7:26 AM	4/9/2008	7:19 AM	1,433	5,016	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/10/2008	0.027	< 0.040	0.012	0.16	< 0.0020	0.015	< 0.0020	< 0.008	0.009	< 0.013	No	No		
5276904	4- Albany St 6th Floor Scaffolding	4/8/2008	8:20 AM	4/9/2008	8:05 AM	1,425	4,988	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/10/2008	< 0.008	< 0.040	< 0.008	0.14	< 0.0020	< 0.008	< 0.0020	< 0.008	0.008	< 0.012	No	No		
5276960	5- Washington St 6th Floor Scaffolding	4/8/2008	8:31 AM	4/9/2008	8:12 AM	1,421	4,974	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/10/2008	0.034	< 0.040	0.014	0.21	< 0.0020	0.022	< 0.0020	0.020	0.010	0.011	< 0.012	No	No	
5276976	6- Cedar St 6th Floor Scaffolding	4/8/2008	7:48 AM	4/9/2008	7:46 AM	1,438	5,105	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/10/2008	0.033	< 0.039	0.019	0.19	< 0.0020	0.029	< 0.0020	0.010	0.014	< 0.012	No	No		
5276964	6- Cedar St 6th Floor Scaffolding	4/8/2008	8:01 AM	4/9/2008	7:53 AM	1,432	5,084	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/10/2008	0.028	< 0.039	0.016	0.26	< 0.0020	0.023	< 0.0020	0.009	0.013	< 0.012	No	No		
5276968	7- Roof, East Facade	4/8/2008	7:51 AM	4/9/2008	7:25 AM	1,444	5,107	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/10/2008	0.025	< 0.039	0.013	0.15	< 0.0020	0.025	< 0.0020	0.008	0.012	< 0.012	No	No		
5276972	8- Roof, North Facade	4/8/2008	7:37 AM	4/9/2008	7:37 AM	1,426	5,176	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/10/2008	0.020	0.051	0.017	0.18	< 0.0019	0.027	< 0.0019	0.009	0.015	< 0.012	No	No		
5276900	3-90 West Courtyard at 2nd Floor Level	4/9/2008	7:21 AM	4/10/2008	7:15 AM	1,424	5,091	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/11/2008	0.045	0.050	0.017	0.31	< 0.0020	0.054	< 0.0020	0.014	0.024	< 0.012	No	No		
5276956	4- Albany St 6th Floor Scaffolding	4/9/2008	8:06 AM	4/10/2008	7:49 AM	1,421	4,974	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/11/2008	0.091	0.053	0.035	0.24	< 0.0020	0.085	< 0.0020	0.022	0.036	0.012	< 0.012	No	No	
5276969	5- Washington St 6th Floor Scaffolding	4/9/2008	8:20 AM	4/10/2008	7:57 AM	1,417	5,030	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/11/2008	0.060	0.051	0.020	0.19	< 0.0020	0.058	< 0.0020	0.019	0.025	< 0.013	No	No		
5276974	6- Cedar St 6th Floor Scaffolding	4/9/2008	7:30 AM	4/10/2008	7:30 AM	1,415	5,023	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/11/2008	0.062	0.050	0.020	0.21	< 0.0020	0.055	< 0.0020	0.035	0.024	< 0.012	No	No		
5276916	7- Roof, East Facade	4/9/2008	7:55 AM	4/10/2008	8:50 AM	1,520	5,016	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/11/2008	0.042	0.055	0.019	0.18	< 0.0020	0.054	< 0.0020	0.009	0.025	< 0.012	No	No		
5276920	8- Roof, North Facade	4/9/2008	7:43 AM	4/10/2008	8:40 AM	1,497	5,385	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/11/2008	0.039	0.054	0.018	0.18	< 0.0019	0.053	< 0.0019	0.009	0.025	< 0.011	No	No		
5276987	3-90 West Courtyard at 2nd Floor Level	4/10/2008	7:17 AM	4/11/2008	7:20 AM	1,443	5,123	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/12/2008	0.054	0.049	0.023	0.16	< 0.0020	0.055	< 0.0020	0.020	0.016	< 0.012	No	No		
5276934	4- Albany St 6th Floor Scaffolding	4/10/2008	7:51 AM	4/11/2008	7:47 AM	1,436	5,026	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/12/2008	0.057	0.051	0.018	0.15	< 0.0020	0.051	< 0.0020	0.016	0.011	< 0.012	No	No		
5276938	5- Washington St 6th Floor Scaffolding	4/10/2008	7:57 AM	4/11/2008	7:57 AM	1,440	5,040	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/12/2008	0.065	0.041	0.026	0.16	< 0.0020	0.055	< 0.0020	0.016	0.014	< 0.012	No	No		
5276942	6- Cedar St 6th Floor Scaffolding	4/10/2008	7:53 AM	4/11/2008	7:46 AM	1,429	4,909	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/12/2008	0.054	0.061	0.021	0.15	< 0.0020	0.049	< 0.0020	0.015	0.011	< 0.012	No	No		
5276946	7- Roof, East Facade	4/10/2008	8:55 AM	4/11/2008	7:44 AM	1,369	4,559	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/12/2008	0.033	0.059	0.014	0.10	< 0.0022	0.029	< 0.0022	< 0.009	0.009	< 0.012	No	No		
5276950	8- Roof, North Facade	4/10/2008	8:46 AM	4/11/2008	8:01 AM	1,366	5,054	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/12/2008	0.050	0.043	0.023	0.17	< 0.0020	0.044	< 0.0020	0.012	0.012	< 0.011	No	No		
5276954	3-90 West Courtyard at 2nd Floor Level	4/11/2008	7:24 AM	4/12/2008	7:18 AM	1,434	5,019	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/14/2008	0.051	0.040	0.026	0.20	< 0.0020	0.040	< 0.0020	0.019	0.020	< 0.012	No	No		
5276958	4- Albany St 6th Floor Scaffolding	4/11/2008	7:50 AM	4/12/2008	7:46 AM	1,436	5,026	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/14/2008	0.055	< 0.040	0.029	0.21	< 0.0020	0.046	< 0.0020	< 0.020	0.037	0.021	< 0.011	No	No	
5276962	5- Washington St 6th Floor Scaffolding	4/11/2008	8:00 AM	4/12/2008	7:54 AM	1,434	5,047	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/14/2008	0.064	0.048	0.031	0.20	< 0.0020	0.048	< 0.0020	0.013	0.025	< 0.011	No	No		
5276966	6- Cedar St 6th Floor Scaffolding	4/11/2008	7:36 AM	4/12/2008	7:33 AM	1,435	5,023	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/14/2008	0.058	0.049	0.025	0.17	< 0.0020	0.041	< 0.0020	0.015	0.023	< 0.011	No	No		
5276970	7- Roof, East Facade	4/11/2008	7:49 AM	4/12/2008	8:24 AM	1,475	4,754	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/14/2008	0.051	0.048	0.030	0.25	< 0.0021	0.083	< 0.0021	0.021	0.024	< 0.012	No	No		
5276974	8- Roof, North Facade	4/11/2008	8:07 AM	4/12/2008	8:53 AM	1,486	4,881	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/14/2008	0.051	< 0.041	0.029	0.21	< 0.0021	0.044	< 0.0021	0.022	0.023	< 0.011	No	No		
5276978	3-90 West Courtyard at 2nd Floor Level	4/12/2008	7:20 AM	4/13/2008	7:17 AM	1,437	5,030	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/15/2008	0.019	0.041	0.011	0.13	< 0.0020	0.018	< 0.0020	0.010	0.011	< 0.011	No	No		
5276982	4- Albany St 6th Floor Scaffolding	4/12/2008	7:48 AM	4/13/2008	7:36 AM	1,428	4,988	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/15/2008	0.022	< 0.040	0.011	0.12	< 0.0020	0.022	< 0.0020	0.011	0.011	< 0.011	No	No		
5276986	5- Washington St 6th Floor Scaffolding	4/12/2008	7:59 AM	4/13/2008	7:45 AM	1,426	4,766	Metals	NIOSH 7300 Modified ICP-MS	R.J.G. Metals	4/15/2008	0.022	0.044	0.013	0.13	< 0.0021	0.022	< 0.0021	0.012	0.010	< 0.011	No	No		
5276990	6- Cedar St 6th Floor Scaffolding	4/12/2008	7:35 AM	4/13/2008	8:00 AM	1,465	5,126	Metals	NIOSH 7300 Modified ICP-MS																

MasterWorks - 130 Cedar Building, Community Monitoring															
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Date	Mercury Concentration (ng/m ³)	EPA Site Specific Trigger Level for Mercury (ng/m ³)	Exceeds Target Air quality? or EPA Site Specific Level?	Comments
5276923	3 - 90 West Courtyard at 2nd Floor Level	4/6/2008	7:26 AM	4/7/2008	7:23 AM	1,437	575	Mercury	EPA 324/1631 mod.	BRL	04/08/2008	6	3000 ng/m3	No	
5276919	4 - Albany St 6th Floor Scaffolding	4/6/2008	7:56 AM	4/7/2008	8:12 AM	1,456	582	Mercury	EPA 324/1631 mod.	BRL	04/08/2008	< 5	3000 ng/m3	No	
5276907	5 - Washington St 6th Floor Scaffolding	4/6/2008	8:05 AM	4/7/2008	8:24 AM	1,459	576	Mercury	EPA 324/1631 mod.	BRL	04/08/2008	8	3000 ng/m3	No	
5276911	6 - Cedar St 6th Floor Scaffolding	4/6/2008	7:46 AM	4/7/2008	7:49 AM	1,443	570	Mercury	EPA 324/1631 mod.	BRL	04/08/2008	7	3000 ng/m3	No	
5276915	7 - Roof, East Facade	4/6/2008	7:22 AM	4/7/2008	7:13 AM	1,431	558	Mercury	EPA 324/1631 mod.	BRL	04/08/2008	< 6	3000 ng/m3	No	
5276903	8 - Roof, North Facade	4/6/2008	7:33 AM	4/7/2008	7:47 AM	1,454	422	Mercury	EPA 324/1631 mod.	BRL	04/08/2008	8	3000 ng/m3	No	
5276931	3 - 90 West Courtyard at 2nd Floor Level	4/7/2008	7:27 AM	4/8/2008	7:24 AM	1,437	575	Mercury	EPA 324/1631 mod.	BRL	04/09/2008	< 5	3000 ng/m3	No	
5276935	4 - Albany St 6th Floor Scaffolding	4/7/2008	8:16 AM	4/8/2008	8:16 AM	1,440	576	Mercury	EPA 324/1631 mod.	BRL	04/09/2008	< 5	3000 ng/m3	No	
5276939	5 - Washington St 6th Floor Scaffolding	4/7/2008	8:29 AM	4/8/2008	8:28 AM	1,439	576	Mercury	EPA 324/1631 mod.	BRL	04/09/2008	< 5	3000 ng/m3	No	
5276943	6 - Cedar St 6th Floor Scaffolding	4/7/2008	7:56 AM	4/8/2008	7:58 AM	1,442	570	Mercury	EPA 324/1631 mod.	BRL	04/09/2008	< 5	3000 ng/m3	No	
5276947	7 - Roof, East Facade	4/7/2008	7:19 AM	4/8/2008	7:13 AM	1,434	588	Mercury	EPA 324/1631 mod.	BRL	04/09/2008	< 5	3000 ng/m3	No	
5276951	8 - Roof, North Facade	4/7/2008	7:56 AM	4/8/2008	7:43 AM	1,427	564	Mercury	EPA 324/1631 mod.	BRL	04/09/2008	< 5	3000 ng/m3	No	
5276955	3 - 90 West Courtyard at 2nd Floor Level	4/8/2008	7:26 AM	4/9/2008	7:19 AM	1,433	573	Mercury	EPA 324/1631 mod.	BRL	04/10/2008	< 5	3000 ng/m3	No	
5276959	4 - Albany St 6th Floor Scaffolding	4/8/2008	8:20 AM	4/9/2008	8:05 AM	1,425	570	Mercury	EPA 324/1631 mod.	BRL	04/10/2008	< 5	3000 ng/m3	No	
5276963	5 - Washington St 6th Floor Scaffolding	4/8/2008	8:31 AM	4/9/2008	8:12 AM	1,421	568	Mercury	EPA 324/1631 mod.	BRL	04/10/2008	10	3000 ng/m3	No	
5276979	6 - Cedar St 6th Floor Scaffolding	4/8/2008	7:48 AM	4/9/2008	7:46 AM	1,438	575	Mercury	EPA 324/1631 mod.	BRL	04/10/2008	10	3000 ng/m3	No	
5276967	6 - Cedar St 6th Floor Scaffolding	4/8/2008	8:01 AM	4/9/2008	7:53 AM	1,432	573	Mercury	EPA 324/1631 mod.	BRL	04/10/2008	12	3000 ng/m3	No	
5276971	7 - Roof, East Facade	4/8/2008	7:21 AM	4/9/2008	7:25 AM	1,444	563	Mercury	EPA 324/1631 mod.	BRL	04/10/2008	13	3000 ng/m3	No	
5276975	8 - Roof, North Facade	4/8/2008	7:51 AM	4/9/2008	7:37 AM	1,426	585	Mercury	EPA 324/1631 mod.	BRL	04/10/2008	7	3000 ng/m3	No	
5276803	3 - 90 West Courtyard at 2nd Floor Level	4/9/2008	7:21 AM	4/10/2008	7:15 AM	1,434	574	Mercury	EPA 324/1631 mod.	BRL	04/11/2008	< 5	3000 ng/m3	No	
5276807	4 - Albany St 6th Floor Scaffolding	4/9/2008	8:08 AM	4/10/2008	7:49 AM	1,421	561	Mercury	EPA 324/1631 mod.	BRL	04/11/2008	< 5	3000 ng/m3	No	
5276811	5 - Washington St 6th Floor Scaffolding	4/9/2008	8:20 AM	4/10/2008	7:57 AM	1,417	567	Mercury	EPA 324/1631 mod.	BRL	04/11/2008	6	3000 ng/m3	No	
5276815	6 - Cedar St 6th Floor Scaffolding	4/9/2008	7:55 AM	4/10/2008	7:30 AM	1,415	566	Mercury	EPA 324/1631 mod.	BRL	04/11/2008	6	3000 ng/m3	No	
5276819	7 - Roof, East Facade	4/9/2008	7:30 AM	4/10/2008	8:50 AM	1,520	593	Mercury	EPA 324/1631 mod.	BRL	04/11/2008	< 5	3000 ng/m3	No	
5276823	8 - Roof, North Facade	4/9/2008	7:43 AM	4/10/2008	8:40 AM	1,497	614	Mercury	EPA 324/1631 mod.	BRL	04/11/2008	< 5	3000 ng/m3	No	
5276990	3 - 90 West Courtyard at 2nd Floor Level	4/10/2008	7:17 AM	4/11/2008	7:20 AM	1,443	577	Mercury	EPA 324/1631 mod.	BRL	04/12/2008	< 5	3000 ng/m3	No	
5276537	4 - Albany St 6th Floor Scaffolding	4/10/2008	7:51 AM	4/11/2008	7:47 AM	1,436	589	Mercury	EPA 324/1631 mod.	BRL	04/12/2008	< 5	3000 ng/m3	No	
5276541	5 - Washington St 6th Floor Scaffolding	4/10/2008	7:57 AM	4/11/2008	7:57 AM	1,440	576	Mercury	EPA 324/1631 mod.	BRL	04/12/2008	< 5	3000 ng/m3	No	
5276545	6 - Cedar St 6th Floor Scaffolding	4/10/2008	7:33 AM	4/11/2008	7:36 AM	1,443	577	Mercury	EPA 324/1631 mod.	BRL	04/12/2008	< 5	3000 ng/m3	No	
5276549	7 - Roof, East Facade	4/10/2008	8:55 AM	4/11/2008	7:44 AM	1,369	534	Mercury	EPA 324/1631 mod.	BRL	04/12/2008	< 6	3000 ng/m3	No	
5276553	8 - Roof, North Facade	4/10/2008	8:45 AM	4/11/2008	8:01 AM	1,396	565	Mercury	EPA 324/1631 mod.	BRL	04/12/2008	< 5	3000 ng/m3	No	
5276557	3 - 90 West Courtyard at 2nd Floor Level	4/11/2008	7:20 AM	4/12/2008	7:18 AM	1,434	559	Mercury	EPA 324/1631 mod.	BRL	04/14/2008	< 6	3000 ng/m3	No	
5276561	4 - Albany St 6th Floor Scaffolding	4/11/2008	7:50 AM	4/12/2008	7:46 AM	1,436	574	Mercury	EPA 324/1631 mod.	BRL	04/14/2008	< 5	3000 ng/m3	No	
5276565	5 - Washington St 6th Floor Scaffolding	4/11/2008	8:00 AM	4/12/2008	7:54 AM	1,434	574	Mercury	EPA 324/1631 mod.	BRL	04/14/2008	< 5	3000 ng/m3	No	
5276569	6 - Cedar St 6th Floor Scaffolding	4/11/2008	7:38 AM	4/12/2008	7:33 AM	1,435	581	Mercury	EPA 324/1631 mod.	BRL	04/14/2008	< 5	3000 ng/m3	No	
5276573	7 - Roof, East Facade	4/11/2008	7:49 AM	4/12/2008	8:24 AM	1,475	568	Mercury	EPA 324/1631 mod.	BRL	04/14/2008	< 5	3000 ng/m3	No	
5276577	8 - Roof, North Facade	4/11/2008	8:07 AM	4/12/2008	8:53 AM	1,486	580	Mercury	EPA 324/1631 mod.	BRL	04/14/2008	7	3000 ng/m3	No	
5276581	3 - 90 West Courtyard at 2nd Floor Level	4/12/2008	7:20 AM	4/13/2008	7:17 AM	1,437	575	Mercury	EPA 324/1631 mod.	BRL	04/15/2008	< 5	3000 ng/m3	No	
5276585	4 - Albany St 6th Floor Scaffolding	4/12/2008	7:48 AM	4/13/2008	7:36 AM	1,428	578	Mercury	EPA 324/1631 mod.	BRL	04/15/2008	< 5	3000 ng/m3	No	
5276589	5 - Washington St 6th Floor Scaffolding	4/12/2008	7:59 AM	4/13/2008	7:45 AM	1,426	578	Mercury	EPA 324/1631 mod.	BRL	04/15/2008	< 5	3000 ng/m3	No	
5276593	6 - Cedar St 6th Floor Scaffolding	4/12/2008	7:35 AM	4/13/2008	8:00 AM	1,465	579	Mercury	EPA 324/1631 mod.	BRL	04/15/2008	< 5	3000 ng/m3	No	
5276597	7 - Roof, East Facade	4/12/2008	8:29 AM	4/13/2008	7:07 AM	1,358	543	Mercury	EPA 324/1631 mod.	BRL	04/15/2008	< 6	3000 ng/m3	No	
5276603	8 - Roof, North Facade	4/12/2008	8:59 AM	4/13/2008	7:41 AM	1,362	572	Mercury	EPA 324/1631 mod.	BRL	04/15/2008	< 5	3000 ng/m3	No	

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Volume (liters)	Analysis	Analytical Method	Lab	Lab Sample Receipt Date	Asbestos Concentration (f/cc)	MMVF Concentration (f/cc)	EPA Site Specific Trigger Level	Exceeds EPA Site Specific Trigger Level?	Comments
5276922	3 - 90 West Courtyard at 2nd Floor Level	4/6/2008	7:26 AM	4/7/2008	7:23 AM	1,437	4,239	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/8/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276918	4 - Albany St 6th Floor Scaffolding	4/6/2008	7:56 AM	4/7/2008	8:12 AM	1,456	4,368	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/8/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276906	5 - Washington St 6th Floor Scaffolding	4/6/2008	8:05 AM	4/7/2008	8:24 AM	1,459	4,523	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/8/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5276910	6 - Cedar St 6th Floor Scaffolding	4/6/2008	7:46 AM	4/7/2008	7:49 AM	1,443	4,401	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/8/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276914	7 - Roof, East Facade	4/6/2008	7:22 AM	4/7/2008	7:13 AM	1,431	4,319	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/8/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276902	8 - Roof, North Facade	4/6/2008	7:33 AM	4/7/2008	7:47 AM	1,454	4,454	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/8/2008	<0.00005	0.00005	0.0009 f/cc	No	
5276930	3 - 90 West Courtyard at 2nd Floor Level	4/7/2008	7:27 AM	4/8/2008	7:24 AM	1,437	4,383	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/9/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276934	4 - Albany St 6th Floor Scaffolding	4/7/2008	8:16 AM	4/8/2008	8:16 AM	1,440	4,176	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/9/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276938	5 - Washington St 6th Floor Scaffolding	4/7/2008	8:29 AM	4/8/2008	8:28 AM	1,439	4,245	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/9/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276942	6 - Cedar St 6th Floor Scaffolding	4/7/2008	7:56 AM	4/8/2008	7:58 AM	1,442	4,326	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/9/2008	<0.00005	0.00005	0.0009 f/cc	No	
5276946	7 - Roof, East Facade	4/7/2008	7:19 AM	4/8/2008	7:13 AM	1,434	4,357	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/9/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276950	8 - Roof, North Facade	4/7/2008	7:56 AM	4/8/2008	7:43 AM	1,427	4,383	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/9/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276954	3 - 90 West Courtyard at 2nd Floor Level	4/8/2008	7:26 AM	4/9/2008	7:19 AM	1,433	4,299	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/10/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276806	4 - Albany St 6th Floor Scaffolding	4/8/2008	8:20 AM	4/9/2008	8:05 AM	1,425	4,133	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/10/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276962	5 - Washington St 6th Floor Scaffolding	4/8/2008	8:31 AM	4/9/2008	8:12 AM	1,421	4,192	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/10/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276978	6 - Cedar St 6th Floor Scaffolding	4/8/2008	7:48 AM	4/9/2008	7:46 AM	1,438	4,386	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/10/2008	<0.00005	0.00009	0.0009 f/cc	No	
5276966	6 - Cedar St 6th Floor Scaffolding	4/8/2008	8:01 AM	4/9/2008	7:53 AM	1,432	4,224	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/10/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276970	7 - Roof, East Facade	4/8/2008	7:21 AM	4/9/2008	7:25 AM	1,444	4,397	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/10/2008	<0.00005	0.00009	0.0009 f/cc	No	
5276974	8 - Roof, North Facade	4/8/2008	7:51 AM	4/9/2008	7:37 AM	1,426	4,394	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/10/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276802	3 - 90 West Courtyard at 2nd Floor Level	4/9/2008	7:21 AM	4/10/2008	7:15 AM	1,434	4,374	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/11/2008	0.00005	<0.00005	0.0009 f/cc	No	
5276958	4 - Albany St 6th Floor Scaffolding	4/9/2008	8:08 AM	4/10/2008	7:49 AM	1,421	4,121	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/11/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276810	5 - Washington St 6th Floor Scaffolding	4/9/2008	8:20 AM	4/10/2008	7:57 AM	1,417	4,393	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/11/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276814	6 - Cedar St 6th Floor Scaffolding	4/9/2008	7:55 AM	4/10/2008	7:30 AM	1,415	4,316	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/11/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276818	7 - Roof, East Facade	4/9/2008	7:30 AM	4/10/2008	8:50 AM	1,520	4,703	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/11/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5276822	8 - Roof, North Facade	4/9/2008	7:43 AM	4/10/2008	8:40 AM	1,497	4,614	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/11/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5276989	3 - 90 West Courtyard at 2nd Floor Level	4/10/2008	7:17 AM	4/11/2008	7:20 AM	1,443	3,896	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/12/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276536	4 - Albany St 6th Floor Scaffolding	4/10/2008	7:51 AM	4/11/2008	7:47 AM	1,436	4,308	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/12/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276540	5 - Washington St 6th Floor Scaffolding	4/10/2008	7:57 AM	4/11/2008	7:57 AM	1,440	4,248	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/12/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276544	6 - Cedar St 6th Floor Scaffolding	4/10/2008	7:33 AM	4/11/2008	7:36 AM	1,443	4,329	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/12/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276548	7 - Roof, East Facade	4/10/2008	8:55 AM	4/11/2008	7:44 AM	1,369	4,200	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/12/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276552	8 - Roof, North Facade	4/10/2008	8:45 AM	4/11/2008	8:01 AM	1,396	4,333	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/12/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276556	3 - 90 West Courtyard at 2nd Floor Level	4/11/2008	7:24 AM	4/12/2008	7:18 AM	1,434	4,302	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/14/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276560	4 - Albany St 6th Floor Scaffolding	4/11/2008	7:50 AM	4/12/2008	7:46 AM	1,436	4,236	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/14/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276564	5 - Washington St 6th Floor Scaffolding	4/11/2008	8:00 AM	4/12/2008	7:54 AM	1,434	4,374	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/14/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276568	6 - Cedar St 6th Floor Scaffolding	4/11/2008	7:38 AM	4/12/2008	7:33 AM	1,435	4,233	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/14/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276572	7 - Roof, East Facade	4/11/2008	7:49 AM	4/12/2008	8:24 AM	1,475	4,653	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/14/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5276576	8 - Roof, North Facade	4/11/2008	8:07 AM	4/12/2008	8:53 AM	1,486	4,581	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/14/2008	<0.00004	<0.00004	0.0009 f/cc	No	
5276580	3 - 90 West Courtyard at 2nd Floor Level	4/12/2008	7:20 AM	4/13/2008	7:17 AM	1,437	4,383	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/15/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276584	4 - Albany St 6th Floor Scaffolding	4/12/2008	7:48 AM	4/13/2008	7:36 AM	1,428	4,355	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/15/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276588	5 - Washington St 6th Floor Scaffolding	4/12/2008	7:59 AM	4/13/2008	7:45 AM	1,426	4,421	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/15/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276592	6 - Cedar St 6th Floor Scaffolding	4/12/2008	7:35 AM	4/13/2008	8:00 AM	1,465	4,395	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/15/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276596	7 - Roof, East Facade	4/12/2008	8:29 AM	4/13/2008	7:07 AM	1,358	3,965	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/15/2008	<0.00005	<0.00005	0.0009 f/cc	No	
5276602	8 - Roof, North Facade	4/12/2008	8:59 AM	4/13/2008	7:41 AM	1,362	4,097	Asbestos PCME fibers	ISO 14966 mod	RJLG SEM	4/15/2008	<0.00005	<0.00005	0.0009 f/cc	No	

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total collection time, minutes	Sample Volume (liters)	Analyte	Analytical Method	Lab	Lab Sample Receipt Date	Respirable Dust Concentration (mg/m ³)	Respirable Quartz Concentration (mg/m ³)	Target Air quality Level for Respirable Quartz (mg/m ³)	EPA Site Specific Trigger Level for Respirable Quartz (mg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
5276920	3- 90 West Courtyard at 2nd Floor Level	4/6/2008	7:26 AM	4/7/2008	7:23 AM	7:26 AM	1,437	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/8/2008	< 0.028	< 0.001	0.01	0.01	No	
5276916	4- Albany St 6th Floor Scaffolding	4/9/2008	7:56 AM	4/7/2008	8:12 AM	7:56 AM	1,456	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.031	< 0.002	0.01	0.01	No	
5276904	5- Washington St 6th Floor Scaffolding	4/6/2008	8:05 AM	4/7/2008	8:24 AM	8:05 AM	1,459	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/8/2008	< 0.029	< 0.001	0.01	0.01	No	
5276908	6- Cedar St 6th Floor Scaffolding	4/6/2008	7:46 AM	4/7/2008	7:49 AM	7:46 AM	1,443	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/8/2008	< 0.029	< 0.001	0.01	0.01	No	
5276912	7- Roof, East Facade	4/6/2008	7:22 AM	4/7/2008	7:13 AM	7:22 AM	1,431	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.027	< 0.001	0.01	0.01	No	
5276900	8- Roof, North Facade	4/6/2008	7:33 AM	4/7/2008	7:47 AM	7:33 AM	1,454	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.029	< 0.001	0.01	0.01	No	
5276929	3- 90 West Courtyard at 2nd Floor Level	4/7/2008	7:27 AM	4/8/2008	7:24 AM	7:27 AM	1,437	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.028	< 0.001	0.01	0.01	No	
5276933	4- Albany St 6th Floor Scaffolding	4/7/2008	8:16 AM	4/8/2008	8:16 AM	8:16 AM	1,440	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.027	< 0.001	0.01	0.01	No	
5276937	5- Washington St 6th Floor Scaffolding	4/7/2008	8:29 AM	4/9/2008	8:29 AM	8:29 AM	1,439	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.028	< 0.001	0.01	0.01	No	
5276941	6- Cedar St 6th Floor Scaffolding	4/7/2008	7:56 AM	4/8/2008	7:58 AM	7:56 AM	1,442	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.027	< 0.001	0.01	0.01	No	
5276945	7- Roof, East Facade	4/7/2008	7:19 AM	4/8/2008	7:13 AM	7:19 AM	1,434	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.027	< 0.001	0.01	0.01	No	
5276949	8- Roof, North Facade	4/7/2008	7:56 AM	4/8/2008	7:43 AM	7:56 AM	1,427	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/9/2008	< 0.029	< 0.001	0.01	0.01	No	
5276953	3- 90 West Courtyard at 2nd Floor Level	4/8/2008	7:26 AM	4/9/2008	7:19 AM	7:26 AM	1,433	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/10/2008	< 0.028	< 0.001	0.01	0.01	No	
5276956	4- Albany St 6th Floor Scaffolding	4/8/2008	8:20 AM	4/9/2008	8:06 AM	8:20 AM	1,425	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/10/2008	< 0.028	< 0.001	0.01	0.01	No	
5276961	5- Washington St 6th Floor Scaffolding	4/8/2008	8:31 AM	4/9/2008	8:16 AM	8:31 AM	1,421	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/10/2008	< 0.028	< 0.001	0.01	0.01	No	
5276977	6- Cedar St 6th Floor Scaffolding	4/8/2008	7:48 AM	4/9/2008	7:46 AM	7:48 AM	1,436	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/10/2008	< 0.028	< 0.001	0.01	0.01	No	
5276965	6- Cedar St 6th Floor Scaffolding	4/8/2008	8:01 AM	4/9/2008	7:53 AM	8:01 AM	1,432	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/10/2008	< 0.028	< 0.001	0.01	0.01	No	
5276969	7- Roof, East Facade	4/8/2008	7:21 AM	4/9/2008	7:25 AM	7:21 AM	1,444	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/10/2008	< 0.027	< 0.001	0.01	0.01	No	
5276973	8- Roof, North Facade	4/8/2008	7:51 AM	4/9/2008	7:37 AM	7:51 AM	1,426	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/10/2008	< 0.028	< 0.001	0.01	0.01	No	
5276981	3- 90 West Courtyard at 2nd Floor Level	4/9/2008	7:21 AM	4/10/2008	7:15 AM	7:21 AM	1,434	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/11/2008	< 0.027	< 0.001	0.01	0.01	No	
5276987	4- Albany St 6th Floor Scaffolding	4/9/2008	8:08 AM	4/10/2008	7:49 AM	8:08 AM	1,421	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/11/2008	0.036	< 0.001	0.01	0.01	No	
5276989	5- Washington St 6th Floor Scaffolding	4/9/2008	8:20 AM	4/10/2008	7:57 AM	8:20 AM	1,417	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/11/2008	< 0.028	< 0.001	0.01	0.01	No	
5276913	6- Cedar St 6th Floor Scaffolding	4/9/2008	7:55 AM	4/10/2008	7:30 AM	7:55 AM	1,415	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/11/2008	< 0.026	< 0.001	0.01	0.01	No	
5276917	7- Roof, East Facade	4/9/2008	7:30 AM	4/10/2008	8:00 AM	7:30 AM	1,520	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/11/2008	< 0.025	< 0.001	0.01	0.01	No	
5276921	8- Roof, North Facade	4/9/2008	7:43 AM	4/10/2008	8:40 AM	7:43 AM	1,497	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/11/2008	< 0.026	< 0.001	0.01	0.01	No	
5276988	3- 90 West Courtyard at 2nd Floor Level	4/10/2008	7:17 AM	4/11/2008	7:20 AM	7:17 AM	1,443	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/12/2008	< 0.027	< 0.001	0.01	0.01	No	
5276535	4- Albany St 6th Floor Scaffolding	4/10/2008	7:51 AM	4/11/2008	7:24 AM	7:51 AM	1,413	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/12/2008	< 0.029	< 0.001	0.01	0.01	No	
5276539	5- Washington St 6th Floor Scaffolding	4/10/2008	7:57 AM	4/11/2008	7:57 AM	7:57 AM	1,440	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/12/2008	< 0.027	< 0.001	0.01	0.01	No	
5276543	6- Cedar St 6th Floor Scaffolding	4/10/2008	7:33 AM	4/11/2008	7:36 AM	7:33 AM	1,443	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/12/2008	< 0.028	< 0.001	0.01	0.01	No	
5276547	7- Roof, East Facade	4/10/2008	8:55 AM	4/11/2008	7:44 AM	8:55 AM	1,369	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/12/2008	< 0.027	< 0.001	0.01	0.01	No	
5276551	8- Roof, North Facade	4/10/2008	8:45 AM	4/11/2008	8:01 AM	8:45 AM	1,396	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/12/2008	< 0.028	< 0.001	0.01	0.01	No	
5276555	3- 90 West Courtyard at 2nd Floor Level	4/11/2008	7:24 AM	4/12/2008	7:18 AM	7:24 AM	1,434	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/14/2008	< 0.028	< 0.001	0.01	0.01	No	
5276559	4- Albany St 6th Floor Scaffolding	4/11/2008	7:50 AM	4/12/2008	7:46 AM	7:50 AM	1,436	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/14/2008	< 0.028	< 0.001	0.01	0.01	No	
5276563	5- Washington St 6th Floor Scaffolding	4/11/2008	8:00 AM	4/12/2008	7:54 AM	8:00 AM	1,434	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/14/2008	< 0.029	< 0.001	0.01	0.01	No	
5276567	6- Cedar St 6th Floor Scaffolding	4/11/2008	7:38 AM	4/12/2008	7:33 AM	7:38 AM	1,435	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/14/2008	< 0.028	< 0.001	0.01	0.01	No	
5276571	7- Roof, East Facade	4/11/2008	7:49 AM	4/12/2008	8:24 AM	7:49 AM	1,475	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/14/2008	< 0.026	< 0.001	0.01	0.01	No	
5276575	8- Roof, North Facade	4/11/2008	8:07 AM	4/12/2008	8:53 AM	8:07 AM	1,486	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/14/2008	< 0.031	< 0.002	0.01	0.01	No	
5276579	3- 90 West Courtyard at 2nd Floor Level	4/12/2008	7:20 AM	4/13/2008	7:17 AM	7:20 AM	1,437	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/15/2008	< 0.027	< 0.001	0.01	0.01	No	
5276583	4- Albany St 6th Floor Scaffolding	4/12/2008	7:48 AM	4/13/2008	7:36 AM	7:48 AM	1,428	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/15/2008	< 0.028	< 0.001	0.01	0.01	No	
5276587	5- Washington St 6th Floor Scaffolding	4/12/2008	7:59 AM	4/13/2008	7:45 AM	7:59 AM	1,426	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/15/2008	< 0.028	< 0.001	0.01	0.01	No	
5276591	6- Cedar St 6th Floor Scaffolding	4/12/2008	7:35 AM	4/13/2008	8:05 AM	7:35 AM	1,465	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/15/2008	< 0.030	< 0.002	0.01	0.01	No	
5276595	7- Roof, East Facade	4/12/2008	8:29 AM	4/13/2008	7:07 AM	8:29 AM	1,358	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/15/2008	< 0.029	< 0.001	0.01	0.01	No	
5276601	8- Roof, North Facade	4/12/2008	8:59 AM	4/13/2008	7:41 AM	8:59 AM	1,362	Dust and Quartz	NIOSH 0600/7500	RJLG XRD	4/15/2008	< 0.039	< 0.002	0.01	0.01	No	


MasterWorks - 130 Cedar Building, Community Monitoring														
Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM _{2.5} Avg. Concentration (µg/m ³)	EPA Site Specific Trigger Level for PM _{2.5} (µg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	4/6/2008	12:00 AM	4/7/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	11	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/6/2008	12:00 AM	4/7/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	15	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/6/2008	12:00 AM	4/7/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	10	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/6/2008	12:00 AM	4/7/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	11	65	No	
N/A	7 - Roof, East	4/6/2008	12:00 AM	4/7/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5001	N/A	12	65	No	
N/A	8 - Roof, North	4/6/2008	12:00 AM	4/7/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	11	65	No	
N/A	3 - Courtyard, 2nd Floor Level	4/7/2008	12:00 AM	4/8/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	17	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/7/2008	12:00 AM	4/8/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	18	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/7/2008	12:00 AM	4/8/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	12	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/7/2008	12:00 AM	4/8/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	13	65	No	
N/A	7 - Roof, East	4/7/2008	12:00 AM	4/8/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5001	N/A	16	65	No	
N/A	8 - Roof, North	4/7/2008	12:00 AM	4/8/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	16	65	No	
N/A	3 - Courtyard, 2nd Floor Level	4/8/2008	12:00 AM	4/9/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	19	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/8/2008	12:00 AM	4/9/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	15	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/8/2008	12:00 AM	4/9/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	14	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/8/2008	12:00 AM	4/9/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	15	65	No	
N/A	7 - Roof, East	4/8/2008	12:00 AM	4/9/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5001	N/A	20	65	No	
N/A	8 - Roof, North	4/8/2008	12:00 AM	4/9/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	17	65	No	
N/A	3 - Courtyard, 2nd Floor Level	4/9/2008	12:00 AM	4/10/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	23	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/9/2008	12:00 AM	4/10/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	19	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/9/2008	12:00 AM	4/10/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	20	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/9/2008	12:00 AM	4/10/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	21	65	No	
N/A	7 - Roof, East	4/9/2008	12:00 AM	4/10/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5001	N/A	30	65	No	
N/A	8 - Roof, North	4/9/2008	12:00 AM	4/10/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	28	65	No	
N/A	3 - Courtyard, 2nd Floor Level	4/10/2008	12:00 AM	4/11/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	39	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/10/2008	12:00 AM	4/11/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	26	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/10/2008	12:00 AM	4/11/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	27	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/10/2008	12:00 AM	4/11/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	29	65	No	
N/A	7 - Roof, East	4/10/2008	12:00 AM	4/11/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5001	N/A	36	65	No	
N/A	8 - Roof, North	4/10/2008	12:00 AM	4/11/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	26	65	No	
N/A	3 - Courtyard, 2nd Floor Level	4/11/2008	12:00 AM	4/12/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	27	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/11/2008	12:00 AM	4/12/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	24	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/11/2008	12:00 AM	4/12/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	26	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/11/2008	12:00 AM	4/12/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	26	65	No	
N/A	7 - Roof, East	4/11/2008	12:00 AM	4/12/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5001	N/A	25	65	No	
N/A	8 - Roof, North	4/11/2008	12:00 AM	4/12/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	22	65	No	
N/A	3 - Courtyard, 2nd Floor Level	4/12/2008	12:00 AM	4/13/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4526	N/A	26	65	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/12/2008	12:00 AM	4/13/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4728	N/A	24	65	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/12/2008	12:00 AM	4/13/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4729	N/A	32	65	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/12/2008	12:00 AM	4/13/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4527	N/A	26	65	No	
N/A	7 - Roof, East	4/12/2008	12:00 AM	4/13/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # F5001	N/A	17	65	No	
N/A	8 - Roof, North	4/12/2008	12:00 AM	4/13/2008	12:00 AM	1,440	PM _{2.5}	Direct Read	Met One E-BAM Unit # G4607	N/A	17	65	No	

MasterWorks - 130 Cedar Building, Community Monitoring

Sample No.	Sampling Location	Collection Start Date	Collection (Time on)	Collection End Date	Collection (Time off)	Total Collection Time, minutes	Analysis	Analytical Method	Instrument	Lab Sample Receipt Date	PM ₁₀ Avg. Concentration (µg/m ³)	EPA Site Specific Trigger Level for PM10 (µg/m ³)	Exceeds Target Air quality or EPA Site Specific Level?	Comments
N/A	3 - Courtyard, 2nd Floor Level	4/6/2008	12:00 AM	04/07/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	14	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/6/2008	12:00 AM	04/07/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	13	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/6/2008	12:00 AM	04/07/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	18	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/6/2008	12:00 AM	04/07/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	17	150	No	
N/A	7 - Roof, East	4/6/2008	12:00 AM	04/07/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3363	N/A	14	150	No	
N/A	8 - Roof, North	4/6/2008	12:00 AM	04/07/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5003	N/A	12	150	No	
N/A	3 - Courtyard, 2nd Floor Level	4/7/2008	12:00 AM	04/08/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	16	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/7/2008	12:00 AM	04/08/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	23	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/7/2008	12:00 AM	04/08/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	25	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/7/2008	12:00 AM	04/08/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	22	150	No	
N/A	7 - Roof, East	4/7/2008	12:00 AM	04/08/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3363	N/A	19	150	No	
N/A	8 - Roof, North	4/7/2008	12:00 AM	04/08/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5003	N/A	18	150	No	
N/A	3 - Courtyard, 2nd Floor Level	4/8/2008	12:00 AM	04/09/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	17	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/8/2008	12:00 AM	04/09/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	22	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/8/2008	12:00 AM	04/09/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	24	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/8/2008	12:00 AM	04/09/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	24	150	No	
N/A	7 - Roof, East	4/8/2008	12:00 AM	04/09/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3363	N/A	23	150	No	
N/A	8 - Roof, North	4/8/2008	12:00 AM	04/09/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5003	N/A	23	150	No	
N/A	3 - Courtyard, 2nd Floor Level	4/9/2008	12:00 AM	04/10/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	27	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/9/2008	12:00 AM	04/10/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	30	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/9/2008	12:00 AM	04/10/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	38	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/9/2008	12:00 AM	04/10/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	40	150	No	
N/A	7 - Roof, East	4/9/2008	12:00 AM	04/10/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3363	N/A	34	150	No	
N/A	8 - Roof, North	4/9/2008	12:00 AM	04/10/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5003	N/A	38	150	No	
N/A	3 - Courtyard, 2nd Floor Level	4/10/2008	12:00 AM	04/11/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	57	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/10/2008	12:00 AM	04/11/2008	12:00 AM	95	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	20	150	No	Instrument off-line for portion of day, conc. is not a 24 hr. avg.
N/A	5 - Washington St 6th Floor Level Scaffolding	4/10/2008	12:00 AM	04/11/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	39	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/10/2008	12:00 AM	04/11/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	38	150	No	
N/A	7 - Roof, East	4/10/2008	12:00 AM	04/11/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3363	N/A	46	150	No	
N/A	8 - Roof, North	4/10/2008	12:00 AM	04/11/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5003	N/A	47	150	No	
N/A	3 - Courtyard, 2nd Floor Level	4/11/2008	12:00 AM	04/12/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	40	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/11/2008	12:00 AM	04/12/2008	12:00 AM	750	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	61	150	No	Instrument off-line for portion of day, conc. is not a 24 hr. avg.
N/A	5 - Washington St 6th Floor Level Scaffolding	4/11/2008	12:00 AM	04/12/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	58	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/11/2008	12:00 AM	04/12/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	30	150	No	
N/A	7 - Roof, East	4/11/2008	12:00 AM	04/12/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3363	N/A	35	150	No	
N/A	8 - Roof, North	4/11/2008	12:00 AM	04/12/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5003	N/A	31	150	No	
N/A	3 - Courtyard, 2nd Floor Level	4/12/2008	12:00 AM	04/13/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4606	N/A	51	150	No	
N/A	4 - Albany St 6th Floor Level Scaffolding	4/12/2008	12:00 AM	04/13/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4731	N/A	33	150	No	
N/A	5 - Washington St 6th Floor Level Scaffolding	4/12/2008	12:00 AM	04/13/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4604	N/A	41	150	No	
N/A	6 - Cedar St 6th Floor Level Scaffolding	4/12/2008	12:00 AM	04/13/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # G4605	N/A	62	150	No	
N/A	7 - Roof, East	4/12/2008	12:00 AM	4/13/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # E3363	N/A	35	150	No	
N/A	8 - Roof, North	4/12/2008	12:00 AM	4/13/2008	12:00 AM	1,440	PM ₁₀	Direct Read	Met One E-BAM Unit # F5003	N/A	33	150	No	

350 Hochberg Road, Monroeville, PA 15146
 Phone: (724) 325-1776 Fax: (724) 733-1799

Mercury Vapor (Hg^0) Air Results for Outdoor Community
 Monitoring Stations by Location as recorded by the Lumex Analyzer

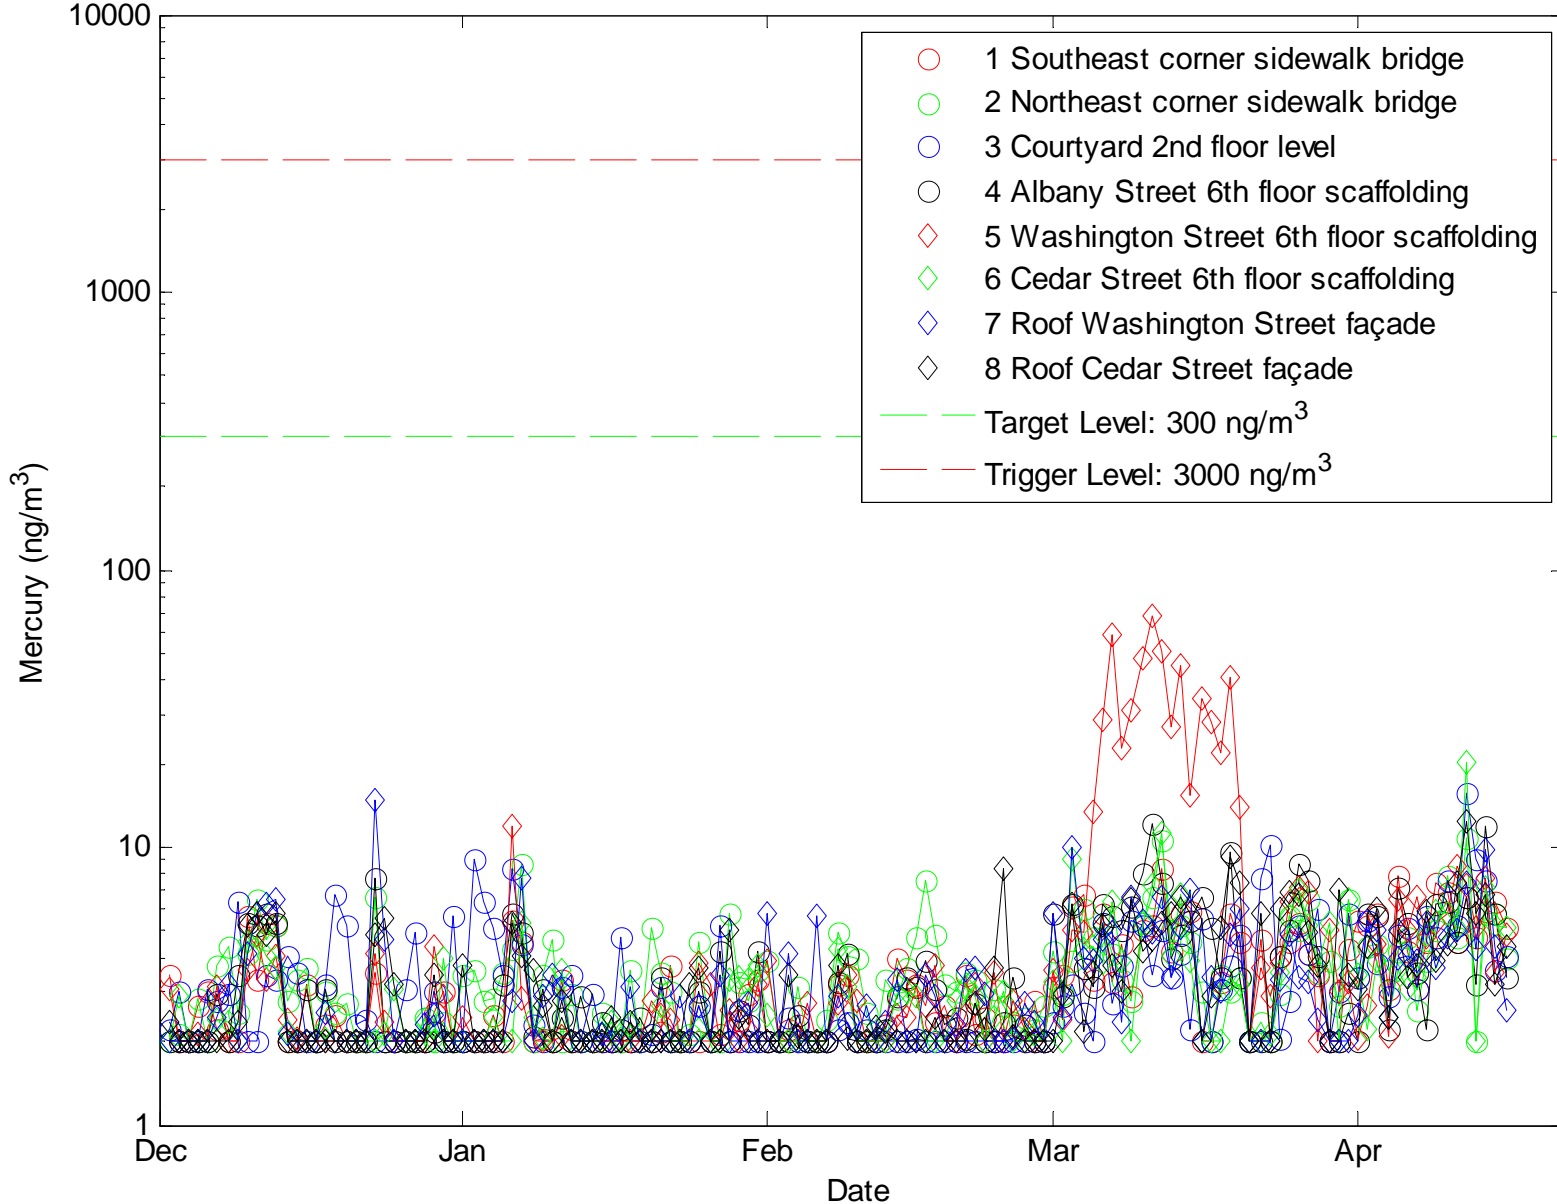

350 Hochberg Road, Monroeville, PA 15146
Phone: (724) 325-1776 Fax: (724) 733-1799

Report Summary
Air Mercury Results (Hg⁰, ng/m³) as recorded by the Lumex RA915+ analyzer
Week of 04/06/08 to 04/12/08

Date	Mercury (Hg ⁰) ng/m ³ 30-sec readings	1 Southeast corner sidewalk bridge	2 Northeast corner sidewalk bridge	3 Courtyard 2nd floor level	4 Albany Street 6th floor scaffolding	5 Washington Street 6th floor scaffolding	6 Cedar Street 6th floor scaffolding	7 Roof Washington Street façade	8 Roof Cedar Street façade
6-Apr-08	# Samples	27	27	27	27	27	30	27	27
	Average	4	5	5	5	5	3	4	3
	Maximum	8	6	7	6	11	7	7	6
7-Apr-08	# Samples	45	45	45	45	45	45	45	45
	Average	3	3	3	4	7	3	4	4
	Maximum	8	5	5	8	19	6	14	7
8-Apr-08	# Samples	18	18	18	18	18	18	18	18
	Average	5	4	6	2	5	5	5	6
	Maximum	7	7	11	4	7	10	7	9
9-Apr-08	# Samples	18	27	27	27	27	27	27	27
	Average	7	5	5	6	5	6	4	4
	Maximum	14	11	8	14	13	9	8	8
10-Apr-08	# Samples	36	36	36	36	33	36	36	36
	Average	7	8	8	6	6	6	5	5
	Maximum	14	12	15	12	8	11	9	9
11-Apr-08	# Samples	36	36	36	36	36	36	36	36
	Average	5	5	5	5	9	5	5	8
	Maximum	10	11	9	11	23	11	8	15
12-Apr-08	# Samples	18	18	18	18	18	18	18	18
	Average	7	11	16	7	7	20	7	12
	Maximum	8	17	25	9	11	31	10	18